





General characteristics

Description				Modular with transparent cover, 2 operating threshold
Residual operation characteristic				Type A
N° of operating threshold				2
Control circuit				
Toroidal transformer				External
Adjustments				
Tripping set-point ($I\Delta n$)		(x1)	A	0.03...30
Tripping delay time		(tx1)	s	0.2...10
Resetting				Configurable automatic or manual by button on front or digital input
Test Button				Yes
Shunt circuit control				No
Auxiliary supply				
Auxiliary rated supply voltage U_s				90...250VAC or 120...350VDC
Operational limits				90...250VAC or 120...350VDC
Output contacts				2
Rated frequency			Hz	50...60
Power consumption Max			VA	6
Relay outputs				
Relay state				Normally de-energised
Contact arrangement				2 changeover SPDT (trip)
Rated contact capacity IEC I_{th}				5A - 250VAC
Insulations				
Power frequency withstand voltage			kV	2.5kV for 60s
Indications				
Auxiliary voltage available (ON)				Green LED and green backlight
Relay tripping (TRIP)				Red LED and red backlight
Trip prealarm (ALARM)				Yellow LED and yellow backlight
Connections				

Terminals type	Fixed		
Tightening torque for terminals	max	Nm	0.5
	max	lbin	4.5
Conductor section			
AWG/Kcmil	min		24
	max		12
IEC	min	mm ²	0.2
	max	mm ²	2.5
Operations			
Mechanical life		cycles	10000000
Electrical life		cycles	300000
Ambient conditions			
Temperature			
Operating temperature	min	°C	-10
	max	°C	+60
Storage temperature	min	°C	-20
	max	°C	+80
Relative humidity		%	≤90%
Housing			
Material			Self-extinguishing polycarbonate
Mounting			35mm DIN rail
Degree of protection			IP20 terminals
Dimensions (W x H x D)		mm	52.5x90x60
Weight		g	200
Dimensions			

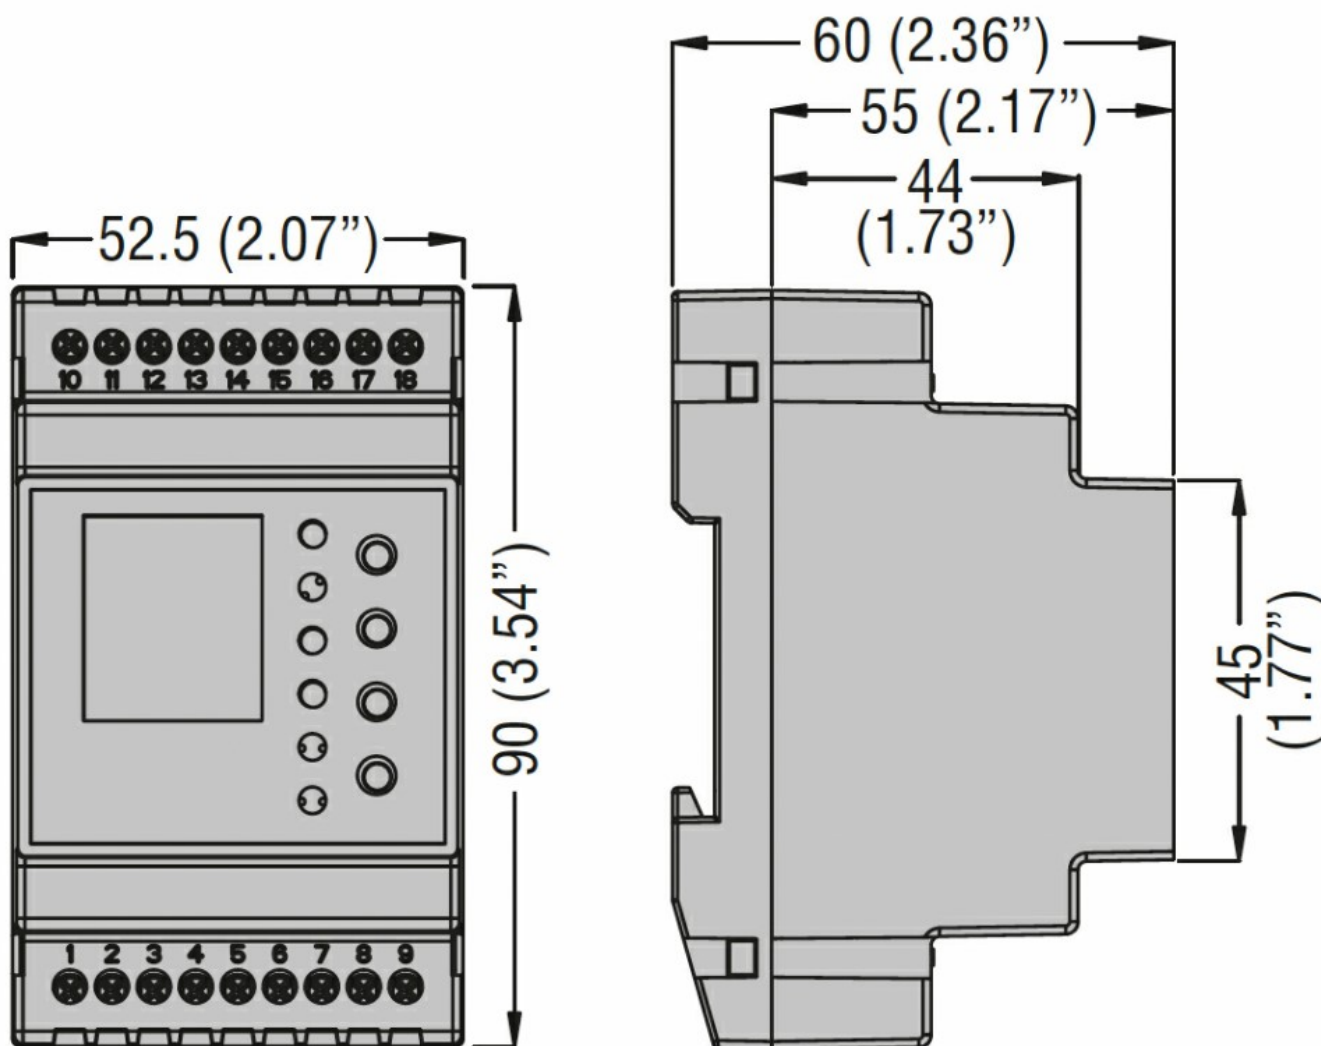

Wiring diagrams

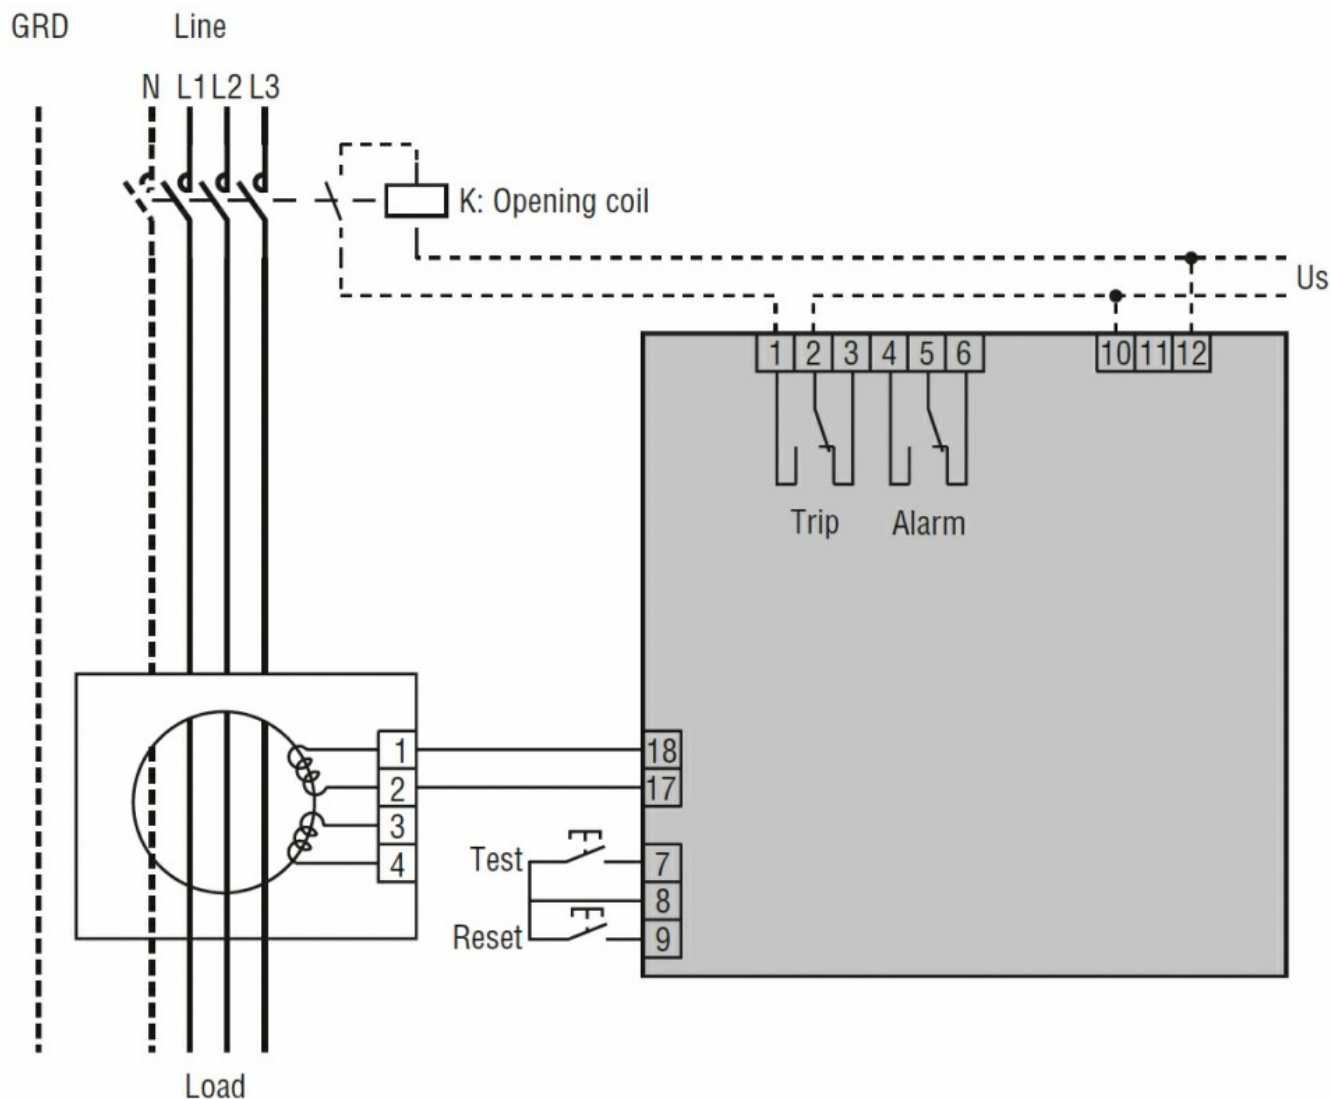

Certifications and compliance

Compliant with standards

EN 60947-2:2017-10 (Annex M)

EN 61

EN 61326-1:2013-01

EN 61326-2-1:2013-01

EN 61326-2-2:2013-01

EN 61326-2-3:2013-01

EN 61326-2-4:2013-01

EN 61326-2-5:2013-01

EN 61543/A11

EN 61543/A2:2006-02

ETIM classification

ETIM 8.0

EC001445 -
Residual current
monitoring relay