



Auxiliary supply

Rated auxil. supply voltage	24VAC
Operating auxil. supply voltage range	19.2...28.8VAC
Operating frequency range	Hz 45...66Hz

Voltage inputs

Rated voltage U_s			
	min	VAC	100
	Max	VAC	600
Measurement range		V	100...720
Frequency range		Hz	45...66

NTC probe input

Sensor type		NTC (LOVATO code NTC01)
Measuring range	°C	-40...+85
Maximum connection length	mt	3m

Digital inputs

Number of digital input	Nr.	8
Digital input type		Negative
Digital input current	mA	≤6
High digital input signal	V	≥4.9V (typical 3.8V)
Low digital input signal	V	≤1.25V (typical 2.3V)
Digital input signal delay	ms	≥50

Current inputs

Rated current (I_e)	A	/1A or /5A
-------------------------	---	------------

Relay outputs

Number of relay output	Nr.	7
Mechanical endurance		10^7
Electrical endurance		10^5

Static Outputs

Number of static output		1 (OUT10)
Static output type		NO
Operating voltage	V	10...30VDC
Maximum current	mA	50mA

RS485 serial interface

Interface type		Isolated RS485 serial interface
Baud rate	bps	1200...115200
Insulation voltage (RS485-Vbatt)		1kVDC

Connections

Type of terminal		Removable screw-type
Conductor cross section		
	AWG/Kcmil	

	min	AWG	24
	Max	AWG	12
IEC			
	min	mm ²	0.2
	Max	mm ²	2.5
Tightening torque for terminals			
	max	Nm	0.56
	max	lbin	5


Ambient conditions

Temperature			
Operating temperature			
	min	°C	-25
	max	°C	+70
Storage temperature			
	min	°C	-30
	max	°C	+80
Relative humidity		%	<80% (IEC/EN 60068-2-78)


Housing

Execution	Flush-mount
Material	Polycarbonate
Degree of protection	IP65 Frontal; IP20 on terminals
Dimensions (W x H x D)	mm 240 x 180 x 43.9
Weight	g 980

Dimensions

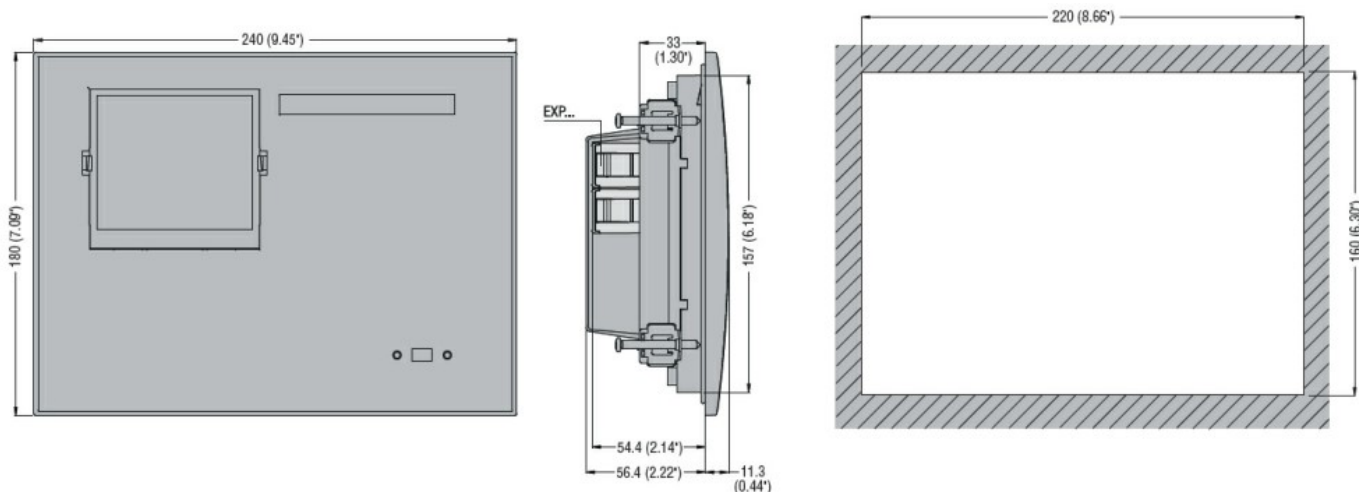

Wiring diagrams

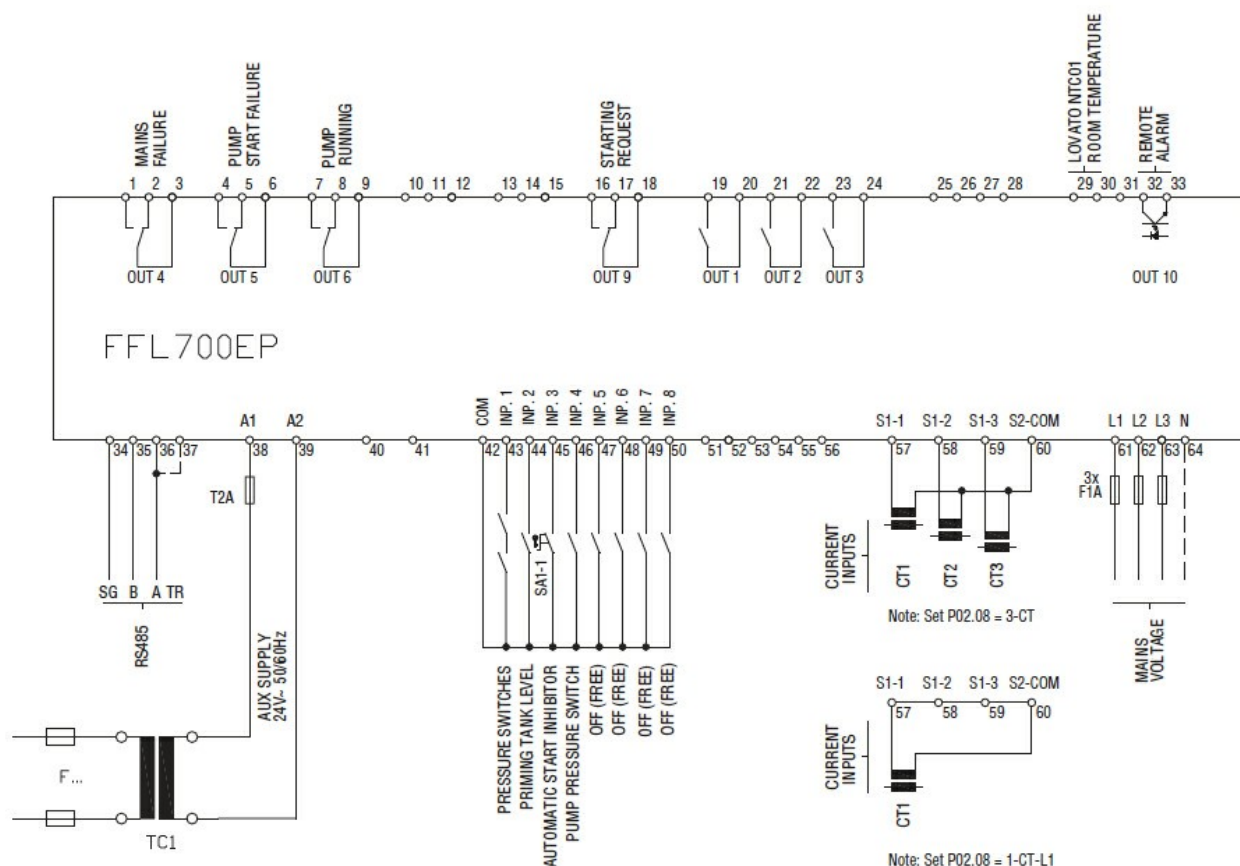

Certifications and compliance

Compliance

IEC/EN 61000-6-2
IEC/EN 61000-6-4
IEC/EN 61010-1
IEC/EN 61010-2-030
UNI EN 12845

Certificates

/

ETIM classification

ETIM 8.0

EC002685 -
Central fire alarm
control panel