


Modicon Edge I/O NTS

Analog Modules

User Guide

Original instructions

EIO0000005246.02
10/2025

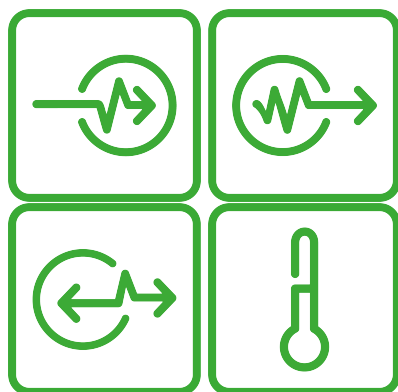

Legal Information

The information provided in this document contains general descriptions, technical characteristics and/or recommendations related to products/solutions.

This document is not intended as a substitute for a detailed study or operational and site-specific development or schematic plan. It is not to be used for determining suitability or reliability of the products/solutions for specific user applications. It is the duty of any such user to perform or have any professional expert of its choice (integrator, specifier or the like) perform the appropriate and comprehensive risk analysis, evaluation and testing of the products/solutions with respect to the relevant specific application or use thereof.

The Schneider Electric brand and any trademarks of Schneider Electric SE and its subsidiaries referred to in this document are the property of Schneider Electric SE or its subsidiaries. All other brands may be trademarks of their respective owner.

This document and its content are protected under applicable copyright laws and provided for informative use only. No part of this document may be reproduced or transmitted in any form or by any means (electronic, mechanical, photocopying, recording, or otherwise), for any purpose, without the prior written permission of Schneider Electric.

Schneider Electric does not grant any right or license for commercial use of the document or its content, except for a non-exclusive and personal license to consult it on an "as is" basis.

Schneider Electric reserves the right to make changes or updates with respect to or in the content of this document or the format thereof, at any time without notice.

To the extent permitted by applicable law, no responsibility or liability is assumed by Schneider Electric and its subsidiaries for any errors or omissions in the informational content of this document, as well as any non-intended use or misuse of the content thereof.

Table of Contents

Safety Information	7
Before You Begin	7
Start-up and Test	8
Operation and Adjustments	9
About the Document	10
General Overview	15
Analog Input Modules	18
NTSAMI0210/NTSAMI0210H Analog Input Module, 2 Isolated Inputs, Current, Voltage, 2-/3-/4 wire, Loop Power, Standard/Hardened	19
NTSAMI0210/NTSAMI0210H Presentation	19
Overview	19
Main Characteristics	19
Purchasing Information	20
Physical Description	22
Status LEDs	23
NTSAMI0210/NTSAMI0210H Characteristics	24
Overview	24
Dimensions	24
Weight	25
General Characteristics	26
Input Characteristics	27
NTSAMI0210/NTSAMI0210H Wiring	29
Overview	29
Wiring Rules	29
Wiring Diagrams	29
NTSAMI0210/NTSAMI0210H Parameters	33
Overview	33
Parameters Description	34
NTSAMI0400 Analog Input Module, 4 Inputs, Current, Voltage, 2- wire	38
NTSAMI0400 Presentation	38
Overview	38
Main Characteristics	38
Purchasing Information	39
Physical Description	40
Status LEDs	41
NTSAMI0400 Characteristics	42
Overview	42
Dimensions	42
Weight	42
General Characteristics	43
Input Characteristics	44
NTSAMI0400 Wiring	45
Overview	45
Wiring Rules	45
Wiring Diagram	45
NTSAMI0400 Parameters	46
Overview	46

Parameters Description	47
NTSAMI0420 Analog Input Module, 4 Differential Inputs, Current, Voltage, 2-wire	51
NTSAMI0420 Presentation	51
Overview	51
Main Characteristics	51
Purchasing Information	52
Physical Description	53
Status LEDs	54
NTSAMI0420 Characteristics	55
Overview	55
Dimensions	55
Weight	55
General Characteristics	56
Input Characteristics	57
NTSAMI0420 Wiring	58
Overview	58
Wiring Rules	58
Wiring Diagram	58
NTSAMI0420 Parameters	59
Overview	59
Parameters Description	60
NTSAMI0800 Analog Input Module, 8 Inputs, Current, Voltage, 2- wire	64
NTSAMI0800 Presentation	64
Overview	64
Main Characteristics	64
Purchasing Information	65
Physical Description	66
Status LEDs	67
NTSAMI0800 Characteristics	68
Overview	68
Dimensions	68
Weight	68
General Characteristics	69
Input Characteristics	70
NTSAMI0800 Wiring	71
Overview	71
Wiring Rules	71
Wiring Diagram	71
NTSAMI0800 Parameters	72
Overview	72
Parameters Description	73
NTSACI0802X/NTSACI0802XH Analog Input Module, 8 Inputs, Current, 1-/2-wire, Loop Power, Standard/Hardened	77
NTSACI0802X/NTSACI0802XH Presentation	77
Overview	77
Main Characteristics	77
Purchasing Information	78
Physical Description	79
Status LEDs	80

NTSACI0802X/NTSACI0802XH Characteristics	81
Overview	81
Dimensions	81
Weight.....	81
General Characteristics	82
Input Characteristics.....	83
NTSACI0802X/NTSACI0802XH Wiring	84
Overview	84
Wiring Rules	84
Wiring Diagrams	85
NTSACI0802X/NTSACI0802XH Parameters	88
Overview	88
Parameters Description	89
Temperature Input Modules	93
NTSART0603 Temperature Input Module, 6 Differential Inputs, RTD, Thermistor, 2-/3-wire	94
NTSART0603 Presentation	94
Overview	94
Main Characteristics.....	94
Purchasing Information.....	95
Physical Description	96
Status LEDs	97
NTSART0603 Characteristics	98
Overview	98
Dimensions	98
Weight.....	98
General Characteristics	99
Input Characteristics.....	100
NTSART0603 Wiring.....	102
Overview	102
Wiring Rules	102
Wiring Diagram	102
NTSART0603 Parameters.....	103
Overview	103
Parameters Description	104
Analog Output Modules	108
NTSAMO0210/NTSAMO0210H Analog Output Module, 2 Isolated Outputs, Current, Voltage, Standard/Hardened	109
NTSAMO0210/NTSAMO0210H Presentation	109
Overview	109
Main Characteristics.....	109
Purchasing Information.....	110
Physical Description	111
Status LEDs	112
NTSAMO0210/NTSAMO0210H Characteristics	113
Overview	113
Dimensions	113
Weight.....	113
General Characteristics	114
Output Characteristics	115
NTSAMO0210/NTSAMO0210H Wiring.....	116

Overview	116
Wiring Rules	116
Wiring Diagrams	116
NTSAM00210/NTSAM00210H Parameters	117
Overview	117
Parameters Description	118
NTSAM00400/NTSAM00400H Analog Output Module, 4 Outputs, Current, Voltage, Standard/Hardened	122
NTSAM00400/NTSAM00400H Presentation	122
Overview	122
Main Characteristics	122
Purchasing Information	123
Physical Description	124
Status LEDs	125
NTSAM00400/NTSAM00400H Characteristics	126
Overview	126
Dimensions	126
Weight	126
General Characteristics	127
Output Characteristics	128
NTSAM00400/NTSAM00400H Wiring	129
Overview	129
Wiring Rules	129
Wiring Diagram	129
NTSAM00400/NTSAM00400H Parameters	130
Overview	130
Parameters Description	131
Appendices	135
Parameters Description	136
General Parameters	136
RangeMode Parameters	138
Overflowcheck/Underflowcheck and ScalingRange Parameters	141
Glossary	149
Index	152

Safety Information

Important Information

Read these instructions carefully, and look at the equipment to become familiar with the device before trying to install, operate, service, or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a “Danger” or “Warning” safety label indicates that an electrical hazard exists which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

DANGER

DANGER indicates a hazardous situation which, if not avoided, **will result in** death or serious injury.

WARNING

WARNING indicates a hazardous situation which, if not avoided, **could result in** death or serious injury.

CAUTION

CAUTION indicates a hazardous situation which, if not avoided, **could result in** minor or moderate injury.

NOTICE

NOTICE is used to address practices not related to physical injury.

Please Note

Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction and operation of electrical equipment and its installation, and has received safety training to recognize and avoid the hazards involved.

Before You Begin

Do not use this product on machinery lacking effective point-of-operation guarding. Lack of effective point-of-operation guarding on a machine can result in serious injury to the operator of that machine.

⚠ WARNING**UNGUARDED EQUIPMENT**

- Do not use this software and related automation equipment on equipment which does not have point-of-operation protection.
- Do not reach into machinery during operation.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

This automation equipment and related software is used to control a variety of industrial processes. The type or model of automation equipment suitable for each application will vary depending on factors such as the control function required, degree of protection required, production methods, unusual conditions, government regulations, etc. In some applications, more than one processor may be required, as when backup redundancy is needed.

Only you, the user, machine builder or system integrator can be aware of all the conditions and factors present during setup, operation, and maintenance of the machine and, therefore, can determine the automation equipment and the related safeties and interlocks which can be properly used. When selecting automation and control equipment and related software for a particular application, you should refer to the applicable local and national standards and regulations. The National Safety Council's Accident Prevention Manual (nationally recognized in the United States of America) also provides much useful information.

In some applications, such as packaging machinery, additional operator protection such as point-of-operation guarding must be provided. This is necessary if the operator's hands and other parts of the body are free to enter the pinch points or other hazardous areas and serious injury can occur. Software products alone cannot protect an operator from injury. For this reason the software cannot be substituted for or take the place of point-of-operation protection.

Ensure that appropriate safeties and mechanical/electrical interlocks related to point-of-operation protection have been installed and are operational before placing the equipment into service. All interlocks and safeties related to point-of-operation protection must be coordinated with the related automation equipment and software programming.

NOTE: Coordination of safeties and mechanical/electrical interlocks for point-of-operation protection is outside the scope of the Function Block Library, System User Guide, or other implementation referenced in this documentation.

Start-up and Test

Before using electrical control and automation equipment for regular operation after installation, the system should be given a start-up test by qualified personnel to verify correct operation of the equipment. It is important that arrangements for such a check are made and that enough time is allowed to perform complete and satisfactory testing.

⚠ WARNING**EQUIPMENT OPERATION HAZARD**

- Verify that all installation and set up procedures have been completed.
- Before operational tests are performed, remove all blocks or other temporary holding means used for shipment from all component devices.
- Remove tools, meters, and debris from equipment.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Follow all start-up tests recommended in the equipment documentation. Store all equipment documentation for future references.

Software testing must be done in both simulated and real environments.

Verify that the completed system is free from all short circuits and temporary grounds that are not installed according to local regulations (according to the National Electrical Code in the U.S.A, for instance). If high-potential voltage testing is necessary, follow recommendations in equipment documentation to prevent accidental equipment damage.

Before energizing equipment:

- Remove tools, meters, and debris from equipment.
- Close the equipment enclosure door.
- Remove all temporary grounds from incoming power lines.
- Perform all start-up tests recommended by the manufacturer.

Operation and Adjustments

The following precautions are from the NEMA Standards Publication ICS 7.1-1995:

(In case of divergence or contradiction between any translation and the English original, the original text in the English language will prevail.)

- Regardless of the care exercised in the design and manufacture of equipment or in the selection and ratings of components, there are hazards that can be encountered if such equipment is improperly operated.
- It is sometimes possible to misadjust the equipment and thus produce unsatisfactory or unsafe operation. Always use the manufacturer's instructions as a guide for functional adjustments. Personnel who have access to these adjustments should be familiar with the equipment manufacturer's instructions and the machinery used with the electrical equipment.
- Only those operational adjustments required by the operator should be accessible to the operator. Access to other controls should be restricted to prevent unauthorized changes in operating characteristics.

About the Document

Document Scope

This guide describes the implementation of Modicon Edge I/O NTS analog modules. It provides the description, characteristics, wiring diagrams and configuration details for Modicon Edge I/O NTS analog modules.

Validity Note

This document has been updated for the release of Modicon Edge I/O NTS analog modules firmware V1.0.1.

The characteristics of the products described in this document are intended to match the characteristics that are available on www.se.com. As part of our corporate strategy for constant improvement, we may revise the content over time to enhance clarity and accuracy. If you see a difference between the characteristics in this document and the characteristics on www.se.com, consider www.se.com to contain the latest information.

Product Related Information

DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Disconnect all power from all equipment including connected devices prior to removing any covers or doors, or installing or removing any accessories, hardware, cables, or wires except under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the equipment.
- Use only the specified voltage when operating this equipment and any associated products.

Failure to follow these instructions will result in death or serious injury.

⚠ WARNING

LOSS OF CONTROL

- Perform a Failure Mode and Effects Analysis (FMEA), or equivalent risk analysis, of your application, and apply preventive and detective controls before implementation.
- Provide a fallback state for undesired control events or sequences.
- Provide separate or redundant control paths wherever required.
- Supply appropriate parameters, particularly for limits.
- Review the implications of transmission delays and take actions to mitigate them.
- Review the implications of communication link interruptions and take actions to mitigate them.
- Provide independent paths for control functions (for example, emergency stop, over-limit conditions, and error conditions) according to your risk assessment, and applicable codes and regulations.
- Apply local accident prevention and safety regulations and guidelines.¹
- Test each implementation of a system for proper operation before placing it into service.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

¹ For additional information, refer to NEMA ICS 1.1 (latest edition), *Safety Guidelines for the Application, Installation, and Maintenance of Solid State Control* and to NEMA ICS 7.1 (latest edition), *Safety Standards for Construction and Guide for Selection, Installation and Operation of Adjustable-Speed Drive Systems* or their equivalent governing your particular location.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

- Only use software approved by Schneider Electric for use with this equipment.
- Update your application program every time you change the physical hardware configuration.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

General Cybersecurity Information

In recent years, the growing number of networked machines and production plants has seen a corresponding increase in the potential for cyber threats, such as unauthorized access, data breaches, and operational disruptions. You must, therefore, consider all possible cybersecurity measures to help protect assets and systems against such threats.

To help keep your Schneider Electric products secure and protected, it is in your best interest to implement the cybersecurity best practices as described in the [Cybersecurity Best Practices](#) document.

Schneider Electric provides additional information and assistance:

- [Subscribe to the Schneider Electric security newsletter](#).
- Visit the [Cybersecurity Support Portal](#) web page to:
 - [Find Security Notifications](#).
 - [Report vulnerabilities and incidents](#).
- Visit the [Schneider Electric Cybersecurity and Data Protection Posture](#) web page to:
 - [Access the cybersecurity posture](#).
 - [Learn more about cybersecurity in the cybersecurity academy](#).
 - [Explore the cybersecurity services from Schneider Electric](#).

Environmental Data

For product compliance and environmental information, refer to the [Schneider Electric Environmental Data Program](#).

Related Documents

Title of documentation	Reference number
Modicon Edge I/O - System Planning and Installation Guide	EIO0000004786 (ENG)
Modicon Edge I/O - Configurator and Web Interface - User Guide	EIO0000004810 (ENG)
Modicon Edge I/O - Software Integration and Compatibility - User Guide	EIO0000004818 (ENG)
Modicon Edge I/O - Diagnostic Data - User Guide	EIO0000004826 (ENG)
Modicon Edge I/O NTS - Network Interface Modules - User Guide	EIO0000004794 (ENG)
Modicon Edge I/O NTS - Discrete Modules - User Guide	EIO0000005238 (ENG)
Modicon Edge I/O NTS - Counting Modules - User Guide	EIO0000005262 (ENG)
Modicon Edge I/O NTS - Field Device Master Modules - User Guide	EIO0000005270 (ENG)

To find documents online, visit the [Schneider Electric download center](#) (www.se.com/ww/en/download/).

Information on Non-Inclusive or Insensitive Terminology

As a responsible, inclusive company, Schneider Electric is constantly updating its communications and products that contain non-inclusive or insensitive terminology. However, despite these efforts, our content may still contain terms that are deemed inappropriate by some customers.

Terminology Derived from Standards

The technical terms, terminology, symbols and the corresponding descriptions in the information contained herein, or that appear in or on the products themselves, are generally derived from the terms or definitions of international standards.

In the area of functional safety systems, drives and general automation, this may include, but is not limited to, terms such as *safety*, *safety function*, *safe state*, *fault*, *fault reset*, *malfunction*, *failure*, *error*, *error message*, *dangerous*, etc.

Among others, these standards include:

Standard	Description
IEC 61131-2:2007	Programmable controllers, part 2: Equipment requirements and tests.
ISO 13849-1:2023	Safety of machinery: Safety related parts of control systems. General principles for design.
EN 61496-1:2020	Safety of machinery: Electro-sensitive protective equipment. Part 1: General requirements and tests.
ISO 12100:2010	Safety of machinery - General principles for design - Risk assessment and risk reduction
EN 60204-1:2006	Safety of machinery - Electrical equipment of machines - Part 1: General requirements
ISO 14119:2013	Safety of machinery - Interlocking devices associated with guards - Principles for design and selection
ISO 13850:2015	Safety of machinery - Emergency stop - Principles for design
IEC 62061:2021	Safety of machinery - Functional safety of safety-related electrical, electronic, and electronic programmable control systems
IEC 61508-1:2010	Functional safety of electrical/electronic/programmable electronic safety-related systems: General requirements.
IEC 61508-2:2010	Functional safety of electrical/electronic/programmable electronic safety-related systems: Requirements for electrical/electronic/programmable electronic safety-related systems.
IEC 61508-3:2010	Functional safety of electrical/electronic/programmable electronic safety-related systems: Software requirements.
IEC 61784-3:2021	Industrial communication networks - Profiles - Part 3: Functional safety fieldbuses - General rules and profile definitions.
2006/42/EC	Machinery Directive
2014/30/EU	Electromagnetic Compatibility Directive
2014/35/EU	Low Voltage Directive

In addition, terms used in the present document may tangentially be used as they are derived from other standards such as:

Standard	Description
IEC 60034 series	Rotating electrical machines
IEC 61800 series	Adjustable speed electrical power drive systems
IEC 61158 series	Digital data communications for measurement and control – Fieldbus for use in industrial control systems

Finally, the term *zone of operation* may be used in conjunction with the description of specific hazards, and is defined as it is for a *hazard zone* or *danger zone* in the *Machinery Directive (2006/42/EC)* and *ISO 12100:2010*.

NOTE: The aforementioned standards may or may not apply to the specific products cited in the present documentation. For more information concerning the individual standards applicable to the products described herein, see the characteristics tables for those product references.

General Overview

The range of Modicon Edge I/O NTS analog modules includes:

- Input modules, page 16
- Temperature Input modules, page 17
- Output modules, page 17

NOTE: References with an H are hardened devices, suitable for harsh environments.

NOTE: The terminal blocks are purchased separately. The compatible terminal block reference is printed on the front of the module.

Analog Input Modules

The following table shows the analog input modules, with the corresponding description and terminal type:

Reference	Number of Channels	Channel Type	Accuracy at 25 °C (77 °F)	Mode	Terminal Type / Pitch
NTSAMI0210, page 19/ NTSAMI0210H, page 19	2	Isolated inputs with loop power	0.05 %	± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc ± 20 mA 0...20 mA 4...20 mA	Removable screw/spring terminal block / 5 mm
NTSAMI0400, page 38	4	Single-ended inputs	0.3 %	± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc ± 20 mA 0...20 mA 4...20 mA	Removable screw/spring terminal block / 5 mm
NTSAMI0420, page 51	4	Differential inputs	0.3 %	± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc ± 20 mA 0...20 mA 4...20 mA	Removable screw/spring terminal block / 5 mm
NTSAMI0800, page 64	8	Single-ended inputs	0.3 %	± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc ± 20 mA 0...20 mA 4...20 mA	Removable screw/spring terminal block / 3.81 mm
NTSACI0802X, page 77/ NTSACI0802XH, page 77	8	Single-ended inputs with loop power	0.1 %	± 20 mA 0...20 mA 4...20 mA	Removable screw/spring terminal block / 5 mm

Temperature Input Modules

The following table shows the temperature input modules, with the corresponding description and terminal type:

Reference	Number of Channels	Channel Type	Accuracy at 25 °C (77 °F)	Mode	Terminal Type / Pitch
NTSART0603, page 94	6	Differential inputs	0.05 %	Resistance	Removable screw/spring terminal block / 3.81 mm
			Refer to Input Characteristics, page 100	RTD Thermistor	

Analog Output Modules

The following table shows the analog output modules, with the corresponding description and terminal type:

Reference	Number of Channels	Channel Type	Accuracy at 25 °C (77 °F)	Mode	Terminal Type / Pitch
NTSAMO0210, page 109/ NTSAMO0210H, page 109	2	Isolated outputs	0.1 %	± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc ± 20 mA 0...20 mA 4...20 mA	Removable screw/spring terminal block / 5 mm
NTSAMO0400, page 122/ NTSAMO0400H, page 122	4	Outputs	0.1 %	± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc 0...20 mA 4...20 mA	Removable screw/spring terminal block / 5 mm

Analog Input Modules

What's in This Part

NTSAMI0210/NTSAMI0210H Analog Input Module, 2 Isolated Inputs, Current, Voltage, 2-/3-/4 wire, Loop Power, Standard/Hardened 19

NTSAMI0400 Analog Input Module, 4 Inputs, Current, Voltage, 2-wire..... 38

NTSAMI0420 Analog Input Module, 4 Differential Inputs, Current, Voltage, 2-wire 51

NTSAMI0800 Analog Input Module, 8 Inputs, Current, Voltage, 2-wire..... 64

NTSACI0802X/NTSACI0802XH Analog Input Module, 8 Inputs, Current, 1-/2-wire, Loop Power, Standard/Hardened 77

NTSAMI0210/NTSAMI0210H Analog Input Module, 2 Isolated Inputs, Current, Voltage, 2-/3-/4 wire, Loop Power, Standard/Hardened

What’s in This Chapter

NTSAMI0210/NTSAMI0210H Presentation 19

NTSAMI0210/NTSAMI0210H Characteristics 24

NTSAMI0210/NTSAMI0210H Wiring 29

NTSAMI0210/NTSAMI0210H Parameters..... 33

NTSAMI0210/NTSAMI0210H Presentation

Overview

This section provides a presentation of the NTSAMI0210/NTSAMI0210H input modules.

Main Characteristics


The following table describes the main characteristics of the NTSAMI0210/NTSAMI0210H input modules:

Main Characteristics	Value
Product or component type	Analog current and voltage input module
Number of channels	2
Channel property	Channel isolated
Channel signal	Current or voltage
Operating mode	Synchronous, isochronous and asynchronous

Purchasing Information

The following figures show the elements of the Modicon Edge I/O NTS NTSAMI0210/NTSAMI0210H input modules:


NTSAMI0210

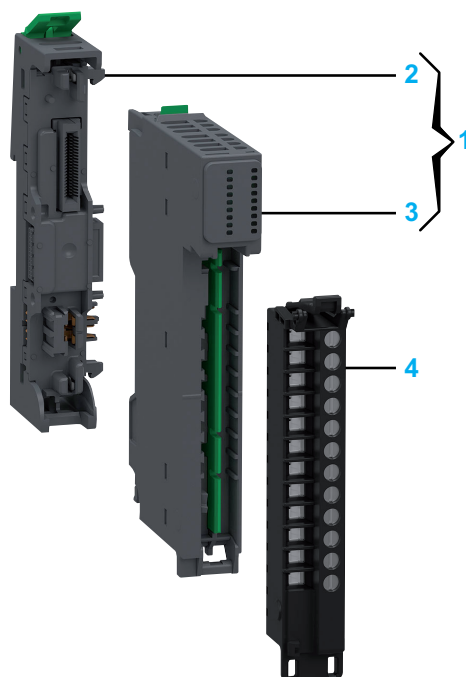

Number	Reference	Description
1	NTSAMI0210K	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXBA0100H	Spare Base, 1 Slot, for Input/Output Common or Expert Module, Hardened
3	NTSAMI0210	Analog Input Module, 2 Isolated Inputs, Current, Voltage, 2-/3-/4 wire, Loop Power
4	NTSXTB12200H NTSXTB12201H NTSXTB12000H NTSXTB12001H	Spring Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Spring Terminal Block, 12 Points, 5 mm Pitch, With Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, With cover, use on Low Height Module, Hardened NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

NTSAMI0210H

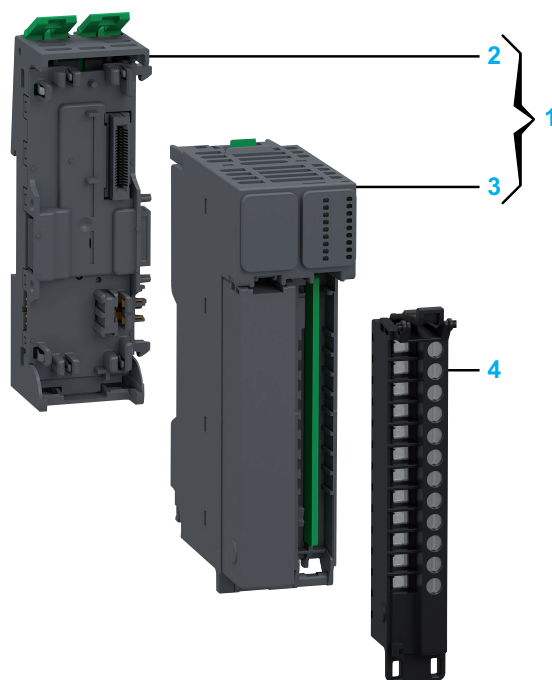


Number	Reference	Description
1	NTSAMI0210HK	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXBA0200H	Spare Base, 2 Slots, for Input/Output Common/Expert/Safety Module, Hardened
3	NTSAMI0210H	Analog Input Module, 2 Isolated Inputs, Current, Voltage, 2-/3-/4 wire, Loop Power, Hardened
4	NTSXTB12200H NTSXTB12201H NTSXTB12000H NTSXTB12001H	Spring Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Spring Terminal Block, 12 Points, 5 mm Pitch, With Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, With cover, use on Low Height Module, Hardened NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

Physical Description

NTSAMI0210


The following figure presents the elements of the module:

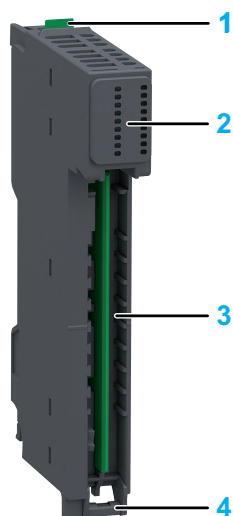

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

NTSAMI0210H


The following figure presents the elements of the module:

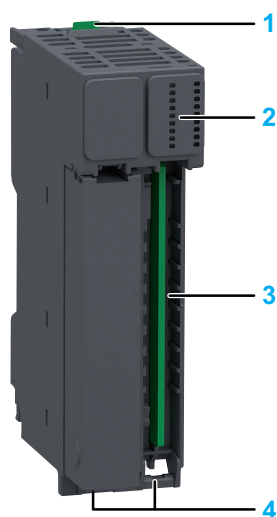

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

Status LEDs


The following figure presents the NTSAMI0210H status LEDs:



The following table describes the status of LEDs:

R (Green)	E (Red)	Channel (Green)	Description
Initialization and non-operational states			
OFF	OFF	OFF	Indicates that the module is not energized.
OFF	Fast Flash	-	Indicates that the module has detected a system error.
Regular Flash	OFF	-	Indicates that the firmware is being updated.
Regular Flash	ON	-	Indicates that a module mismatch is detected.
Single Flash	OFF	-	Indicates that the module is energized and not configured.
Operational state			
ON	OFF	-	Indicates that the module is energized, configured and operational.
ON	-	ON	Indicates that the channel is activated.
ON	-	OFF	Indicates that the channel is deactivated.
ON	Single Flash	-	Indicates an advisory detection.
ON	Single Flash	Single Flash	Indicates: - Lower tolerance advisory detection. - Upper tolerance advisory detection.
ON	Regular Flash	OFF	Indicates that an error is detected in the 24 Vdc field power.
ON	Regular Flash	Regular Flash	Indicates: - Broken wire detection. 24 Vdc loop power error detection. - Overflow/underflow error detection.
ON	Regular Flash	OFF	Indicates an internal error detection.

The following graphic shows the system status of LEDs during module operation:

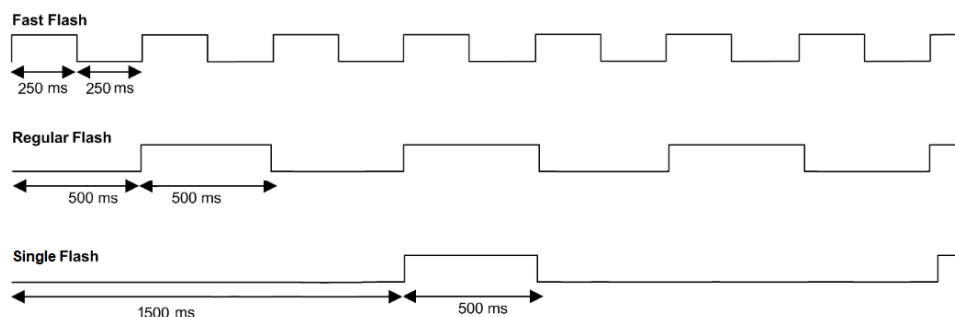

NTSAMI0210/NTSAMI0210H Characteristics

Overview

This section provides a general description of the characteristics of the module.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified in the environmental and electrical characteristics tables.


Failure to follow these instructions can result in death, serious injury, or equipment damage.

For more information on environmental characteristics, refer to Modicon Edge I/O - System Planning and Installation Guide.

Dimensions

NTSAMI0210


The following figure presents the external dimensions of the assembled module:

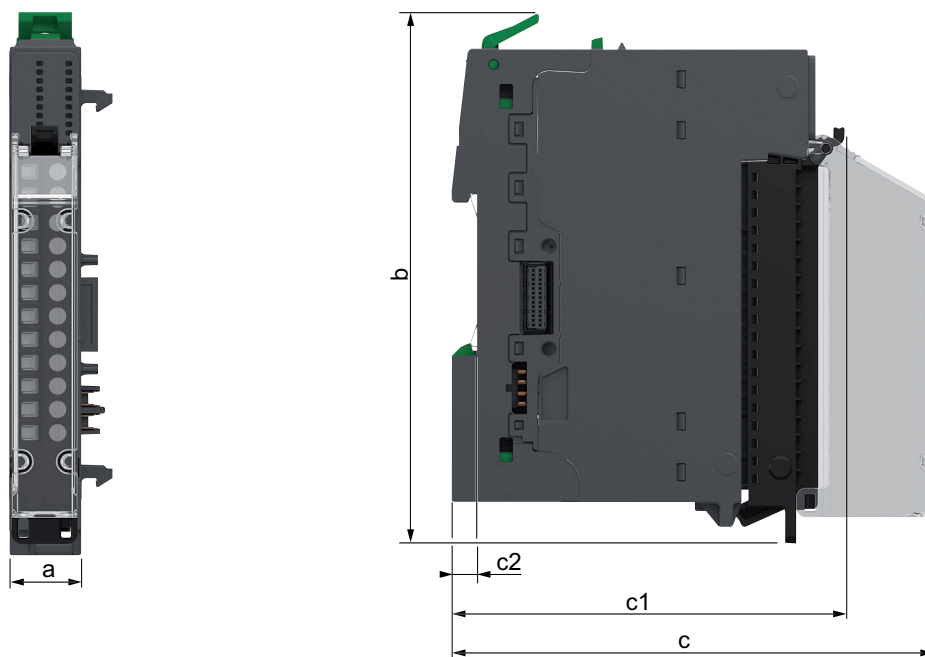

- a: 15 mm (0.59 in)
- b: 116.6 mm (4.57 in)
- c: 107.5 mm (4.21 in)
- c1: 88.2 mm (3.46 in)
- c2: 5.6 mm (0.2 in)

NTSAMI0210H

The following figure presents the external dimensions of the assembled module:

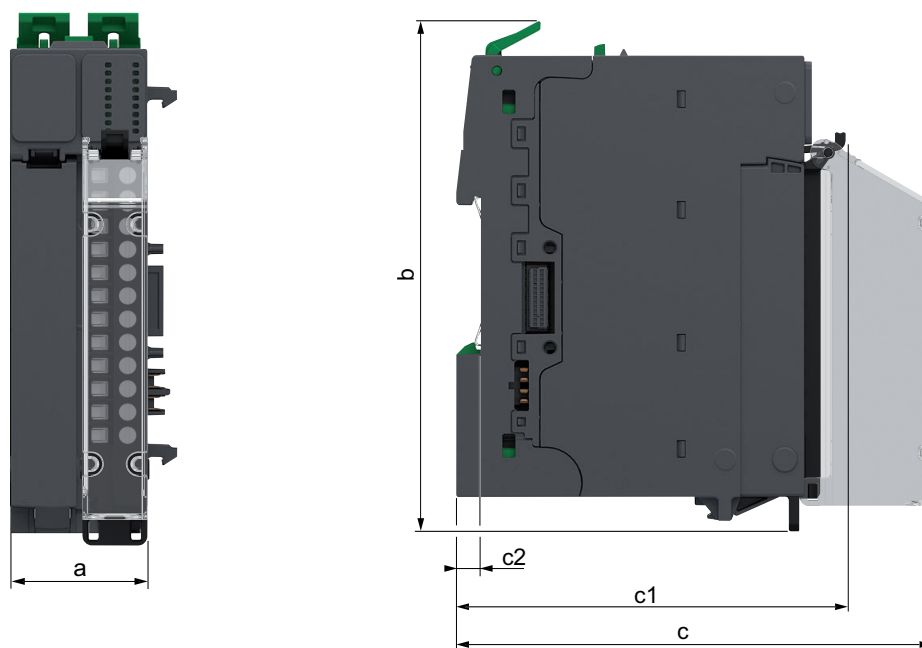

a: 30 mm (1.18 in)
b: 116.6 mm (4.57 in)
c: 107.5 mm (4.21 in)
c1: 88.2 mm (3.46 in)
c2: 5.6 mm (0.2 in)

Weight

- NTSAMI0210: 48 g (1.69 oz)
- NTSAMI0210K: 73 g (2.58 oz)
- NTSAMI0210H: 79 g (2.79 oz)
- NTSAMI0210HK: 125 g (4.40 oz)

General Characteristics

The following table shows the general characteristics of the NTSAMI0210/
NTSAMI0210H input modules:

Characteristics		Value
Rated supplied voltage		24 Vdc
Power supplied voltage range		20.4...28.8 Vdc
Isolation	Between channels	530 Vac
	Between channels and bus	1,500 Vac
	Between channels and field power	1,000 Vac for 2-wire sensor supplied by loop power. No isolation for 3-wire or 4-wire sensor supplied by sensor power.
	Between field power and bus	1,500 Vac
Protection and detection		Overcurrent and short circuit on loop/sensor power by channel.
Power dissipation		2.28 W

Input Characteristics

The following table describes the input characteristics of the NTSAMI0210/NTSAMI0210H input modules:

Characteristics		Value	
		Voltage input	Current input
Input range		± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc	± 20 mA 0...20 mA 4...20 mA
Input impedance		10 M Ω minimum	250 Ω + 10 Ω internal current protector
Input response time	Per enabled channel	300 μ s	
	Per module	Internal I/O bus exchange cycle time ⁽¹⁾ 1 ms minimum	
Input type		Differential, single-ended input	
Conversion mode		Sigma-Delta	
Maximum accuracy at ambient 25 °C (77 °F) / maximum allowed temperature		± 0.05 % / ± 0.1 % of full scale	
Temperature drift		± 0.002 %/°C of full scale	
Repeatability after stabilization time		± 0.005 % of full scale	± 0.007 % of full scale
Nonlinearity		± 0.01 % of full scale	
Monotonicity		Yes	
Resolution		16 bits, or 15 bits plus sign bit	
Input value of LSB		0.31 mV (range ± 10 Vdc) 0.31 mV (range 0...10 Vdc) 0.16 mV (range ± 5 Vdc) 0.16 mV (range 0...5 Vdc) 0.13 mV (range 1...5 Vdc)	0.61 μ A (range ± 20 mA) 0.61 μ A (range 0...20 mA) 0.49 μ A (range 4...20 mA)
Data type in application program		Scalable from -32,768 to 32,767	
Input data out of range detection		Yes	
Resistance to electromagnetic interference	Crosstalk between channels	80 dB minimum	
	Common mode rejection	90 dB	
Cable		Shielded, 200 m (656 ft) maximum	Shielded, 1,000 m (3,281 ft) maximum
Input filter		Software run-time configurable filter. Refer to Measurement Filter , page 137.	
HART compliance		Tolerant	
HART communication		No	
NAMUR NE43 compliance	Applicable nominal range	—	4...20 mA
	Convertible range	—	0...22 mA
	Safety margin IFM,Low / IFM,High	—	0.1 mA / 0.2 mA
	Failure signal detection time	—	4 s
Supply voltage		24 Vdc	

Analog Modules

Characteristics		Value	
		Voltage input	Current input
Sensor power	Output voltage	24 Vdc nominal from field power bus using the power supply module	
	Output current	100 mA per channel	
	Protection	Overcurrent and short circuit protection, channel based	
Loop power	Output voltage	24 Vdc nominal from internal isolated power	
	Output current	25 mA maximum per channel	
	Protection	Overcurrent and short circuit protection, channel based	
Maximum continuous allowed overload (no damage)		30 Vdc	30 Vdc / 50 mA
(1) For more information, refer to Configurable Parameters in Modicon Edge I/O NTS - Network Interface Modules - User Guide.			

NTSAMI0210/NTSAMI0210H Wiring

Overview

This section provides the wiring diagrams for the NTSAMI0210/NTSAMI0210H input modules.

Wiring Rules

For more information on the wiring, refer to Modicon Edge I/O - System Planning and Installation Guide.

Wiring Diagrams

Loop power supply is used with 2-wire 4...20 mA current sensor and provides a maximum current of 25 mA.

Sensor power supply is used with 3-wire or 4-wire current or voltage sensor, and provides a maximum current of 100 mA per channel.

The 3-wire sensor or 4-wire sensor may be malfunctioning due to the loop power limited load capacity of 25 mA per channel, whereas the sensor may require more than 25 mA.

The isolation between the analog module section and the field sensor power is not effective if a 3-wire sensor or a 4-wire sensor with a non-isolated output is used.

The isolation between channels is not effective if two 3-wire or 4-wire sensors with non-isolated outputs share the same power supply (either 24 Vdc from the analog module or an external power supply connected).

Further, as the sensor power could be misused as loop power, the input value may be abnormal due to a broken current loop. Additionally, the isolation between channels is not effective if the same miswiring is applied to the two channels.

NOTICE

INOPERABLE EQUIPMENT


Do not connect the 24 Vdc output sensor power supply with the 24 Vdc loop power supply of the module.

Failure to follow these instructions can result in equipment damage.


You may choose to use an external power supply to provide sensor power or loop power in case a larger current is required for the sensor.

Current and Voltage Measurement 2-Wire Diagram

The following figures illustrate the connection between the inputs and the sensors:

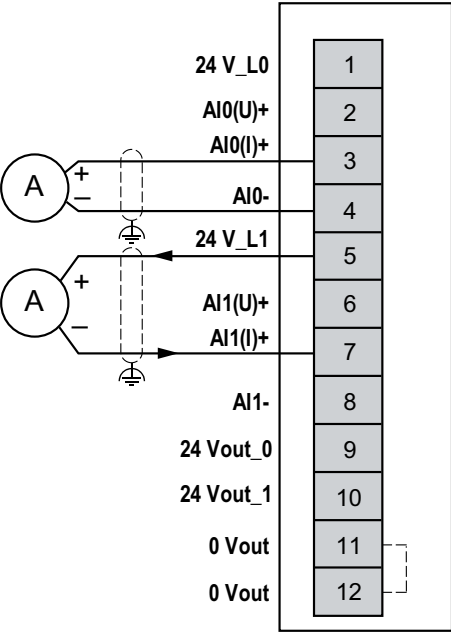


24 V_L•: Loop power
24 Vout_•: Sensor power
A: Current
(U): Voltage
(I): Current

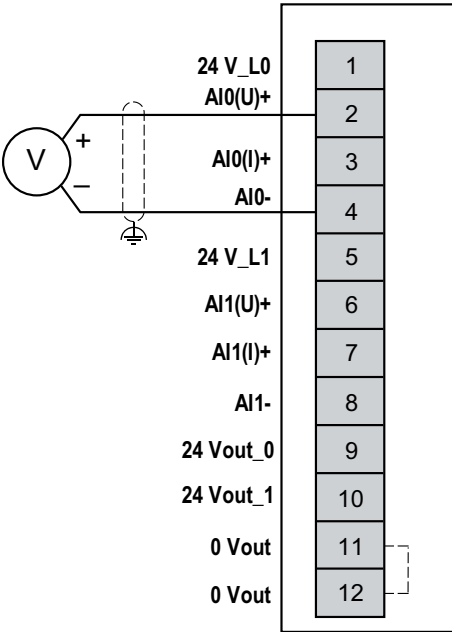

24 V_L•: Loop power
24 Vout_•: Sensor power
V: Voltage
(U): Voltage
(I): Current

Current and Voltage Measurement 3-Wire Diagram

The following figure illustrates the connection between the inputs and the sensors:

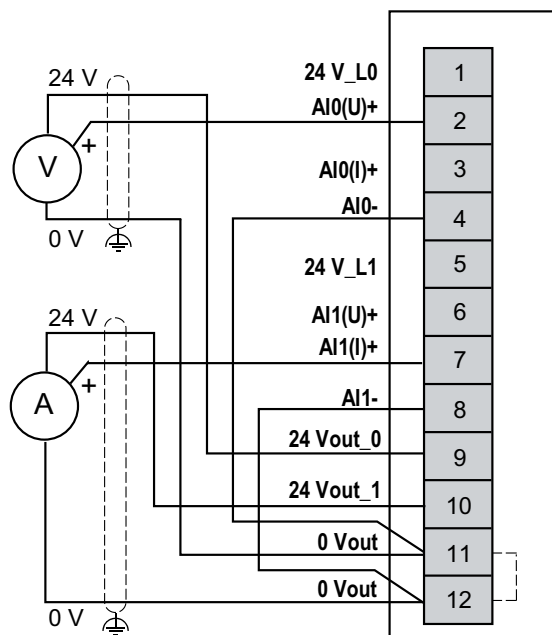

24 V_L•: Loop power

24 Vout_•: Sensor power

V: Voltage

A: Current

(U): Voltage

(I): Current

NOTE: For 3-wire sensors, connect externally **AI-** to **0 Vout**.

NTSAMI0210/NTSAMI0210H Parameters

Overview

This section provides the parameters of the NTSAMI0210/NTSAMI0210H modules.

Parameters are the set of values, specific to a module, that can be edited with the programming software during edition mode.

Software configuration is accomplished with one of the following options:

- The Edge I/O configuration software (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).
- The EcoStruxure Automation Expert software (refer to the EcoStruxure Automation Expert online help).
- The EcoStruxure Automation Expert - Motion software (refer to the EcoStruxure Automation Expert - Motion online help).
- The embedded Web interface (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).

If you have physically wired the analog channel for a voltage signal and you configure the channel for a current signal, you may damage the analog circuit.

NOTICE
INOPERABLE EQUIPMENT Verify that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel. Failure to follow these instructions can result in equipment damage.

Parameters Description

Configurable Parameters

The following table presents the configurable parameters for the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Device Mode <i>DeviceMode</i>	0: Normal * 1: Optional 2: Virtual reserved	ENUM	Allows you to select the device mode: Normal: The module is part of the software configuration and is physically connected in the cluster. Optional: The module is part of the software configuration. A dummy module or the configured module must be physically installed in the cluster. Whether either module is present does not cause a configuration error to be detected. Virtual reserved: The module is part of the software configuration. A dummy module must be physically installed in the cluster. If the virtual module is physically installed in the cluster, a configuration error is detected.

* Parameter default value

The following table presents the configurable parameters for the channels of the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Channel Enabled <i>ChannelEnable</i>	FALSE TRUE *	BOOL	Determines whether a channel is activated or deactivated.
Range Mode <i>RangeMode</i>	+/-10 V * 0..10 V +/-5 V 0..5 V 1..5 V +/-20 mA 0..20 mA 4..20 mA	ENUM	Defines the range mode for the input channel. For more information on RangeMode parameter, refer to RangeMode Parameters , page 138.
Range Maximum <i>RangeMax</i>	-32767...32767	INT16	Sets the maximum value of the nominal range. The values are computed according to the selected RangeMode .
Range Minimum <i>RangeMin</i>	-32768...32766	INT16	Sets the minimum value of the nominal range. The values are computed according to the selected RangeMode .
HART Tolerance Enabled <i>HartToleranceEnable</i>	FALSE * TRUE	BOOL	Enables the slew rate filter to filter out HART signals on the analog current input. HartToleranceEnable parameter can be changed to TRUE when the RangeMode is set to 4..20mA . For more information on HartToleranceEnabled parameter, refer to HartToleranceEnable , page 136.
NE43 Enabled <i>NE43Enable</i>	FALSE * TRUE	BOOL	Enables or disables NE43 compliance. NE43 compliance can be enabled when the RangeMode is set to 4..20mA . When NE43 Enabled is set to TRUE , the threshold values (Underflow Threshold/Overflow Threshold) are not configurable, the fixed threshold values are 3.6 mA / 21 mA.
Overflow Checked <i>OverflowCheck</i>	FALSE TRUE *	BOOL	Enables or disables overflow detection. An error is detected if the measurement is greater than Overflow Threshold . For more information on OverflowChecked parameter, refer to Overflowcheck/Underflowcheck , page 141.

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Overflow Threshold <i>OverMax</i>	-32767...32767	INT16	Sets the overflow threshold value. The values are computed according to the selected RangeMax value.
Underflow Checked <i>UnderflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables underflow detection. An error is detected if the measurement is lower than Underflow Threshold . For more information on UnderflowChecked parameter, refer to Overflowcheck/Underflowcheck , page 141.
Underflow Threshold <i>OverMin</i>	-32768...32766	INT16	Sets the underflow threshold value. The values are computed according to the selected RangeMin value.
Alignment Offset <i>AlignmentOffset⁽¹⁾</i>	-1500...1500	INT16	Compensates for a permanent offset observed with a given sensor, around a specific operating point. This operation compensates for an offset linked to the process. Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment. For more information on AlignmentOffset parameter, refer to Alignment Offset , page 138.
Filter <i>Filter⁽¹⁾</i>	No filtering: 0* Low filtering: 1 2 Medium filtering: 3 4 High filtering: 5 6	ENUM	Defines the type of filtering for the input channel selected for the analog modules. For more information on Filter parameter, refer to Measurement Filter , page 137.
* Parameter default value ⁽¹⁾ Online modification is allowed.			

Implicit Data

The following table presents the input implicit data for the module:

<i>Parameter Name</i>	<i>Value(s)</i>	<i>Data type</i> <i>Size in bytes</i>	<i>Description</i>
GCS	0...255	BYTE 1	Group Cyclic Status Bit 0: Data quality Bit 1: General module status Bit 2: I/O status Bit 3: N/A Bit 4: N/A Bit 5: Advisory status Bit 6: N/A Bit 7: Data freshness NOTE: For more information, refer to Modicon Edge I/O - Diagnostic Data - User Guide.
ChannelHealth0_7 ⁽¹⁾	0...255	BYTE 1	Bit 0...7 = Status of channel 0...7 - Bit = FALSE: Channel is invalid or not present. - Bit = TRUE: Channel is valid or disabled.
⁽¹⁾ This parameter is not part of the implicit data if the optimized I/O profile is selected.			

The following table presents the input implicit data for the channels of the module:

<i>Parameter Name</i>	<i>Value(s)</i>	<i>Data type</i> <i>Size in bytes</i>	<i>Description</i>
IValue	-32,768... 32,767	INT16 2	Value of the input channel.

Explicit Data

The following table presents the explicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
<i>ChannelFault1</i>	0...255	BYTE 1	Indicates module channel error catalog. Bit 0: Underflow error detected Bit 1: Overflow error detected Bit 2: Broken wire error detected Bit 3: N/A Bit 4: Hardware error detected Bit 5: Calibration error detected Bit 6: Loop power supply error detected Bit 7: N/A
<i>ChannelFault2</i>	0...255	BYTE 1	Bit 7: Power supply error detected NOTE: Bits 0 to 6 are reserved.
<i>MeasureStatus1</i>	0...255	BYTE 1	Bit 0: Lower tolerance alert Bit 1: Upper tolerance alert Bit 2: Non-zero alignment offset configured Bit 3: Channel enabled configured NOTE: Bits 4 to 7 are reserved.
<i>MeasureStatus2</i>	0...255	BYTE 1	Bits 0 to 7 are reserved.

NTSAMI0400 Analog Input Module, 4 Inputs, Current, Voltage, 2-wire

What's in This Chapter

NTSAMI0400 Presentation38

NTSAMI0400 Characteristics42

NTSAMI0400 Wiring45

NTSAMI0400 Parameters46

NTSAMI0400 Presentation

Overview

This section provides a presentation of the NTSAMI0400 input module.


Main Characteristics

The following table describes the main characteristics of the NTSAMI0400 input module:

Main Characteristics	Value
Product or component type	Analog current and voltage input module
Number of channels	4
Channel property	Single-ended
Channel signal	Current or voltage
Operating mode	Isochronous and asynchronous

Purchasing Information

The following figure shows the elements of the Modicon Edge I/O NTS NTSAMI0400 input module:

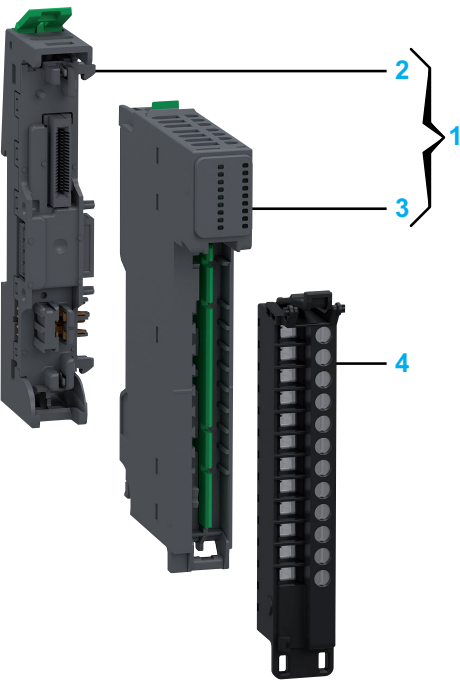


Number	Reference	Description
1	NTSAMI0400K	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXBA0100H	Spare Base, 1 Slot, for Input/Output Common or Expert Module, Hardened
3	NTSAMI0400	Analog Input Module, 4 Inputs, Current, Voltage, 2-wire
4	NTSXTB12200H NTSXTB12201H NTSXTB12000H NTSXTB12001H	Spring Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Spring Terminal Block, 12 Points, 5 mm Pitch, With Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, With cover, use on Low Height Module, Hardened NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

Physical Description


The following figure presents the elements of the module:

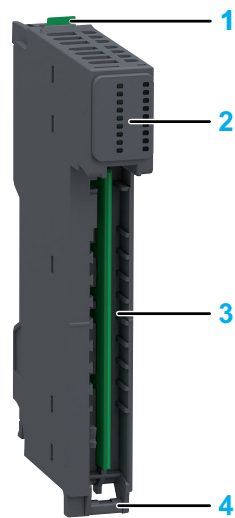

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

Status LEDs


The following figure presents the NTSAMI0400 status LEDs:



The following table describes the status of LEDs:

R (Green)	E (Red)	Channel (Green)	Description
Initialization and non-operational states			
OFF	OFF	OFF	Indicates that the module is not energized.
OFF	Fast Flash	-	Indicates that the module has detected a system error.
Regular Flash	OFF	-	Indicates that the firmware is being updated.
Regular Flash	ON	-	Indicates that a module mismatch is detected.
Single Flash	OFF	-	Indicates that the module is energized and not configured.
Operational state			
ON	OFF	-	Indicates that the module is energized, configured and operational.
ON	-	ON	Indicates that the channel is activated.
ON	-	OFF	Indicates that the channel is deactivated.
ON	Single Flash	-	Indicates an advisory detection.
ON	Single Flash	Single Flash	Indicates: - Lower tolerance advisory detection. - Upper tolerance advisory detection.
ON	Regular Flash	OFF	Indicates that an error is detected in the 24 Vdc field power.
ON	Regular Flash	Regular Flash	Indicates: - Broken wire detection. - Overflow/underflow error detection.
ON	Regular Flash	OFF	Indicates an internal error detection.

The following graphic shows the system status of LEDs during module operation:

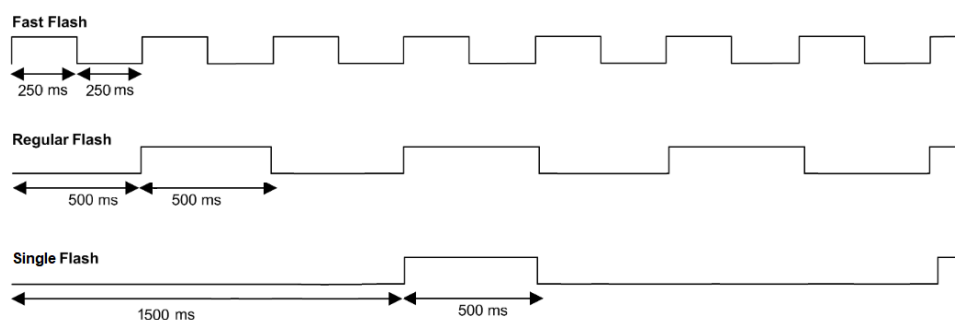

NTSAMI0400 Characteristics

Overview

This section provides a general description of the characteristics of the module.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION


Do not exceed any of the rated values specified in the environmental and electrical characteristics tables.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

For more information on environmental characteristics, refer to Modicon Edge I/O - System Planning and Installation Guide.

Dimensions

The following figure presents the external dimensions of the assembled module:

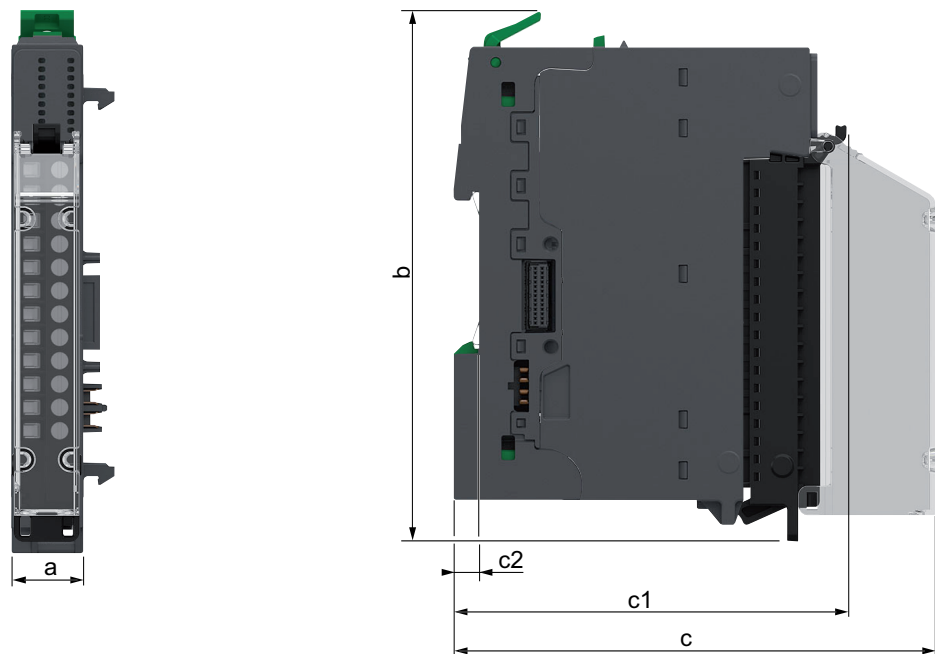

- a:** 15 mm (0.59 in)
- b:** 116.6 mm (4.57 in)
- c:** 107.5 mm (4.21 in)
- c1:** 88.2 mm (3.46 in)
- c2:** 5.6 mm (0.2 in)

Weight

- NTSAMI0400: 48 g (1.69 oz)
- NTSAMI0400K: 73 g (2.58 oz)

General Characteristics

The following table shows the general characteristics of the NTSAMI0400 input module:

Characteristics		Value
Rated supplied voltage		24 Vdc
Power supplied voltage range		20.4...28.8 Vdc
Isolation	Between channels	No
	Between channels and bus	1,500 Vac
	Between channels and field power	No
	Between field power and bus	1,500 Vac
Protection and detection		Voltage input: Miswiring protection by channel Current input: Overcurrent and miswiring protection by channel
Power dissipation		1.52 W

Input Characteristics

The following table describes the input characteristics of the NTSAMI0400 input module:

Characteristics		Value	
		Voltage input	Current input
Input range		± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc	± 20 mA 0...20 mA 4...20 mA
Input impedance		10 M Ω minimum	100 Ω + 10 Ω internal current protector
Input response time	Per enabled channel	250 μ s	
	Per module	Internal I/O bus exchange cycle time ⁽¹⁾ 1 ms minimum	
Maximum accuracy at ambient 25 °C (77 °F) / 60 °C (140 °F)		0.3 % / 0.5 % of full scale	
Temperature drift		± 0.0057 %/°C of full scale	
Repeatability after stabilization time		± 0.007 % of full scale	
Nonlinearity		± 0.01 % of full scale	
Monotonicity		Yes	
Input value of LSB		0.31 mV (range ± 10 Vdc) 0.31 mV (range 0...10 Vdc) 0.16 mV (range ± 5 Vdc) 0.16 mV (range 0...5 Vdc) 0.13 mV (range 1...5 Vdc)	0.61 μ A (range ± 20 mA) 0.61 μ A (range 0...20 mA) 0.49 μ A (range 4...20 mA)
Resolution	Signed signal	± 10 V, ± 5 V, ± 20 mA: 16 bits, or 15 bits plus sign bit	
	Unsigned signal	0...10 V, 0...5 V, 1...5 V, 0...20 mA, 4...20 mA: 15 bits	
Input data out of range detection		Yes	
Resistance to electromagnetic interference	Crosstalk between channels	80 dB minimum	
	Common mode rejection	90 dB	
Cable		Shielded, 200 m (656 ft) maximum	Shielded, 1,000 m (3,281 ft) maximum
Input filter		Software run-time configurable filter. Refer to Measurement Filter , page 137.	
HART compliance		No	
HART communication		No	
NAMUR NE43 compliance	Applicable nominal range	—	4...20 mA
	Convertible range	—	0...22 mA
	Safety margin IFM , Low / IFM , High	—	0.1 mA / 0.2 mA
	Failure signal detection time	—	4 s
Supply voltage		24 Vdc	
Maximum continuous allowed overload (no damage)		30 Vdc	30 Vdc / 50 mA
⁽¹⁾ For more information, refer to Configurable Parameters in Modicon Edge I/O NTS - Network Interface Modules - User Guide.			

NTSAMI0400 Wiring

Overview


This section provides the wiring diagram for the NTSAMI0400 input module.

Wiring Rules

For more information on the wiring, refer to Modicon Edge I/O - System Planning and Installation Guide.

Wiring Diagram

The following figure illustrates the connection between the inputs and the sensors:

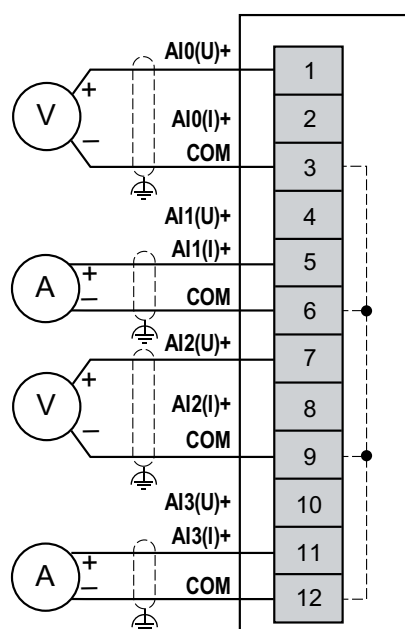

(U): Voltage
(I): Current

NTSAMI0400 Parameters

Overview

This section describes the parameters of the NTSAMI0400 module.

Parameters are the set of values, specific to a module, that can be edited with the programming software during edition mode.

Software configuration is accomplished with one of the following options:

- The Edge I/O configuration software (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).
- The EcoStruxure Automation Expert software (refer to the [EcoStruxure Automation Expert](#) online help).
- The EcoStruxure Automation Expert - Motion software (refer to the [EcoStruxure Automation Expert - Motion](#) online help).
- The embedded Web interface (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).

If you have physically wired the analog channel for a voltage signal and you configure the channel for a current signal, you may damage the analog circuit.

NOTICE
INOPERABLE EQUIPMENT Verify that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel. Failure to follow these instructions can result in equipment damage.

Parameters Description

Configurable Parameters

The following table presents the configurable parameters for the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Device Mode <i>DeviceMode</i>	0: Normal * 1: Optional 2: Virtual reserved	ENUM	Allows you to select the device mode: • Normal: The module is part of the software configuration and is physically connected in the cluster. • Optional: The module is part of the software configuration. A dummy module or the configured module must be physically installed in the cluster. Whether either module is present does not cause a configuration error to be detected. • Virtual reserved: The module is part of the software configuration. A dummy module must be physically installed in the cluster. If the virtual module is physically installed in the cluster, a configuration error is detected.
* Parameter default value			

The following table presents the configurable parameters for the channels of the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Channel Enabled <i>ChannelEnable</i>	FALSE TRUE*	BOOL	Determines whether a channel is activated or deactivated.
Range Mode <i>RangeMode</i>	± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc ± 20 mA 0...20 mA 4...20 mA	ENUM	Defines the range mode for the input channel. For more information on RangeMode parameter, refer to <i>RangeMode Parameters</i> , page 138.
Range Maximum <i>RangeMax</i>	-32767...32767	INT16	Sets the maximum value of the nominal range. The values are computed according to the selected RangeMode .
Range Minimum <i>RangeMin</i>	-32768...32766	INT16	Sets the minimum value of the nominal range. The values are computed according to the selected RangeMode .
NE43 Enabled <i>NE43Enable</i>	FALSE* TRUE	BOOL	Enables or disables NE43 compliance. NE43 compliance can be enabled when the RangeMode is set to 4...20 mA . When NE43 Enabled is set to TRUE , the threshold values (Underflow Threshold/Overflow Threshold) are not configurable, the fixed threshold values are 3.6 mA / 21 mA.
Overflow Checked <i>OverflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables overflow detection. An error is detected if the measurement is greater than Overflow Threshold . For more information on OverflowChecked parameter, refer to <i>Overflowcheck/Underflowcheck</i> , page 141.
Overflow Threshold <i>OverMax</i>	-32767...32767	INT16	Sets the overflow threshold value. The values are computed according to the selected RangeMax value.
Underflow Checked <i>UnderflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables underflow detection. An error is detected if the measurement is lower than Underflow Threshold . For more information on UnderflowChecked parameter, refer to <i>Overflowcheck/Underflowcheck</i> , page 141.
Underflow Threshold <i>OverMin</i>	-32768...32766	INT16	Sets the underflow threshold value. The values are computed according to the selected RangeMin value.
Alignment Offset <i>AlignmentOffset⁽¹⁾</i>	-1500...1500	INT16	Compensates for a permanent offset observed with a given sensor, around a specific operating point. This operation compensates for an offset linked to the process. Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment. For more information on AlignmentOffset parameter, refer to <i>Alignment Offset</i> , page 138.

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Filter <i>Filter⁽¹⁾</i>	No filtering: 0* Low filtering: 1 2 Medium filtering: 3 4 High filtering: 5 6	ENUM	Defines the type of filtering for the input channel selected for the analog modules. For more information on Filter parameter, refer to Measurement Filter , page 137.
* Parameter default value (1) Online modification is allowed.			

Implicit Data

The following table presents the input implicit data for the module:

<i>Parameter Name</i>	Value(s)	Data type Size in bytes	Description
GCS	0...255	BYTE 1	Group Cyclic Status Bit 0: Data quality Bit 1: General module status Bit 2: I/O status Bit 3: N/A Bit 4: N/A Bit 5: Advisory status Bit 6: N/A Bit 7: Data freshness NOTE: For more information, refer to Modicon Edge I/O - Diagnostic Data - User Guide .
<i>ChannelHealth0_7⁽¹⁾</i>	0...255	BYTE 1	Bit 0...7 = Status of channel 0...7 - Bit = FALSE: Channel is invalid or not present. - Bit = TRUE: Channel is valid or disabled.
(1) This parameter is not part of the implicit data if the optimized I/O profile is selected.			

The following table presents the input implicit data for the channels of the module:

<i>Parameter Name</i>	Value(s)	Data type Size in bytes	Description
<i>IValue</i>	-32,768... 32,767	INT16 2	Value of the input channel.

Explicit Data

The following table presents the explicit data for the channels of the module:

<i>Parameter Name</i>	<i>Value(s)</i>	<i>Data type</i> <i>Size in bytes</i>	<i>Description</i>
<i>ChannelFault1</i>	0...255	BYTE 1	Indicates module channel error catalog. Bit 0: Underflow error detected Bit 1: Overflow error detected Bit 2: Broken wire error detected Bit 3: N/A Bit 4: Hardware error detected NOTE: Bits 5 to 7 are reserved.
<i>ChannelFault2</i>	0...255	BYTE 1	Bit 7: Power supply error detected NOTE: Bits 0 to 6 are reserved.
<i>MeasureStatus1</i>	0...255	BYTE 1	Bit 0: Lower tolerance alert Bit 1: Upper tolerance alert Bit 2: Non-zero alignment offset configured Bit 3: Channel enabled configured NOTE: Bits 4 to 7 are reserved.
<i>MeasureStatus2</i>	0...255	BYTE 1	Bits 0 to 7 are reserved.

NTSAMI0420 Analog Input Module, 4 Differential Inputs, Current, Voltage, 2-wire

What's in This Chapter

NTSAMI0420 Presentation	51
NTSAMI0420 Characteristics	55
NTSAMI0420 Wiring	58
NTSAMI0420 Parameters	59

NTSAMI0420 Presentation

Overview

This section provides a presentation of the NTSAMI0420 input module.


Main Characteristics

The following table describes the main characteristics of the NTSAMI0420 input module:

Main Characteristics	Value
Product or component type	Analog current and voltage input module
Number of channels	4
Channel property	Differential
Channel signal	Current or voltage
Operating mode	Isochronous and asynchronous

Purchasing Information

The following figure shows the elements of the Modicon Edge I/O NTS NTSAMI0420 input module:

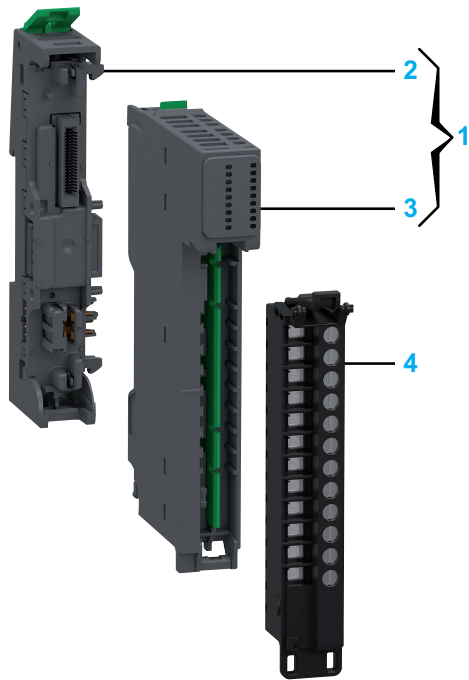


Number	Reference	Description
1	NTSAMI0420K	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXBA0100H	Spare Base, 1 Slot, for Input/Output Common or Expert Module, Hardened
3	NTSAMI0420	Analog Input Module, 4 Differential Inputs, Current, Voltage, 2-wire
4	NTSXTB12200H NTSXTB12201H NTSXTB12000H NTSXTB12001H	Spring Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Spring Terminal Block, 12 Points, 5 mm Pitch, With Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, With cover, use on Low Height Module, Hardened NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

Physical Description


The following figure presents the elements of the module:

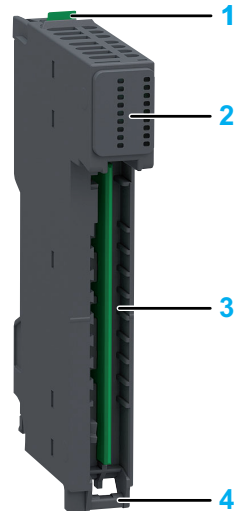

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

Status LEDs


The following figure presents the NTSAMI0420 status LEDs:



The following table describes the status of LEDs:

R (Green)	E (Red)	Channel (Green)	Description
Initialization and non-operational states			
OFF	OFF	OFF	Indicates that the module is not energized.
OFF	Fast Flash	-	Indicates that the module has detected a system error.
Regular Flash	OFF	-	Indicates that the firmware is being updated.
Regular Flash	ON	-	Indicates that a module mismatch is detected.
Single Flash	OFF	-	Indicates that the module is energized and not configured.
Operational state			
ON	OFF	-	Indicates that the module is energized, configured and operational.
ON	-	ON	Indicates that the channel is activated.
ON	-	OFF	Indicates that the channel is deactivated.
ON	Single Flash	-	Indicates an advisory detection.
ON	Single Flash	Single Flash	Indicates: • Lower tolerance advisory detection. • Upper tolerance advisory detection.
ON	Regular Flash	OFF	Indicates that an error is detected in the 24 Vdc field power.
ON	Regular Flash	Regular Flash	Indicates: • Broken wire detection. • Overflow/underflow error detection.
ON	Regular Flash	OFF	Indicates an internal error detection.

The following graphic shows the system status of LEDs during module operation:

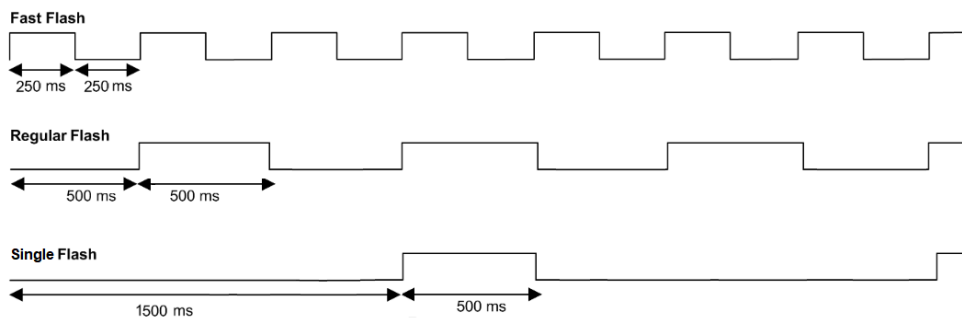

NTSAMI0420 Characteristics

Overview

This section provides a general description of the characteristics of the module.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION


Do not exceed any of the rated values specified in the environmental and electrical characteristics tables.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

For more information on environmental characteristics, refer to Modicon Edge I/O - System Planning and Installation Guide.

Dimensions

The following figure presents the external dimensions of the assembled module:

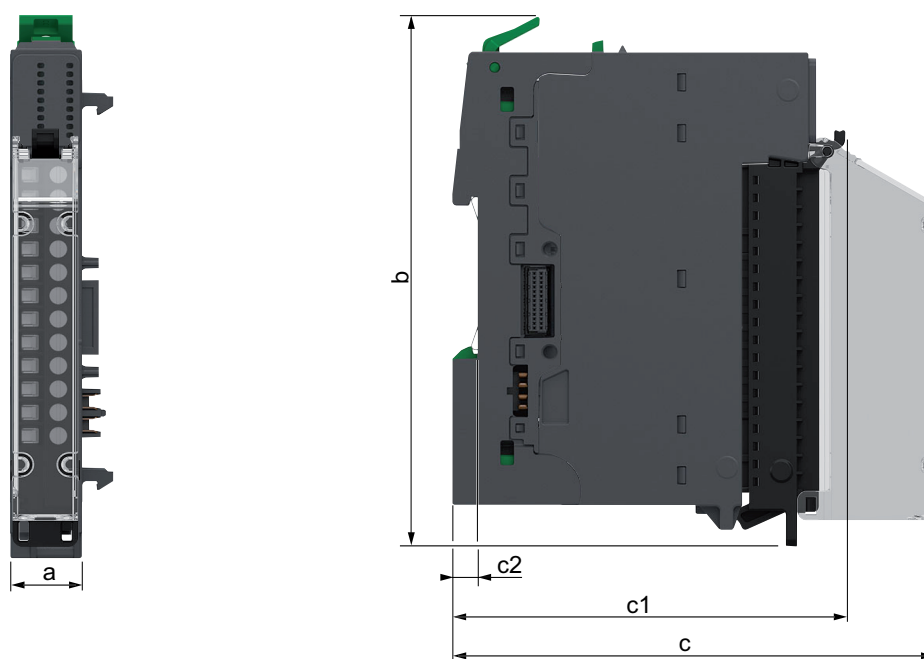

- a:** 15 mm (0.59 in)
- b:** 116.6 mm (4.57 in)
- c:** 107.5 mm (4.21 in)
- c1:** 88.2 mm (3.46 in)
- c2:** 5.6 mm (0.2 in)

Weight

- NTSAMI0420: 48 g (1.69 oz)
- NTSAMI0420K: 73 g (2.58 oz)

General Characteristics

The following table shows the general characteristics of the NTSAMI0420 input modules:

Characteristics		Value
Rated supplied voltage		24 Vdc
Power supplied voltage range		20.4...28.8 Vdc
Isolation	Between channels	No
	Between channels and bus	1,500 Vac
	Between channels and field power	1,000 Vac
	Between field power and bus	1,500 Vac
Protection and detection		Module: - Field power from the power supply module detection Analog Input: - Voltage input: Miswiring protection by channel - Current input: Overcurrent and miswiring protection by channel
Power dissipation		1.76 W

Input Characteristics

The following table describes the input characteristics of the NTSAMI0420 input module:

Characteristics		Value	
		Voltage input	Current input
Input range		±10 Vdc	±20 mA
		0...10 Vdc	0...20 mA
		±5 Vdc	4...20 mA
		0...5 Vdc	
		1...5 Vdc	
Input impedance		5 MΩ minimum	100 Ω + 10 Ω internal current protector
Input response time	Per enabled channel	70 μs	
	Per module	Internal I/O bus exchange cycle time ⁽¹⁾ 1 ms minimum	
Maximum accuracy at ambient 25 °C (77 °F) / 60 °C (140 °F)		0.3 % / 0.5 % of full scale	
Temperature drift		±0.0057 %/°C of full scale	
Repeatability after stabilization time		±0.007 % of full scale	
Nonlinearity		±0.01 % of full scale	
Monotonicity		Yes	
Resolution	Signed signal	±10 V, ±5 V, ±20 mA: 16 bits, or 15 bits plus sign bit	
	Unsigned signal	0...10 V, 0...5V, 1...5V, 0...20mA, 4...20mA: 15 bits	
Input value of LSB		0.31 mV (range ±10 Vdc)	0.61 μA (range ±20 mA)
		0.31 mV (range 0...10 Vdc)	0.61 μA (range 0...20 mA)
		0.16 mV (range ±5 Vdc)	0.49 μA (range 4...20 mA)
		0.16 mV (range 0...5 Vdc)	
		0.13 mV (range 1...5 Vdc)	
Input data out of range detection		Yes	
Resistance to electromagnetic interference	Crosstalk between channels	80 dB minimum	
	Common mode rejection	70 dB	
Cable		Shielded, 200 m (656 ft) maximum	Shielded, 1,000 m (3,281 ft) maximum
Input filter		Software run-time configurable filter. Refer to Measurement Filter , page 137.	
NAMUR NE43 compliance	Applicable nominal range	—	4...20 mA
	Convertible range	—	0...22 mA
	Safety margin IFM,Low / IFM,High	—	0.1 mA / 0.2 mA
	Failure signal detection time	—	4 s
Supply voltage		24 Vdc	
Maximum continuous allowed overload (no damage)		30 Vdc	30 Vdc / 50 mA
⁽¹⁾ For more information, refer to Configurable Parameters in Modicon Edge I/O NTS - Network Interface Modules - User Guide.			

NTSAMI0420 Wiring

Overview


This section provides the wiring diagram for the NTSAMI0420 input module.

Wiring Rules

For more information on the wiring, refer to Modicon Edge I/O - System Planning and Installation Guide.

Wiring Diagram

The following figure illustrates the connection between the inputs and the sensors:

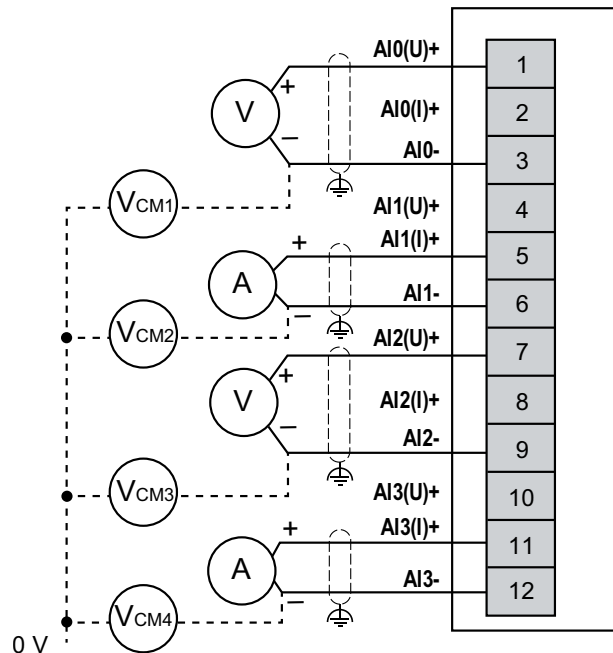

(U): Voltage
(I): Current

NOTE: V_{CM} is the common mode voltage relative to 24 Vdc Field power, with maximum allowable common mode voltage between channels of +/- 12 Vdc.

NTSAMI0420 Parameters

Overview

This section describes the parameters of the NTSAMI0420 module.

Parameters are the set of values, specific to a module, that can be edited with the programming software during edition mode.

Software configuration is accomplished with one of the following options:

- The Edge I/O configuration software (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).
- The EcoStruxure Automation Expert software (refer to the [EcoStruxure Automation Expert online help](#)).
- The EcoStruxure Automation Expert - Motion software (refer to the [EcoStruxure Automation Expert - Motion online help](#)).
- The embedded Web interface (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).

Parameters Description

If you have physically wired the analog channel for a voltage signal and you configure the channel for a current signal, you may damage the analog circuit.

NOTICE

INOPERABLE EQUIPMENT

Verify that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel.

Failure to follow these instructions can result in equipment damage.

Configurable Parameters

The following table presents the configurable parameters for the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Device Mode <i>DeviceMode</i>	0: Normal * 1: Optional 2: Virtual reserved	ENUM	Allows you to select the device mode: Normal: The module is part of the software configuration and is physically connected in the cluster. Optional: The module is part of the software configuration. A dummy module or the configured module must be physically installed in the cluster. Whether either module is present does not cause a configuration error to be detected. Virtual reserved: The module is part of the software configuration. A dummy module must be physically installed in the cluster. If the virtual module is physically installed in the cluster, a configuration error is detected.
* Parameter default value			

For each input channel you can define:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Channel Enabled <i>ChannelEnable</i>	FALSE TRUE*	BOOL	Determines whether a channel is activated or deactivated.
Range Mode <i>RangeMode</i>	+/-10 V* 0..10 V +/-5 V 0..5 V 1..5 V +/-20 mA 0..20 mA 4..20 mA	ENUM	Defines the range mode for the input channel. For more information on RangeMode parameter, refer to RangeMode Parameters, page 138.
Range Maximum <i>RangeMax</i>	-32767...32767	INT16	Sets the maximum value of the nominal range. The values are computed according to the selected RangeMode .
Range Minimum <i>RangeMin</i>	-32768...32766	INT16	Sets the minimum value of the nominal range. The values are computed according to the selected RangeMode .
NE43 Enabled <i>NE43Enable</i>	FALSE* TRUE	BOOL	Enables or disables NE43 compliance. NE43 compliance can be enabled when the RangeMode is set to 4..20mA . When NE43 Enabled is set to TRUE , the threshold values (Underflow Threshold/Overflow Threshold) are not configurable, the fixed threshold values are 3.6 mA / 21 mA.
Overflow Checked <i>OverflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables overflow detection. An error is detected if the measurement is greater than Overflow Threshold . For more information on OverflowChecked parameter, refer to Overflowcheck/Underflowcheck, page 141.
Overflow Threshold <i>OverMax</i>	-32767...32767	INT16	Sets the overflow threshold value. The values are computed according to the selected RangeMax value.
Underflow Checked <i>UnderflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables underflow detection. An error is detected if the measurement is lower than Underflow Threshold . For more information on UnderflowChecked parameter, refer to Overflowcheck/Underflowcheck, page 141.
Underflow Threshold <i>OverMin</i>	-32768...32766	INT16	Sets the underflow threshold value. The values are computed according to the selected RangeMin value.
Alignment Offset <i>AlignmentOffset⁽¹⁾</i>	-1500...1500	INT16	Compensates for a permanent offset observed with a given sensor, around a specific operating point. This operation compensates for an offset linked to the process. Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment. For more information on AlignmentOffset parameter, refer to Alignment Offset, page 138.

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Filter <i>Filter⁽¹⁾</i>	No filtering: 0* Low filtering: 1 2 Medium filtering: 3 4 High filtering: 5 6 Peak filtering: 7	ENUM	Defines the type of filtering for the input channel selected for the analog modules. For more information on Filter parameter, refer to <i>Measurement Filter</i> , page 137.
* Parameter default value (1) Online modification is allowed.			

Implicit Data

The following table presents the input implicit data for the module:

<i>Parameter Name</i>	Value(s)	Data type Size in bytes	Description
GCS	0...255	BYTE 1	Group Cyclic Status Bit 0: Data quality Bit 1: General module status Bit 2: I/O status Bit 3: N/A Bit 4: N/A Bit 5: Advisory status Bit 6: N/A Bit 7: Data freshness NOTE: For more information, refer to <i>Modicon Edge I/O - Diagnostic Data - User Guide</i> .
<i>ChannelHealth0_7⁽¹⁾</i>	0...255	BYTE 1	Bit 0...7 = Status of channel 0...7 - Bit = FALSE: Channel is invalid or not present. - Bit = TRUE: Channel is valid or disabled.
(1) This parameter is not part of the implicit data if the optimized I/O profile is selected.			

The following table presents the input implicit data for the channels of the module:

<i>Parameter Name</i>	Value(s)	Data type Size in bytes	Description
<i>IValue</i>	-32,768... 32,767	INT16 2	Value of the input channel.

Explicit Data

The following table presents the explicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
<i>ChannelFault1</i>	0...255	BYTE 1	Indicates module channel error catalog. Bit 0: Underflow error detected Bit 1: Overflow error detected Bit 2: Broken wire error detected Bit 3: N/A Bit 4: Hardware error detected NOTE: Bits 5 to 7 are reserved.
<i>ChannelFault2</i>	0...255	BYTE 1	Bit 7: Power supply error detected NOTE: Bits 0 to 6 are reserved.
<i>MeasureStatus1</i>	0...255	BYTE 1	Bit 0: Lower tolerance alert Bit 1: Upper tolerance alert Bit 2: Non-zero alignment offset configured Bit 3: Channel enabled configured NOTE: Bits 4 to 7 are reserved.
<i>MeasureStatus2</i>	0...255	BYTE 1	Bits 0 to 7 are reserved.

NTSAMI0800 Analog Input Module, 8 Inputs, Current, Voltage, 2-wire

What’s in This Chapter

NTSAMI0800 Presentation64

NTSAMI0800 Characteristics68

NTSAMI0800 Wiring71

NTSAMI0800 Parameters72

NTSAMI0800 Presentation

Overview

This section provides a presentation of the NTSAMI0800 input module.


Main Characteristics

The following table describes the main characteristics of the NTSAMI0800 input module:

Main Characteristics	Value
Product or component type	Analog current and voltage input module
Number of channels	8
Channel property	Single-ended
Channel signal	Current or voltage
Operating mode	Isochronous and asynchronous

Purchasing Information

The following figure shows the elements of the Modicon Edge I/O NTS NTSAMI0800 input module:

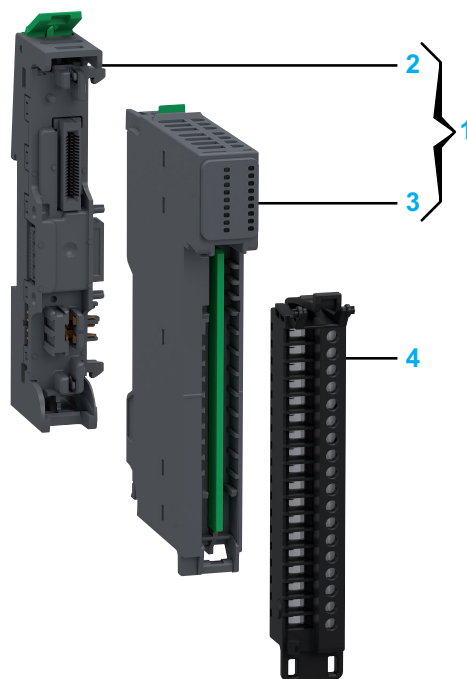


Number	Reference	Description
1	NTSAMI0800K	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXBA0100H	Spare Base, 1 Slot, for Input/Output Common or Expert Module, Hardened
3	NTSAMI0800	Analog Input Module, 8 Inputs, Current, Voltage, 2-wire
4	NTSXTB18200H NTSXTB18201H NTSXTB18000H NTSXTB18001H	Spring Terminal Block, 18 Points, 3.81 mm Pitch, Without Cover, use on Low Height Module, Hardened Spring Terminal Block, 18 Points, 3.81 mm Pitch, With Cover, use on Low Height Module, Hardened Screw Terminal Block, 18 Points, 3.81 mm Pitch, Without Cover, use on Low Height Module, Hardened Screw Terminal Block, 18 Points, 3.81 mm Pitch, With Cover, use on Low Height Module, Hardened NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

Physical Description

NTSAMI0800

The following figure presents the elements of the module:

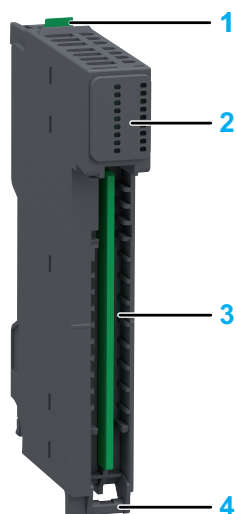

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

Status LEDs


The following figure presents the NTSAMI0800 status LEDs:



The following table describes the status of LEDs:

R (Green)	E (Red)	Channel (Green)	Description
Initialization and non-operational states			
OFF	OFF	OFF	Indicates that the module is not energized.
OFF	Fast Flash	-	Indicates that the module has detected a system error.
Regular Flash	OFF	-	Indicates that the firmware is being updated.
Regular Flash	ON	-	Indicates that a module mismatch is detected.
Single Flash	OFF	-	Indicates that the module is energized and not configured.
Operational state			
ON	OFF	-	Indicates that the module is energized, configured and operational.
ON	-	ON	Indicates that the channel is activated.
ON	-	OFF	Indicates that the channel is deactivated.
ON	Single Flash	-	Indicates an advisory detection.
ON	Single Flash	Single Flash	Indicates: - Lower tolerance advisory detection. - Upper tolerance advisory detection.
ON	Regular Flash	OFF	Indicates that an error is detected in the 24 Vdc field power.
ON	Regular Flash	Regular Flash	Indicates: - Broken wire detection. - Overflow/underflow error detection.
ON	Regular Flash	OFF	Indicates an internal error detection.

The following graphic shows the system status of LEDs during module operation:

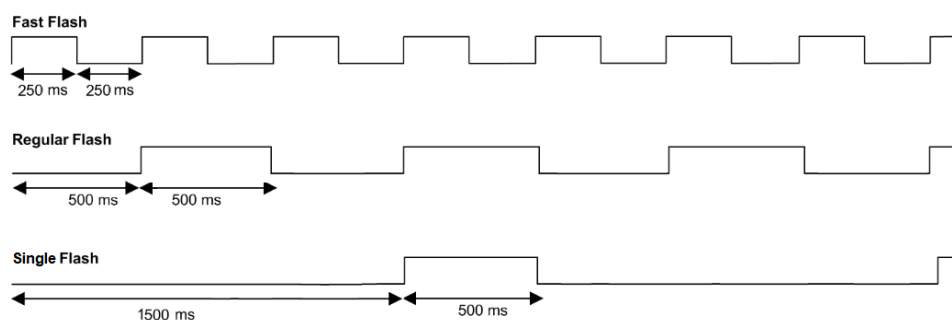

NTSAMI0800 Characteristics

Overview

This section provides a general description of the characteristics of the module.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION


Do not exceed any of the rated values specified in the environmental and electrical characteristics tables.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

For more information on environmental characteristics, refer to Modicon Edge I/O - System Planning and Installation Guide.

Dimensions

The following figure presents the external dimensions of the assembled module:

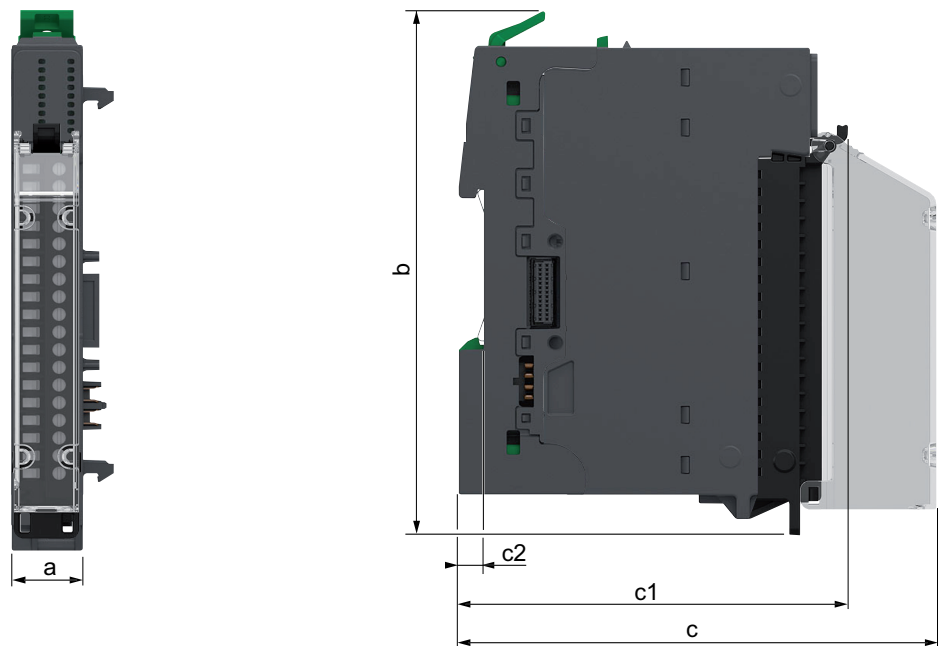

- a:** 15 mm (0.59 in)
- b:** 116.6 mm (4.57 in)
- c:** 107.5 mm (4.21 in)
- c1:** 88.2 mm (3.46 in)
- c2:** 5.6 mm (0.2 in)

Weight

- NTSAMI0800: 48 g (1.69 oz)
- NTSAMI0800K: 73 g (2.58 oz)

General Characteristics

The following table shows the general characteristics of the NTSAMI0800 input module:

Characteristics		Value
Rated supplied voltage		24 Vac
Power supplied voltage range		20.4...28.8 Vdc
Isolation	Between channels	No
	Between channels and bus	1,500 Vac
	Between channels and field power	No
	Between field power and bus	1,500 Vac
Protection and detection		Module: • Field power from the power supply module detection Analog Input: • Voltage input: Miswiring protection by channel • Current input: Overcurrent and miswiring protection by channel
Power dissipation		2.04 W

Input Characteristics

The following table describes the input characteristics of the NTSAMI0800 input module:

Characteristics		Value	
		Voltage input	Current input
Input range		± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc	± 20 mA 0...20 mA 4...20 mA
Input impedance		7 M Ω minimum	250 Ω and 10 Ω internal current protector
Input response time	Per enabled channel	125 μ s	
	Per module	Internal I/O bus exchange cycle time ⁽¹⁾ 1 ms minimum	
Temperature drift		± 0.0057 %/°C of full scale	
Repeatability after stabilization time		± 0.007 %/ of full scale	
Nonlinearity		± 0.01 % of full scale	
Monotonicity		Yes	
Resolution	Signed signal	± 10 Vdc, ± 5 Vdc, ± 20 mA: 16 bits, or 15 bits plus sign bit	
	Unsigned signal	0...10 Vdc, 0...5 Vdc, 1...5 Vdc, 0...20 mA, 4...20 mA: 15 bits	
Input value of LSB		0.31 mV (range ± 10 Vdc) 0.31 mV (range 0...10 Vdc) 0.16 mV (range ± 5 Vdc) 0.16 mV (range 0...5 Vdc) 0.13 mV (range 1...5 Vdc)	0.61 μ A (range ± 20 mA) 0.61 μ A (range 0...20 mA) 0.49 μ A (range 4...20 mA)
Input data out of range detection		Yes	
Resistance to electromagnetic interference	Crosstalk between channels	80 dB minimum	
	Common mode rejection	90 dB	
Cable		Shielded, 200 m (656 ft) maximum	Shielded, 1,000 m (3,281 ft) maximum
Input filter		Software run-time configurable filter. Refer to Measurement Filter , page 137.	
NAMUR NE43 compliance	Applicable nominal range	—	4...20 mA
	Convertible range	—	0...22 mA
	Safety margin IFM,Low / IFM,High	—	0.1 mA / 0.2 mA
	Failure signal detection time	—	4 s
Supply voltage		24 Vdc	
Maximum continuous allowed overload (no damage)		30 Vdc	30 Vdc / 50 mA
⁽¹⁾ For more information, refer to Configurable Parameters in Modicon Edge I/O NTS - Network Interface Modules - User Guide.			

NTSAMI0800 Wiring

Overview


This section provides the wiring diagram for the NTSAMI0800 input module.

Wiring Rules

For more information on the wiring, refer to Modicon Edge I/O - System Planning and Installation Guide.

Wiring Diagram

The following figure illustrates the connection between the inputs and the sensors:

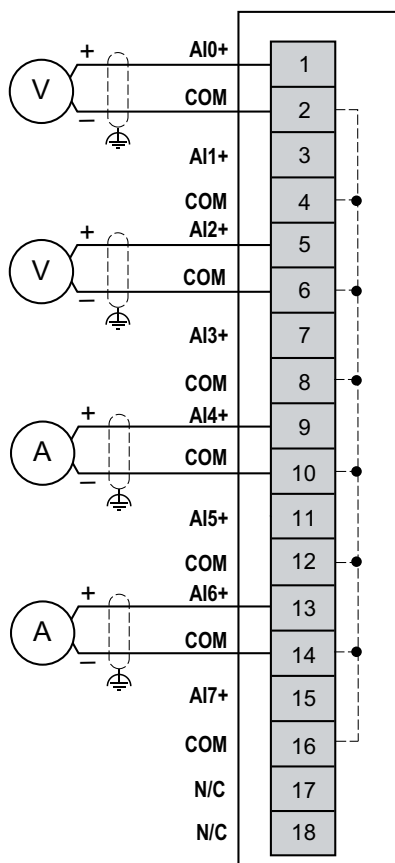

N/C: Not Connected

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals and/or terminals indicated as “No Connection (N/C)”.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NTSAMI0800 Parameters

Overview

This section describes the parameters of the NTSAMI0800 module.

Parameters are the set of values, specific to a module, that can be edited with the programming software during edition mode.

Software configuration is accomplished with one of the following options:

- The Edge I/O configuration software (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).
- The EcoStruxure Automation Expert software (refer to the [EcoStruxure Automation Expert online help](#)).
- The EcoStruxure Automation Expert - Motion software (refer to the [EcoStruxure Automation Expert - Motion online help](#)).
- The embedded Web interface (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).

Parameters Description

If you have physically wired the analog channel for a voltage signal and you configure the channel for a current signal, you may damage the analog circuit.

NOTICE

INOPERABLE EQUIPMENT

Verify that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel.

Failure to follow these instructions can result in equipment damage.

Configurable Parameters

The following table presents the configurable parameters for the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Device Mode <i>DeviceMode</i>	0: Normal * 1: Optional 2: Virtual reserved	ENUM	Allows you to select the device mode: Normal: The module is part of the software configuration and is physically connected in the cluster. Optional: The module is part of the software configuration. A dummy module or the configured module must be physically installed in the cluster. Whether either module is present does not cause a configuration error to be detected. Virtual reserved: The module is part of the software configuration. A dummy module must be physically installed in the cluster. If the virtual module is physically installed in the cluster, a configuration error is detected.
* Parameter default value			

The following table presents the configurable parameters for the channels of the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Channel Enabled <i>ChannelEnable</i>	FALSE TRUE *	BOOL	Determines whether a channel is activated or deactivated.
Range Mode <i>RangeMode</i>	+/-10 V * 0..10 V +/-5 V 0..5 V 1..5 V +/-20 mA 0..20 mA 4..20 mA	ENUM	Defines the range mode for the input channel. For more information on RangeMode parameter, refer to RangeMode Parameters , page 138.
Range Maximum <i>RangeMax</i>	-32767...32767	INT16	Sets the maximum value of the nominal range. The values are computed according to the selected RangeMode .
Range Minimum <i>RangeMin</i>	-32768...32766	INT16	Sets the minimum value of the nominal range. The values are computed according to the selected RangeMode .
NE43 Enabled <i>NE43Enable</i>	FALSE * TRUE	BOOL	Enables or disables NE43 compliance. NE43 compliance can be enabled when the RangeMode is set to 4..20mA . When NE43 Enabled is set to TRUE , the threshold values (Underflow Threshold/Overflow Threshold) are not configurable, the fixed threshold values are 3.6 mA / 21 mA.

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Overflow Checked <i>OverflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables overflow detection. An error is detected if the measurement is greater than Overflow Threshold . For more information on OverflowChecked parameter, refer to <i>Overflowcheck/Underflowcheck</i> , page 141.
Overflow Threshold <i>OverMax</i>	-32767...32767	INT16	Sets the overflow threshold value. The values are computed according to the selected RangeMax value.
Underflow Checked <i>UnderflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables underflow detection. An error is detected if the measurement is lower than Underflow Threshold . For more information on UnderflowChecked parameter, refer to <i>Overflowcheck/Underflowcheck</i> , page 141.
Underflow Threshold <i>OverMin</i>	-32768...32766	INT16	Sets the underflow threshold value. The values are computed according to the selected RangeMin value.
Alignment Offset <i>AlignmentOffset⁽¹⁾</i>	-1500...1500	INT16	Compensates for a permanent offset observed with a given sensor, around a specific operating point. This operation compensates for an offset linked to the process. Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment. For more information on AlignmentOffset parameter, refer to <i>Alignment Offset</i> , page 138.
Filter <i>Filter⁽¹⁾</i>	No filtering: 0* Low filtering: 1 2 Medium filtering: 3 4 High filtering: 5 6	ENUM	Defines the type of filtering for the input channel selected for the analog modules. For more information on Filter parameter, refer to <i>Measurement Filter</i> , page 137.
* Parameter default value ⁽¹⁾ Online modification is allowed.			

Implicit Data

The following table presents the input implicit data for the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
GCS	0...255	BYTE 1	Group Cyclic Status Bit 0: Data quality Bit 1: General module status Bit 2: I/O status Bit 3: N/A Bit 4: N/A Bit 5: Advisory status Bit 6: N/A Bit 7: Data freshness NOTE: For more information, refer to Modicon Edge I/O - Diagnostic Data - User Guide.
ChannelHealth0_7 ⁽¹⁾	0...255	BYTE 1	Bit 0...7 = Status of channel 0...7 • Bit = FALSE: Channel is invalid or not present. • Bit = TRUE: Channel is valid or disabled.
⁽¹⁾ This parameter is not part of the implicit data if the optimized I/O profile is selected.			

The following table presents the input implicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
IValue	-32,768... 32,767	INT16 2	Value of the input channel.

Explicit Data

The following table presents the explicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
<i>ChannelFault1</i>	0...255	BYTE 1	Indicates module channel error catalog. Bit 0: Underflow error detected Bit 1: Overflow error detected Bit 2: Broken wire error detected Bit 3: N/A Bit 4: Hardware error detected NOTE: Bits 5 to 7 are reserved.
<i>ChannelFault2</i>	0...255	BYTE 1	Bit 7: Power supply error detected NOTE: Bits 0 to 6 are reserved.
<i>MeasureStatus1</i>	0...255	BYTE 1	Bit 0: Lower tolerance alert Bit 1: Upper tolerance alert Bit 2: Non-zero alignment offset configured Bit 3: Channel enabled configured NOTE: Bits 4 to 7 are reserved.
<i>MeasureStatus2</i>	0...255	BYTE 1	Bits 0 to 7 are reserved.

NTSACI0802X/NTSACI0802XH Analog Input Module, 8 Inputs, Current, 1-/2-wire, Loop Power, Standard/ Hardened

What's in This Chapter

NTSACI0802X/NTSACI0802XH Presentation	77
NTSACI0802X/NTSACI0802XH Characteristics	81
NTSACI0802X/NTSACI0802XH Wiring	84
NTSACI0802X/NTSACI0802XH Parameters	88

NTSACI0802X/NTSACI0802XH Presentation

Overview

This section provides a presentation of the NTSACI0802X/NTSACI0802XH input modules.


Main Characteristics

The following table describes the main characteristics of the NTSACI0802X/NTSACI0802XH input modules:

Main Characteristics	Value
Product or component type	Analog current input module
Number of channels	8
Channel property	Single-ended
Channel signal	Current
Operating mode	Isochronous and asynchronous

Purchasing Information

The following figure shows the elements of the Modicon Edge I/O NTS NTSACI0802X/NTSACI0802XH input modules:

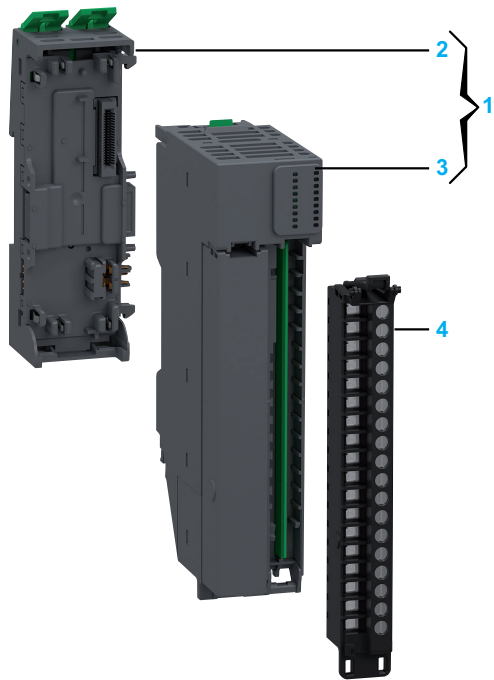


Number	Reference	Description
1	NTSACI0802XK NTSACI0802XHK	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXBA0200H	Spare Base, 2 Slots, for Input/Output Common/Expert/Safety Module, Hardened
3	NTSACI0802X NTSACI0802XH	Analog Input Module, 8 Inputs, Current, 1-/2-wire, Loop Power Analog Input Module, 8 Inputs, Current, 1-/2-wire, Loop Power, Hardened
4	NTSXTB18200XH NTSXTB18201XH NTSXTB18000XH NTSXTB18001XH	Spring Terminal Block, 18 Points, 5 mm Pitch, Without Cover, use on High Height Module (X), Hardened Spring Terminal Block, 18 Points, 5 mm Pitch, With Cover, use on High Height Module (X), Hardened Screw Terminal Block, 18 Points, 5 mm Pitch, Without Cover, use on High Height Module (X), Hardened Screw Terminal Block, 18 Points, 5 mm Pitch, With Cover, use on High Height Module (X), Hardened NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

Physical Description

The following figure presents the elements of the module:

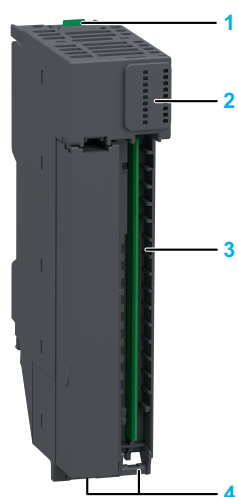

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

Status LEDs


The following figure presents the NTSACI0802X/NTSACI0802XH status LEDs:



The following table describes the status of LEDs:

R (Green)	E (Red)	Channel (Green)	Description
Initialization and non-operational states			
OFF	OFF	OFF	Indicates that the module is not energized.
OFF	Fast Flash	-	Indicates that the module has detected a system error.
Regular Flash	OFF	-	Indicates that the firmware is being updated.
Regular Flash	ON	-	Indicates that a module mismatch is detected.
Single Flash	OFF	-	Indicates that the module is energized and not configured.
Operational state			
ON	OFF	-	Indicates that the module is energized, configured and operational.
ON	-	ON	Indicates that the channel is activated.
ON	-	OFF	Indicates that the channel is deactivated.
ON	Single Flash	-	Indicates an advisory detection.
ON	Single Flash	Single Flash	Indicates: • Lower tolerance advisory detection. • Upper tolerance advisory detection.
ON	Regular Flash	OFF	Indicates that an error is detected in the 24 Vdc field power.
ON	Regular Flash	Regular Flash	Indicates: • Broken wire detection. • 24 Vdc loop power error detection. • Overflow/underflow error detection.
ON	Regular Flash	OFF	Indicates an internal error detection.

The following graphic shows the system status of LEDs during module operation:

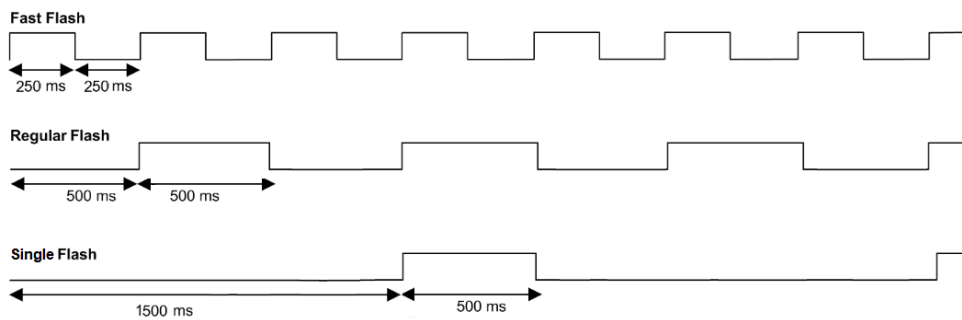

NTSACI0802X/NTSACI0802XH Characteristics

Overview

This section provides a general description of the characteristics of the module.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION


Do not exceed any of the rated values specified in the environmental and electrical characteristics tables.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

For more information on environmental characteristics, refer to Modicon Edge I/O - System Planning and Installation Guide.

Dimensions

The following figure presents the external dimensions of the assembled module:

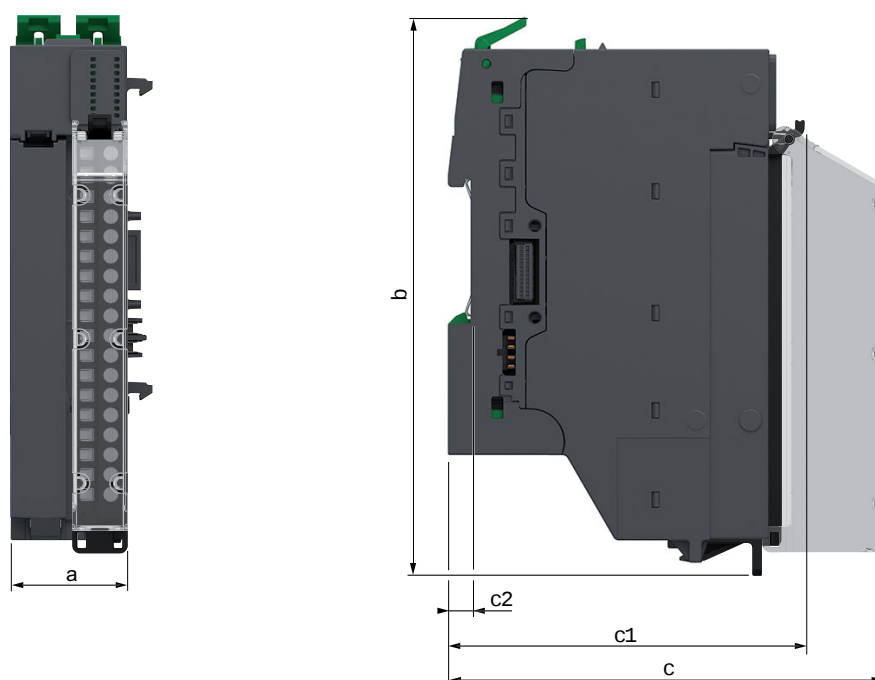

- a:** 30 mm (1.18 in)
- b:** 137.6 mm (5.39 in)
- c:** 107.5 mm (4.21 in)
- c1:** 88.2 mm (3.46 in)
- c2:** 5.6 mm (0.2 in)

Weight

- NTSACI0802X/NTSACI0802XH: 85 g (3.00 oz)
- NTSACI0802XK/NTSACI0802XHk: 131 g (4.62 oz)

General Characteristics

The following table shows the general characteristics of the NTSACI0802X/
NTSACI0802XH input modules:

Characteristics		Value
Rated supplied voltage		24 Vdc
Power supplied voltage range		20.4...28.8 Vdc
Isolation	Between channels	No
	Between channels and bus	1,500 Vac
	Between channels and field power	No
	Between field power and bus	1,500 Vac
Protection and detection		Overcurrent and short circuit on loop power by channel. Current input: Overcurrent and miswiring protection by channel.
Power dissipation		2.27 W

Input Characteristics

The following table describes the input characteristics of the NTSACI0802X/NTSACI0802XH input module:

Characteristics		Value
Input range		±20 mA 0...20 mA 4...20 mA
Input impedance		250 Ω + 10 Ω internal current protector
Input response time	Per enabled channel	125 µs
	Per module	Internal I/O bus exchange cycle time ⁽¹⁾ 1 ms minimum
Maximum accuracy at ambient 25 °C (77 °F) / maximum allowed temperature		±0.1 % / ±0.3 % of full scale
Temperature drift		±0.004 %/°C of full scale
Repeatability after stabilization time		±0.007 % of full scale
Nonlinearity		±0.01 % of full scale
Monotonicity		Yes
Resolution		16 bits, or 15 bits plus sign bit
Input value of LSB		0.61 µA (range ±20 mA) 0.61 µA (range 0...20 mA) 0.49 µA (range 4...20 mA)
Data type in application program		Scalable from -32,768 to 32,767
Input data out of range detection		Yes
Resistance to electromagnetic interference	Crosstalk between channels	80 dB minimum
	Common mode rejection	90 dB
Cable		Shielded, 1,000 m (3,281 ft) maximum
Input filter		Software run-time configurable filter. Refer to Measurement Filter, page 137.
HART compliance		Tolerant
HART communication		No
NAMUR NE43 compliance	Applicable nominal range	4...20 mA
	Convertible range	0...22 mA
	Safety margin IFM,Low / IFM,High	0.1 mA / 0.2 mA
	Failure signal detection time	4 s
Supply voltage		24 Vdc
Loop power	Output voltage	24 Vdc nominal from field power
	Output current	25 mA maximum per channel
	Protection	Overcurrent and short circuit protection, channel based
Maximum continuous allowed overload (no damage)		30 Vdc / 50 mA
⁽¹⁾ For more information, refer to Configurable Parameters in Modicon Edge I/O NTS - Network Interface Modules - User Guide.		

NTSACI0802X/NTSACI0802XH Wiring

Overview

This section provides the wiring diagrams for the NTSACI0802X/NTSACI0802XH input modules.

Wiring Rules

For more information on the wiring, refer to Modicon Edge I/O - System Planning and Installation Guide.


Wiring Diagrams

Loop power supply is used with 2-wire 4...20 mA current sensor and provides a maximum current of 25 mA.

You may choose to use an external power supply to provide loop power.

Current Measurement 1-Wire Diagram

The following figure illustrates the 1-wire connection with 0 V on Common module (NTSPCM0016H) between the inputs and the sensors:

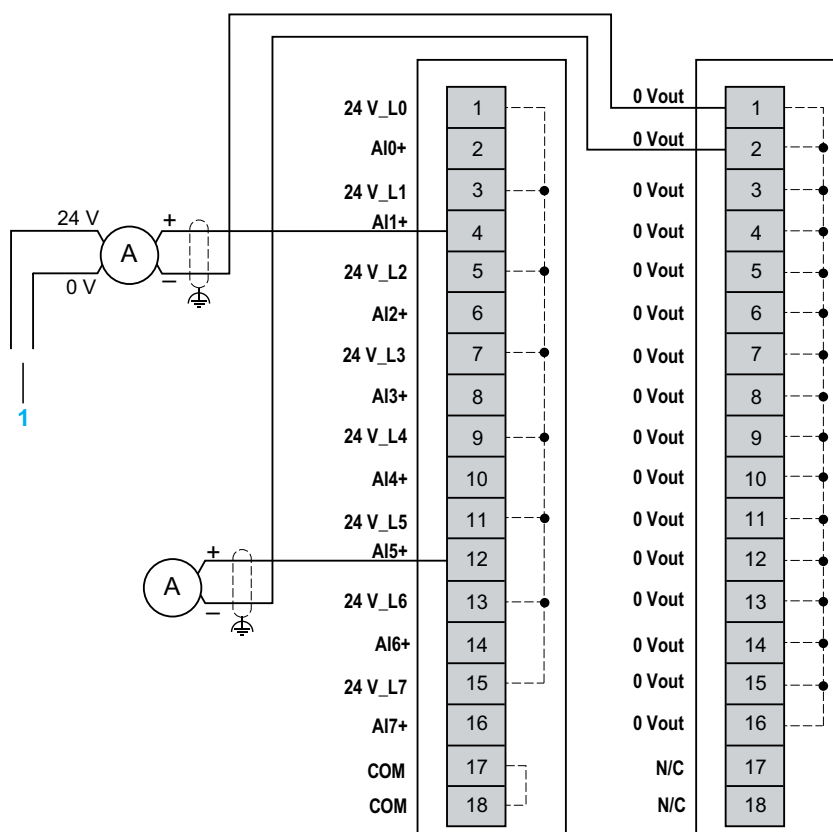

1: External supply
24 V_L•: Loop power
0 Vout: Common module output
A: Current
N/C: Not Connected

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals and/or terminals indicated as “No Connection (N/C)”.

Failure to follow these instructions can result in death, serious injury, or equipment damage.


⚠ WARNING

Do not connect wires to unused terminals and/or terminals indicated as “No Connection (N/C)”.

EIO0000005246.02

Current Measurement 2-Wire Diagram

The following figure illustrates the connection between the inputs and the sensors using two common modules (NTSPCM1600H and NTSPCM0016H):

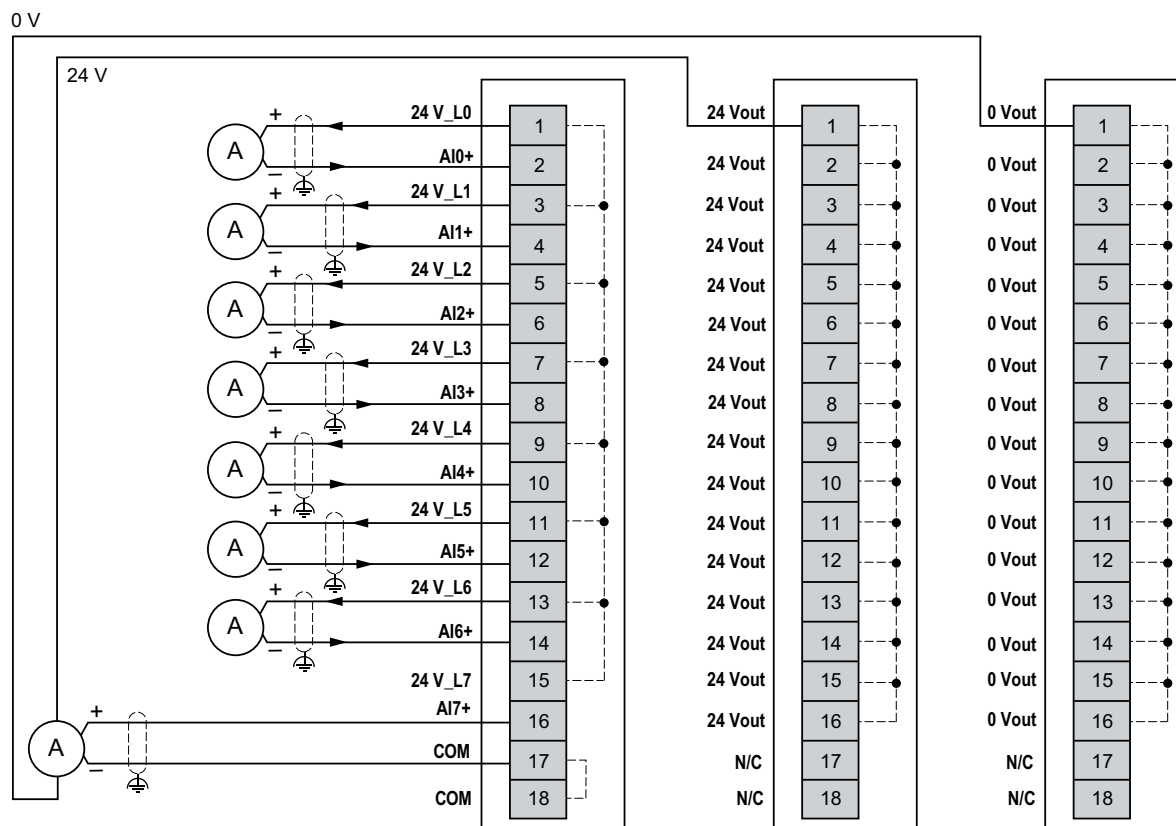

24 V_L•: Loop power
24 Vout: Common module output
0 Vout: Common module output
A: Current
N/C: Not Connected

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals and/or terminals indicated as “No Connection (N/C)”.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NTSACI0802X/NTSACI0802XH Parameters

Overview

This section describes the parameters of the NTSACI0802X/NTSACI0802XH modules.

Parameters are the set of values, specific to a module, that can be edited with the programming software during edition mode.

Software configuration is accomplished with one of the following options:

- The Edge I/O configuration software (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).
- The EcoStruxure Automation Expert software (refer to the EcoStruxure Automation Expert online help).
- The EcoStruxure Automation Expert - Motion software (refer to the EcoStruxure Automation Expert - Motion online help).
- The embedded Web interface (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).

If you have physically wired the analog channel for a voltage signal and you configure the channel for a current signal, you may damage the analog circuit.

NOTICE
INOPERABLE EQUIPMENT Verify that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel. Failure to follow these instructions can result in equipment damage.

Parameters Description

Configurable Parameters

The following table presents the configurable parameters for the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Device Mode <i>DeviceMode</i>	0: Normal * 1: Optional 2: Virtual reserved	ENUM	Allows you to select the device mode: Normal: The module is part of the software configuration and is physically connected in the cluster. Optional: The module is part of the software configuration. A dummy module or the configured module must be physically installed in the cluster. Whether either module is present does not cause a configuration error to be detected. Virtual reserved: The module is part of the software configuration. A dummy module must be physically installed in the cluster. If the virtual module is physically installed in the cluster, a configuration error is detected.
* Parameter default value			

The following table presents the configurable parameters for the channels of the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Channel Enabled <i>ChannelEnable</i>	FALSE TRUE *	BOOL	Determines whether a channel is activated or deactivated.
Range Mode <i>RangeMode</i>	+/-20 mA * 0..20 mA 4..20 mA	ENUM	Defines the range mode for the input channel. For more information on RangeMode parameter, refer to <i>RangeMode Parameters</i> , page 138.
Range Maximum <i>RangeMax</i>	-32767...32767	INT16	Sets the maximum value of the nominal range. The values are computed according to the selected RangeMode .
Range Minimum <i>RangeMin</i>	-32768...32766	INT16	Sets the minimum value of the nominal range. The values are computed according to the selected RangeMode .
HART Tolerance Enabled <i>HartToleranceEnable</i>	FALSE * TRUE	BOOL	Enables the slew rate filter to filter out HART signals on the analog current input. HartToleranceEnable parameter can be changed to TRUE when the RangeMode is set to 4..20 mA . For more information on HartToleranceEnabled parameter, refer to <i>HartToleranceEnable</i> , page 136.
NE43 Enabled <i>NE43Enable</i>	FALSE * TRUE	BOOL	Enables or disables NE43 compliance. NE43 compliance can be enabled when the RangeMode is set to 4..20 mA . When NE43 Enabled is set to TRUE , the threshold values (Underflow Threshold/Overflow Threshold) are not configurable, the fixed threshold values are 3.6 mA / 21 mA.
Overflow Checked <i>OverflowCheck</i>	FALSE TRUE *	BOOL	Enables or disables overflow detection. An error is detected if the measurement is greater than Overflow Threshold . For more information on OverflowChecked parameter, refer to <i>Overflowcheck/Underflowcheck</i> , page 141.
Overflow Threshold <i>OverMax</i>	-32767...32767	INT16	Sets the overflow threshold value. The values are computed according to the selected RangeMax value.

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Underflow Checked <i>UnderflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables underflow detection. An error is detected if the measurement is lower than Underflow Threshold . For more information on UnderflowChecked parameter, refer to <i>Overflowcheck/Underflowcheck</i> , page 141.
Underflow Threshold <i>OverMin</i>	-32768...32766	INT16	Sets the underflow threshold value. The values are computed according to the selected RangeMin value.
Alignment Offset <i>AlignmentOffset⁽¹⁾</i>	-1500...1500	INT16	Compensates for a permanent offset observed with a given sensor, around a specific operating point. This operation compensates for an offset linked to the process. Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment. For more information on AlignmentOffset parameter, refer to <i>Alignment Offset</i> , page 138.
Filter <i>Filter⁽¹⁾</i>	No filtering: 0* Low filtering: 1 2 Medium filtering: 3 4 High filtering: 5 6	ENUM	Defines the type of filtering for the input channel selected for the analog modules. For more information on Filter parameter, refer to <i>Measurement Filter</i> , page 137.
* Parameter default value ⁽¹⁾ Online modification is allowed.			

Implicit Data

The following table presents the input implicit data for the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
GCS	0...255	BYTE 1	Group Cyclic Status Bit 0: Data quality Bit 1: General module status Bit 2: I/O status Bit 3: N/A Bit 4: N/A Bit 5: Advisory status Bit 6: N/A Bit 7: Data freshness NOTE: For more information, refer to Modicon Edge I/O - Diagnostic Data - User Guide.
ChannelHealth0_7 ⁽¹⁾	0...255	BYTE 1	Bit 0...7 = Status of channel 0...7 - Bit = FALSE: Channel is invalid or not present. - Bit = TRUE: Channel is valid or disabled.
⁽¹⁾ This parameter is not part of the implicit data if the optimized I/O profile is selected.			

The following table presents the input implicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
IValue	-32,768... 32,767	INT16 2	Value of the input channel.

Explicit Data

The following table presents the explicit data for the channels of the module:

<i>Parameter Name</i>	<i>Value(s)</i>	Data type Size in bytes	Description
<i>ChannelFault1</i>	0...255	BYTE 1	Indicates module channel error catalog. Bit 0: Underflow error detected Bit 1: Overflow error detected Bit 2: Broken wire error detected Bit 3: N/A Bit 4: Hardware error detected Bit 5: Calibration error detected Bit 6: Loop power supply error detected Bit 7: N/A
<i>ChannelFault2</i>	0...255	BYTE 1	Bit 7: Power supply error detected NOTE: Bits 0 to 6 are reserved.
<i>MeasureStatus1</i>	0...255	BYTE 1	Bit 0: Lower tolerance alert Bit 1: Upper tolerance alert Bit 2: Non-zero alignment offset configured Bit 3: Channel enabled configured NOTE: Bits 4 to 7 are reserved.
<i>MeasureStatus2</i>	0...255	BYTE 1	Bits 0 to 7 are reserved.

Temperature Input Modules

What's in This Part

NTSART0603 Temperature Input Module, 6 Differential Inputs, RTD, Thermistor, 2-/3-wire	94
---	----

NTSART0603 Temperature Input Module, 6 Differential Inputs, RTD, Thermistor, 2-/3-wire

What’s in This Chapter

NTSART0603 Presentation	94
NTSART0603 Characteristics	98
NTSART0603 Wiring	102
NTSART0603 Parameters	103

NTSART0603 Presentation

Overview

This section provides a presentation of the NTSART0603 input module.


Main Characteristics

The following table describes the main characteristics of the NTSART0603 input module:

Main Characteristics	Value
Product or component type	Analog RTD and thermistor input module
Number of channels	6
Channel property	Not isolated
Channel signal	RTD, resistive and thermistor inputs
Operating mode	Asynchronous

Purchasing Information

The following figure shows the elements of the Modicon Edge I/O NTS NTSART0603 input module:

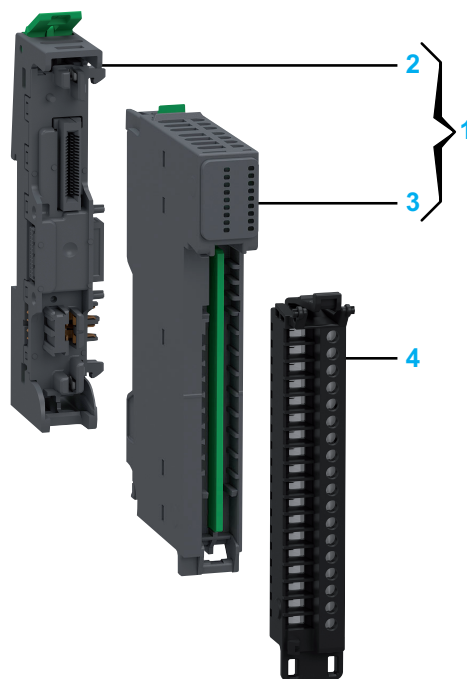


Number	Reference	Description
1	NTSART0603K	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXBA0100H	Spare Base, 1 Slot, for Input/Output Common or Expert Module, Hardened
3	NTSART0603	Temperature Input Module, 6 Differential Inputs, RTD, Thermistor, 2-/3-wire
4	NTSXTB18200H NTSXTB18201H NTSXTB18000H NTSXTB18001H	Spring Terminal Block, 18 Points, 3.81 mm Pitch, Without Cover, use on Low Height Module, Hardened Spring Terminal Block, 18 Points, 3.81 mm Pitch, With Cover, use on Low Height Module, Hardened Screw Terminal Block, 18 Points, 3.81 mm Pitch, Without Cover, use on Low Height Module, Hardened Screw Terminal Block, 18 Points, 3.81 mm Pitch, With Cover, use on Low Height Module, Hardened NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

Physical Description


The following figure presents the elements of the module:

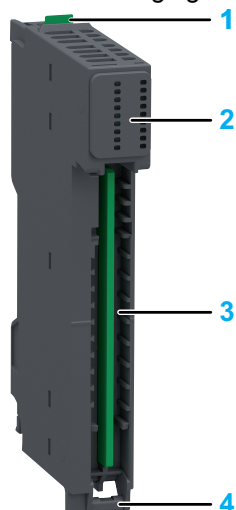

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

Status LEDs


The following figure presents the NTSART0603 status LEDs:



The following table describes the status of LEDs:

R (Green)	E (Red)	Channel (Green)	Description
Initialization and non-operational states			
OFF	OFF	OFF	Indicates that the module is not energized.
OFF	Fast Flash	-	Indicates that the module has detected a system error.
Regular Flash	OFF	-	Indicates that the firmware is being updated.
Regular Flash	ON	-	Indicates that a module mismatch is detected.
Single Flash	OFF	-	Indicates that the module is energized and not configured.
Operational state			
ON	OFF	-	Indicates that the module is energized, configured and operational.
ON	-	ON	Indicates that the channel is activated.
ON	-	OFF	Indicates that the channel is deactivated.
ON	Single Flash	-	Indicates an advisory detection.
ON	Single Flash	Single Flash	Indicates: - Lower tolerance advisory detection. - Upper tolerance advisory detection.
ON	Regular Flash	OFF	Indicates that an error is detected in the 24 Vdc field power.
ON	Regular Flash	Regular Flash	Indicates: - Broken wire detection. - Overflow/underflow error detection.
ON	Regular Flash	OFF	Indicates an internal error detection.

The following graphic shows the system status of LEDs during module operation:

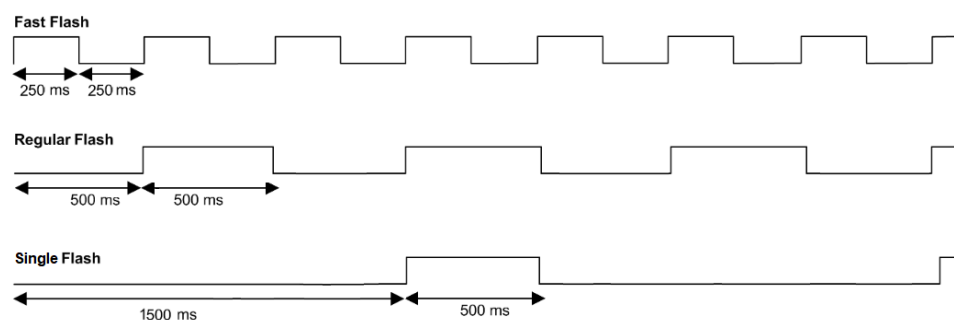

NTSART0603 Characteristics

Overview

This section provides a general description of the characteristics of the module.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION


Do not exceed any of the rated values specified in the environmental and electrical characteristics tables.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

For more information on environmental characteristics, refer to Modicon Edge I/O - System Planning and Installation Guide.

Dimensions

The following figure presents the external dimensions of the assembled module:

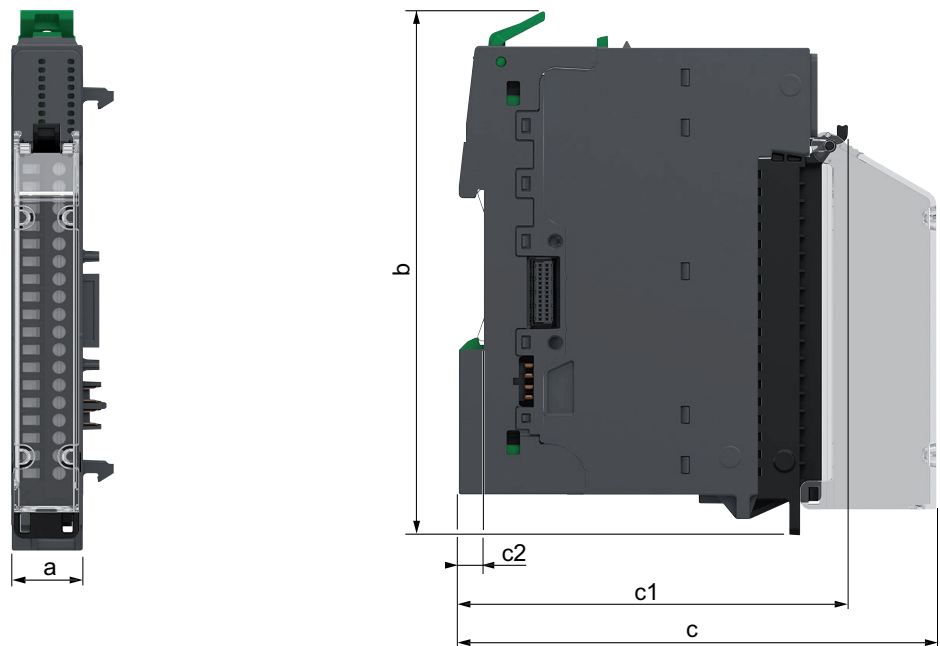

- a**: 15 mm (0.59 in)
- b**: 116.6 mm (4.57 in)
- c**: 107.5 mm (4.21 in)
- c1**: 88.2 mm (3.46 in)
- c2**: 5.6 mm (0.2 in)

Weight

- NTSART0603: 48 g (1.69 oz)
- NTSART0603K: 73 g (2.58 oz)

General Characteristics

The following table shows the general characteristics of the NTSART0603 input module:

Characteristics		Value
Rated supplied voltage		24 Vdc
Power supplied voltage range		20.4...28.8 Vdc
Isolation	Between channels	No
	Between channels and bus	1,500 Vac
	Between channels and field power	1,000 Vac
	Between field power and bus	1,500 Vac
Protection and detection		Protection: Miswiring protection by channel Detection: • Module: ◦ Field power from the power supply module - Input: ◦ Interrupted wire on RTD/Resistance/Thermistor input by channel
Power dissipation		1.59 W

Input Characteristics

The following table describes the input characteristics of the NTSART0603 input module:

Characteristics		Value
Input type		Differential
Logic type		Temperature input
Wiring type sensor connection		2/3 wires for RTD and Resistance. 2-wire for thermistor NTC / PTC
Input range		Resistance: 150 Ω / 300 Ω / 600 Ω / 2,000 Ω / 32 k Ω
		RTD: Ni100/1000, PT100/1000, Cu10/50/100, JPt100/JPt1000, High precision Cu10/Cu50/ Cu100/Ni100/Ni1,000/PT100/PT1000
		Thermistor: PTC: 100 Ω to 10 k Ω NTC: 100 Ω to 200 k Ω , or calculated temperature -90 to 150 $^{\circ}\text{C}$ (-130 to 302 $^{\circ}\text{F}$)
Input impedance		10 M Ω Typical
Resolution		Resistance: 0.0048 Ω on 150 Ω 0.0096 Ω on 300 Ω 0.019 Ω on 600 Ω 0.064 Ω on 2,000 Ω 1 Ω on 32,000 Ω
		RTD: 0.1 $^{\circ}\text{C}$ (32.18 $^{\circ}\text{F}$) in standard mode 0.01 $^{\circ}\text{C}$ (32.018 $^{\circ}\text{F}$) in high precision mode
		Thermistor: - PTC: 1 Ω - NTC: 1 Ω
Maximum accuracy at ambient 25 $^{\circ}\text{C}$ (77 $^{\circ}\text{F}$) / 60 $^{\circ}\text{C}$ (140 $^{\circ}\text{F}$)		Resistance: - For short time sampling: 0.08 % / 0.15 % - For long time sampling: 0.05 % / 0.12 %
		RTD: - For short time sampling: 0.8 $^{\circ}\text{C}$ (33.44 $^{\circ}\text{F}$) / 1.5 $^{\circ}\text{C}$ (34.7 $^{\circ}\text{F}$) in standard mode except Cu10 0.50 $^{\circ}\text{C}$ (32.9 $^{\circ}\text{F}$) / 0.80 $^{\circ}\text{C}$ (33.44 $^{\circ}\text{F}$) in high precision RTD mode 2 $^{\circ}\text{C}$ (35.6 $^{\circ}\text{F}$) / 2.6 $^{\circ}\text{C}$ (36.68 $^{\circ}\text{F}$) in Cu10 mode - For long time sampling: 0.5 $^{\circ}\text{C}$ (32.9 $^{\circ}\text{F}$) / 1.2 $^{\circ}\text{C}$ (34.16 $^{\circ}\text{F}$) in standard mode except Cu10 0.30 $^{\circ}\text{C}$ (32.54 $^{\circ}\text{F}$) / 0.60 $^{\circ}\text{C}$ (33.08 $^{\circ}\text{F}$) in high precision RTD mode 1 $^{\circ}\text{C}$ (33.8 $^{\circ}\text{F}$) / 1.8 $^{\circ}\text{C}$ (35.24 $^{\circ}\text{F}$) in Cu10 mode
		Thermistor: - For short time sampling: 0.2 % / 0.4 % - For long time sampling: 0.15 % / 0.35 %
Channel switching time	Fast sampling disabled (by default)	140 ms
	Fast sampling enabled	40 ms
Input response time		At 50 Hz rejection: 60 ms + Channel switch time At 60 Hz rejection: 50 ms + Channel switch time
Conversion mode		Sigma-Delta

Characteristics		Value
Maximum allowable input no damage		Overvoltage protection Maximum 30 Vdc no damage
Input filter		Cutoff frequency 50 Hz / 60 Hz Software run-time configurable filter. Refer to Measurement Filter, page 137.
Temperature drift		Within 0.003 %/°C of full scale
Repeatability after stabilization time		0.05 % of full scale
Nonlinearity		Voltage/Resistor input: 0.01 % of full scale Thermistor / RTD: 0.01 % of full scale
Differential mode rejection (50/60 Hz)		60 dB
Common mode rejection (50/60 Hz)		100 dB
Crosstalk		50 dB
Maximum input range		Voltage: over/under range margins: ± 2.4 %
Cable	Type	Shielded
	Length	200 m (656 ft) maximum

NTSART0603 Wiring

Overview


This section provides the wiring diagram for the NTSART0603 input module.

Wiring Rules

For more information on the wiring, refer to Modicon Edge I/O - System Planning and Installation Guide.

Wiring Diagram

The following figure illustrates the connection between the inputs and the sensors:

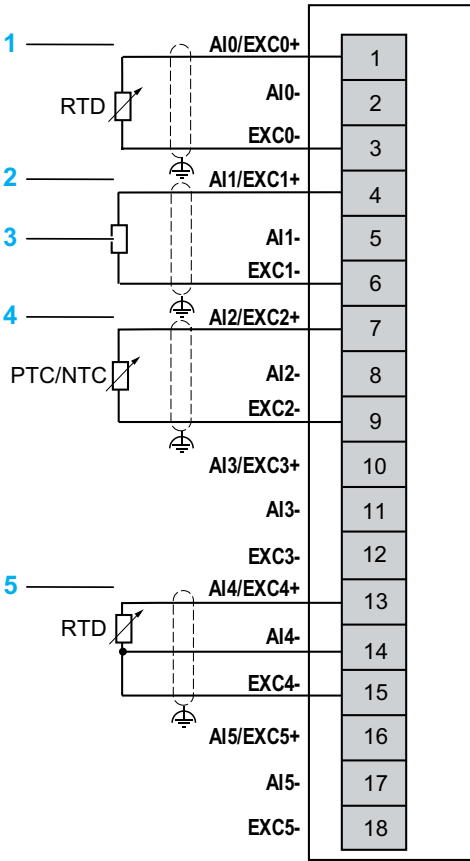

- 1, 2, 4: 2-wire connection
- 3: Resistance
- 5: 3-wire connection

NTSART0603 Parameters

Overview

This section describes the parameters of the NTSART0603 module.

Parameters are the set of values, specific to a module, that can be edited with the programming software during edition mode.

Software configuration is accomplished with one of the following options:

- The Edge I/O configuration software (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).
- The EcoStruxure Automation Expert software (refer to the [EcoStruxure Automation Expert online help](#)).
- The EcoStruxure Automation Expert - Motion software (refer to the [EcoStruxure Automation Expert - Motion online help](#)).
- The embedded Web interface (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).

Parameters Description

If you have physically wired the analog channel for a voltage signal and you configure the channel for a current signal, you may damage the analog circuit.

NOTICE

INOPERABLE EQUIPMENT

Verify that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel.

Failure to follow these instructions can result in equipment damage.

Configurable Parameters

The following table presents the configurable parameters for the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Device Mode <i>DeviceMode</i>	0: Normal * 1: Optional 2: Virtual reserved	ENUM	Allows you to select the device mode: Normal: The module is part of the software configuration and is physically connected in the cluster. Optional: The module is part of the software configuration. A dummy module or the configured module must be physically installed in the cluster. Whether either module is present does not cause a configuration error to be detected. Virtual reserved: The module is part of the software configuration. A dummy module must be physically installed in the cluster. If the virtual module is physically installed in the cluster, a configuration error is detected.
Frequency Rejection <i>Frequency Rejection</i>	50 Hz* 60 Hz	ENUM	Selects Frequency Rejection . Depending on the country, you can configure the frequency rejection of main power harmonics by adapting the speed of sigma delta converter.
* Parameter default value			

The following table presents the configurable parameters for the channels of the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Channel Enabled <i>ChannelEnable</i>	FALSE TRUE*	BOOL	Determines whether a channel is activated or deactivated.
Range Mode <i>RangeMode</i>	RTD Ni100 RTD Ni1000 RTD PT100 RTD JPt100 RTD PT1000 RTD JPt1000 RTD Cu10 RTD Cu50 RTD Cu100 Resistance Sensors Thermistor Sensors	ENUM	Defines the range mode for the input channel. The module is 2/3-wire type sensor connection for RTD and resistance and is a 2-wire type sensor connection for thermistor NTC / PTC. For more information on RangeMode parameter, refer to RangeMode Parameters , page 138.

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Range Maximum <i>RangeMax</i>	Resistance: 1..32000 Others: -31999..32000	INT16	Sets the high threshold value of the normal range. The values are computed according to the selected RangeMode .
Range Minimum <i>RangeMin</i>	Resistance: 0..31999 Others: -32000..31999	INT16	Sets the low threshold value of the normal range. The values are computed according to the selected RangeMode .
Overflow Checked <i>OverflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables overflow detection. An error is detected if the measurement is greater than Overflow Threshold . You can only configure low threshold and high threshold setting. The Overflow setting is calculated based on high threshold and low threshold settings. For more information on OverflowChecked parameter, refer to Overflowcheck/Underflowcheck, page 141.
Overflow Threshold <i>OverMax</i>	-31999..32000	INT16	Overflow threshold value setting for configured range mode. The values are computed according to the selected RangeMax value.
Underflow Checked <i>UnderflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables underflow detection. An error is detected if the measurement is lower than Underflow Threshold . You can only configure low threshold and high threshold setting. The Underflow setting is calculated based on high threshold and low threshold settings. For more information on UnderflowChecked parameter, refer to Overflowcheck/Underflowcheck, page 141.
Underflow Threshold <i>OverMin</i>	-32000..31999	INT16	Underflow threshold value setting for configured range mode. The values are computed according to the selected RangeMin value.
Broken Wire Checked <i>BrokenWireCheck⁽¹⁾</i>	FALSE TRUE*	BOOL	Enables or disables interrupted wire detection. If RangeMode is voltage mode, it does not support BrokenWireCheck .
Temperature Unit <i>TemperatureUnit</i>	Celsius* Fahrenheit Kelvin	ENUM	Selects the temperature unit (°C / °F / K). This parameter is used for TC or RTD sensor input.
High resolution enabled <i>HighRtd</i>	FALSE* TRUE	BOOL	Enables or disables RTD High Resolution. When RTD High Resolution Mode is enabled, the code display for RTD type is set to 1/100 °C\°F\K, otherwise it is set to 1/10 °C\°F\K.
Fast Sampling Enabled <i>ShortSamplingTime</i>	FALSE* TRUE	BOOL	Enables or disables Fast Sampling. When Fast Sampling Mode is enabled, the sampling time is set to 100 ms. otherwise it is set to 200 ms.
Alignment Offset <i>AlignmentOffset⁽¹⁾</i>	-1500..1500	INT16	Compensates for a permanent offset observed with a given sensor, around a specific operating point. This operation compensates for an offset linked to the process. Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment. For more information on AlignmentOffset parameter, refer to Alignment Offset, page 138.

Displayed Name Parameter Name	Value(s)	Data type	Description
Filter <i>Filter</i> ⁽¹⁾	No filtering: 0* Low filtering: 1 2 Medium filtering: 3 4 High filtering: 5 6	ENUM	Defines the type of filtering for the input channel selected for the analog modules. For more information on Filter parameter, refer to Measurement Filter , page 137.
* Parameter default value ⁽¹⁾ Online modification is allowed.			

Implicit Data

The following table presents the input implicit data for the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
GCS	0...255	BYTE 1	Group Cyclic Status Bit 0: Data quality Bit 1: General module status Bit 2: I/O status Bit 3: N/A Bit 4: N/A Bit 5: Advisory status Bit 6: N/A Bit 7: Data freshness NOTE: For more information, refer to Modicon Edge I/O - Diagnostic Data - User Guide .
<i>ChannelHealth0_7</i> ⁽¹⁾	0...255	BYTE 1	Bit 0...7 = Status of channel 0...7 - Bit = FALSE: Channel is invalid or not present. - Bit = TRUE: Channel is valid or disabled.
⁽¹⁾ This parameter is not part of the implicit data if the optimized I/O profile is selected.			

The following table presents the input implicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
<i>IValue</i>	-32,768... 32,767	INT16 2	Value of the input channel.

Explicit Data

The following table presents the explicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
<i>ChannelFault1</i>	0...255	BYTE 1	Indicates module channel error catalog. Bit 0: Underflow error detected Bit 1: Overflow error detected Bit 2: Broken wire error detected Bit 3: N/A Bit 4: Hardware error detected Bit 5: Calibration error detected Bit 6: N/A Bit 7: N/A
<i>ChannelFault2</i>	0...255	BYTE 1	Bit 7: Power supply error detected NOTE: Bits 0 to 6 are reserved.
<i>MeasureStatus1</i>	0...255	BYTE 1	Bit 0: Lower tolerance alert Bit 1: Upper tolerance alert Bit 2: Non-zero alignment offset configured Bit 3: Channel enabled configured NOTE: Bits 4 to 7 are reserved.
<i>MeasureStatus2</i>	0...255	BYTE 1	Bits 0 to 7 are reserved.

Analog Output Modules

What’s in This Part

NTSAMO0210/NTSAMO0210H Analog Output Module, 2 Isolated Outputs,
Current, Voltage, Standard/Hardened 109

NTSAMO0400/NTSAMO0400H Analog Output Module, 4 Outputs, Current,
Voltage, Standard/Hardened 122

NTSAMO0210/NTSAMO0210H Analog Output Module, 2 Isolated Outputs, Current, Voltage, Standard/Hardened

What's in This Chapter

NTSAMO0210/NTSAMO0210H Presentation	109
NTSAMO0210/NTSAMO0210H Characteristics	113
NTSAMO0210/NTSAMO0210H Wiring	116
NTSAMO0210/NTSAMO0210H Parameters	117

NTSAMO0210/NTSAMO0210H Presentation

Overview

This section provides a presentation of the NTSAMO0210/NTSAMO0210H output modules.


Main Characteristics

The following table describes the main characteristics of the NTSAMO0210/NTSAMO0210H output modules:

Main Characteristics	Value
Product or component type	Analog current and voltage output module
Number of channels	2
Channel property	Channel isolated
Channel signal	Current or voltage
Operating mode	Synchronous, isochronous and asynchronous

Purchasing Information

The following figure shows the elements of the Modicon Edge I/O NTS NTSAMO0210/NTSAMO0210H output modules:

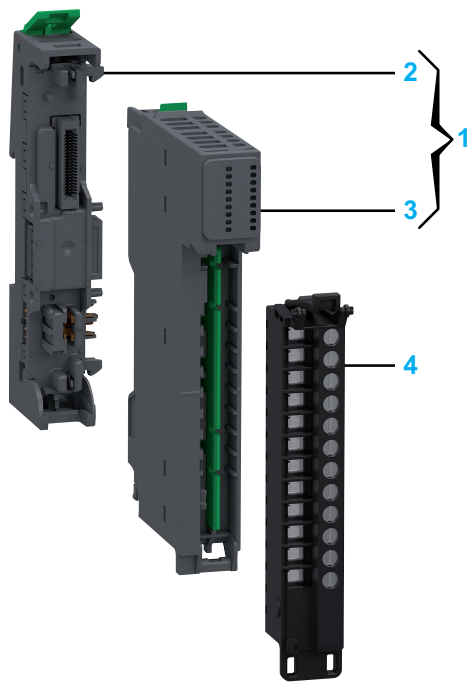


Number	Reference	Description
1	NTSAMO0210K NTSAMO0210HK	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXB0100H	Spare Base, 1 Slot, for Input/Output Common or Expert Module, Hardened
3	NTSAMO0210 NTSAMO0210H	Analog Output Module, 2 Isolated Outputs, Current, Voltage Analog Output Module, 2 Isolated Outputs, Current, Voltage, Hardened
4	NTSXTB12200H NTSXTB12201H NTSXTB12000H NTSXTB12001H	Spring Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Spring Terminal Block, 12 Points, 5 mm Pitch, With Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened Screw Terminal Block, 12 Points, 5 mm Pitch, With cover, use on Low Height Module, Hardened NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

Physical Description


The following figure presents the elements of the module:

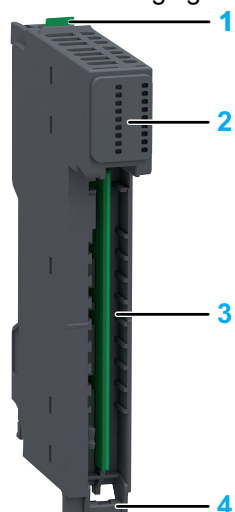

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

Status LEDs


The following figure presents the NTSAMO0210/NTSAMO0210H status LEDs:



The following table describes the status of LEDs:

R (Green)	E (Red)	Channel (Green)	Description
Initialization and non-operational states			
OFF	OFF	OFF	Indicates that the module is not energized.
OFF	Fast Flash	-	Indicates that the module has detected a system error.
Regular Flash	OFF	-	Indicates that the firmware is being updated.
Regular Flash	ON	-	Indicates that a module mismatch is detected.
Single Flash	OFF	-	Indicates that the module is energized and not configured.
Operational state			
ON	OFF	-	Indicates that the module is energized, configured and operational.
ON	-	ON	Indicates that the channel is activated.
ON	-	OFF	Indicates that the channel is deactivated.
ON	Single Flash	-	Indicates an advisory detection.
ON	Single Flash	Single Flash	Indicates: • Lower tolerance advisory detection. • Upper tolerance advisory detection.
ON	Regular Flash	OFF	Indicates that an error is detected in the 24 Vdc field power.
ON	Regular Flash	-	Module in fallback state.
ON	Regular Flash	Regular Flash	Indicates: • Broken wire detection. • Short circuit detection. • Overflow/underflow error detection. • DAC power error detection.
ON	Regular Flash	OFF	Indicates an internal error detection.

The following graphic shows the system status of LEDs during module operation:

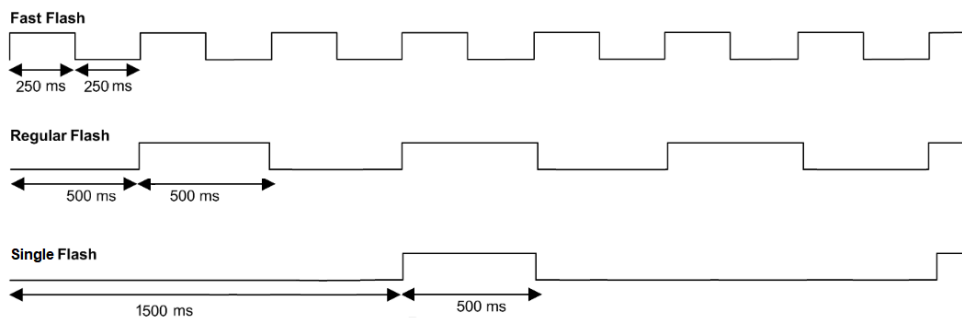

NTSAMO0210/NTSAMO0210H Characteristics

Overview

This section provides a general description of the characteristics of the module.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION


Do not exceed any of the rated values specified in the environmental and electrical characteristics tables.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

For more information on environmental characteristics, refer to Modicon Edge I/O - System Planning and Installation Guide.

Dimensions

The following figure presents the external dimensions of the assembled module:

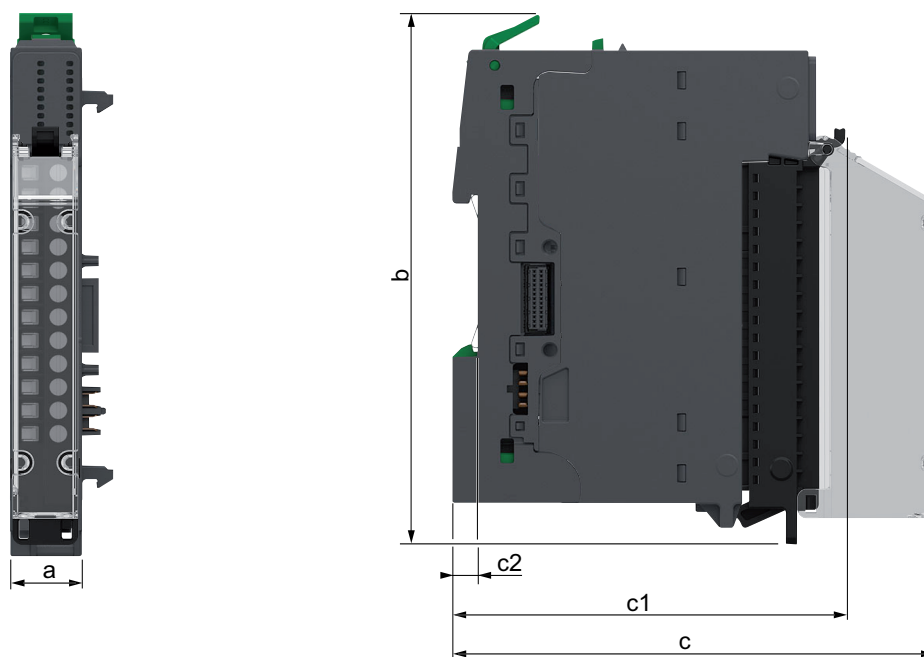

- a:** 15 mm (0.59 in)
- b:** 116.6 mm (4.57 in)
- c:** 107.5 mm (4.21 in)
- c1:** 88.2 mm (3.46 in)
- c2:** 5.6 mm (0.2 in)

Weight

- NTSAMO0210/NTSAMO0210H: 48 g (1.69 oz)
- NTSAMO0210K/NTSAMO0210HK: 73 g (2.58 oz)

General Characteristics

The following table shows the general characteristics of the NTSAM00210/
NTSAM00210H output modules:

Characteristics		Value
Rated power supply voltage		24 Vdc
Power supply range		20.4...28.8 Vdc
Isolation	Between channels	530 Vac
	Between channels and bus	1500 Vac
	Between channels and field power	1000 Vac
	Between field power and bus	1500 Vac
Protection and detection		Overcurrent on voltage output Interrupted wire on current output
Power dissipation		1.16 W

Output Characteristics

The following table describes the output characteristics of the NTSAM00210/NTSAM00210H output modules:

Characteristics		Value
Output type		Single end/Differential
Logic type		High level output
Wiring type connection		2/3/4 wires to actuator (3-wire with +Vsense or, 4-wire with $\pm$ Vsense)
Output range		± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc ± 20 mA 0...20 mA 4...20 mA
Load impedance		Voltage output: 1 K Ω minimum Current output: 750 Ω maximum
Resolution		16 bits, or 15 bits plus sign bit: ± 10 Vdc, ± 5 Vdc, ± 20 mA 15 bits: 0...10 Vdc, 0...5 Vdc, 1...5 Vdc, 0...20 mA, 4...20 mA
Maximum accuracy at ambient 25 °C (77 ° F) / maximum allowed temperature		0.1 % / 0.2 % of full scale
Response time		500 μ s at 600 Ω
Maximum allowable output no damage		30 Vdc
Temperature drift		0.002 %/°C of full scale
Repeatability after stabilization time		0.03 % of full scale
Nonlinearity		0.02 % of full scale
Cable	Type	Shielded
	Length	Voltage output: 200 m (656 ft) Current output: 1,000 m (3280 ft)

NTSAMO0210/NTSAMO0210H Wiring

Overview


This section provides the wiring diagrams for the NTSAMO0210/NTSAMO0210H output modules.

Wiring Rules


For more information on the wiring, refer to Modicon Edge I/O - System Planning and Installation Guide.

Wiring Diagrams

The following figures illustrate the connection between the inputs and the sensors:

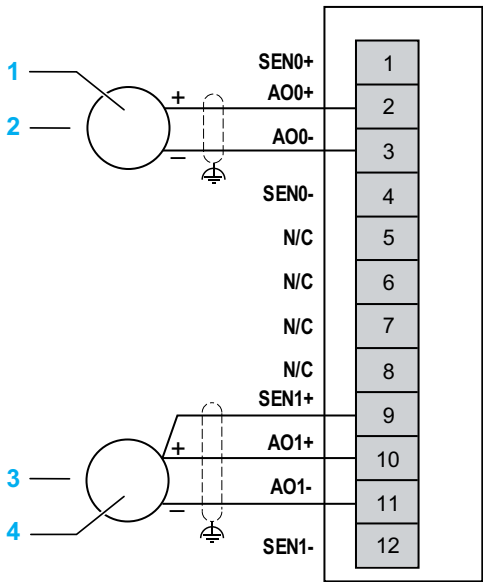

1, 4: Actuator
2: 2-wire connection for voltage/current output
3: 3-wire connection for voltage output
SEN•+ : Sensor sense line positive
SEN•- : Sensor sense line negative
N/C: Not Connected

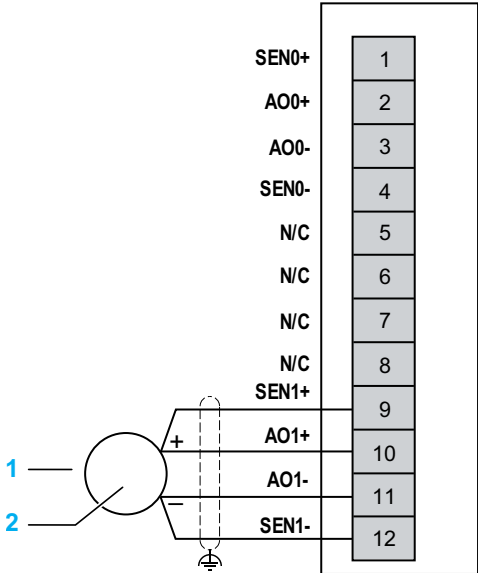

1: 4-wire connection for voltage output
2: Actuator
SEN•+ : Sensor sense line positive
SEN•- : Sensor sense line negative
N/C: Not Connected

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals and/or terminals indicated as “No Connection (N/C)”.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NOTE: The sensor sense line connections are used to compensate the voltage drop over long distances.

NTSAMO0210/NTSAMO0210H Parameters

Overview

This section describes the parameters of the NTSAMO0210/NTSAMO0210H modules.

Parameters are the set of values, specific to a module, that can be edited with the programming software during edition mode.

Software configuration is accomplished with one of the following options:

- The Edge I/O configuration software (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).
- The EcoStruxure Automation Expert software (refer to the [EcoStruxure Automation Expert online help](#)).
- The EcoStruxure Automation Expert - Motion software (refer to the [EcoStruxure Automation Expert - Motion online help](#)).
- The embedded Web interface (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).

Parameters Description

If you have physically wired the analog channel for a voltage signal and you configure the channel for a current signal, you may damage the analog circuit.

NOTICE

INOPERABLE EQUIPMENT

Verify that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel.

Failure to follow these instructions can result in equipment damage.

Configurable Parameters

The following table presents the configurable parameters for the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Device Mode <i>DeviceMode</i>	0: Normal * 1: Optional 2: Virtual reserved	ENUM	Allows you to select the device mode: Normal: The module is part of the software configuration and is physically connected in the cluster. Optional: The module is part of the software configuration. A dummy module or the configured module must be physically installed in the cluster. Whether either module is present does not cause a configuration error to be detected. Virtual reserved: The module is part of the software configuration. A dummy module must be physically installed in the cluster. If the virtual module is physically installed in the cluster, a configuration error is detected.
* Parameter default value			

The following table presents the configurable parameters for the channels of the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Channel Enabled <i>ChannelEnable</i>	FALSE TRUE *	BOOL	Determines whether a channel is activated or deactivated.
Range Mode <i>RangeMode</i>	+/-10 V * 0..10 V +/-5 V 0..5 V 1..5 V +/-20 mA 0..20 mA 4..20 mA	ENUM	Defines the range mode for the output channel. For more information on RangeMode parameter, refer to <i>RangeMode Parameters</i> , page 138.
Range Minimum <i>RangeMin</i>	-32767...32767	INT16	Sets the low threshold value of the normal range. The values are computed according to the selected RangeMode .
Range Maximum <i>RangeMax</i>	-32768...32766	INT16	Sets the high threshold value of the normal range. The values are computed according to the selected RangeMode .
Fallback Mode <i>OutputFallBackMode</i>	Predefined Fallback Value * Maintain	ENUM	Chooses the output Fallback mode function.

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Predefined Fallback Value <i>OutputFallbackValue</i>	-32768...32767	INT16	Sets the value of the predefined Fallback value.
Hart Tolerance Enabled <i>HartToleranceEnable</i>	FALSE* TRUE	BOOL	Enables the slew rate filter on the analog current output. For analog output modules, this function is achieved by setting DAC output slew rate. Current output does not affect original HART signal in current loop, it slows the output slew rate. HartToleranceEnable parameter can be changed to TRUE when the RangeMode is set to 4..20mA. For more information on HartToleranceEnabled parameter, refer to HartToleranceEnable, page 136.
Overflow Checked <i>OverflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables overflow detection. An error is detected if the measurement is greater than Overflow Threshold. For more information on OverflowChecked parameter, refer to Overflowcheck/Underflowcheck, page 141.
Overflow Threshold <i>OverMax</i>	-32767...32767	INT16	Sets the overflow threshold value. The values are computed according to the selected RangeMax value.
Underflow Checked <i>UnderflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables underflow detection. An error is detected if the measurement is lower than Underflow Threshold. For more information on UnderflowChecked parameter, refer to Overflowcheck/Underflowcheck, page 141.
Underflow Threshold <i>OverMin</i>	-32768...32766	INT16	Sets the underflow threshold value. The values are computed according to the selected RangeMin value.
Shorted Wire Checked <i>ShortedWireCheck</i>	FALSE TRUE*	BOOL	Enables or disables shorted wire detection on voltage output.
Broken Wire Checked <i>BrokenWireCheck⁽¹⁾</i>	FALSE TRUE*	BOOL	Enables or disables interrupted wire detection on current output.
AlignmentOffset <i>AlignmentOffset⁽¹⁾</i>	-1500...1500	INT16	Compensates for a permanent offset observed with a given sensor, around a specific operating point. This operation compensates for an offset linked to the process. Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment. For more information on AlignmentOffset parameter, refer to Alignment Offset, page 138.
* Parameter default value			
⁽¹⁾ Online modification is allowed.			

Implicit Data

The following table presents the input implicit data for the module:

<i>Parameter Name</i>	<i>Value(s)</i>	<i>Data type</i> <i>Size in bytes</i>	<i>Description</i>
GCS	0...255	BYTE 1	Group Cyclic Status Bit 0: Data quality Bit 1: General module status Bit 2: I/O status Bit 3: Receive status Bit 4: Output status Bit 5: Advisory status Bit 6: N/A Bit 7: Data freshness NOTE: For more information, refer to Modicon Edge I/O - Diagnostic Data - User Guide.
ChannelHealth0_7 ⁽¹⁾	0...255	BYTE 1	Bit 0...7 = Status of channel 0...7 - Bit = FALSE: Channel is invalid or not present. - Bit = TRUE: Channel is valid or disabled.
⁽¹⁾ This parameter is not part of the implicit data if the optimized I/O profile is selected.			

The following table presents the output implicit data for the channels of the module:

<i>Parameter Name</i>	<i>Value(s)</i>	<i>Data type</i> <i>Size in bytes</i>	<i>Description</i>
QValue	-32,768... 32,767	INT16 2	Value of the output channel.

Explicit Data

The following table presents the explicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
<i>ChannelFault1</i>	0...255	BYTE 1	Indicates module channel error catalog. Bit 0: Underflow error detected Bit 1: Overflow error detected Bit 2: Broken wire error detected Bit 3: Short circuit error detected Bit 4: Hardware error detected Bit 5: Calibration error detected Bit 6: N/A Bit 7: N/A
<i>ChannelFault2</i>	0...255	BYTE 1	Bit 0: DAC power error detected Bit 7: Power supply error detected NOTE: Bits 1 to 6 are reserved.
<i>MeasureStatus1</i>	0...255	BYTE 1	Bit 0: N/A Bit 1: N/A Bit 2: Non-zero alignment offset configured Bit 3: Channel enabled configured NOTE: Bits 4 to 7 are reserved.
<i>MeasureStatus2</i>	0...255	BYTE 1	Bits 0 to 7 are reserved.

NTSAMO0400/NTSAMO0400H Analog Output Module, 4 Outputs, Current, Voltage, Standard/Hardened

What’s in This Chapter

NTSAMO0400/NTSAMO0400H Presentation 122

NTSAMO0400/NTSAMO0400H Characteristics 126

NTSAMO0400/NTSAMO0400H Wiring 129

NTSAMO0400/NTSAMO0400H Parameters 130

NTSAMO0400/NTSAMO0400H Presentation

Overview

This section provides a presentation of the NTSAMO0400/NTSAMO0400H output modules.


Main Characteristics

The following table describes the main characteristics of the NTSAMO0400/NTSAMO0400H output modules:

Main Characteristics	Value
Product or component type	Analog current and voltage output module
Number of channels	4
Channel property	Single-ended
Channel signal	Current or voltage
Operating mode	Isochronous and asynchronous

Purchasing Information

The following figure shows the elements of the Modicon Edge I/O NTS NTSAMO0400/NTSAMO0400H output modules:

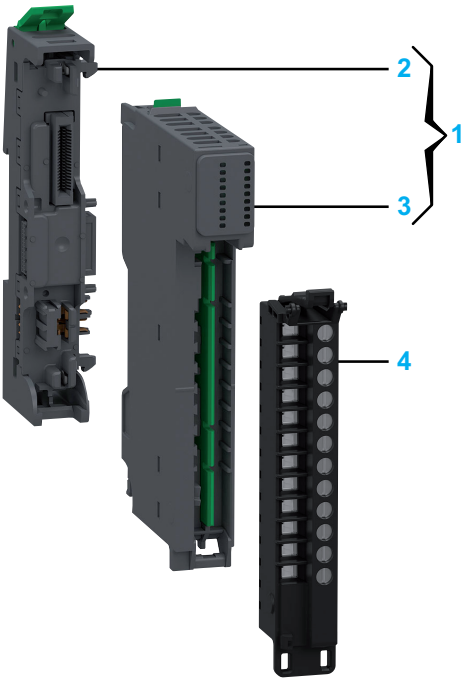


Number	Reference	Description
1	NTSAMO0400K NTSAMO0400HK	Base + Module (kit) NOTE: The module and its corresponding base can be purchased as a kit.
2	NTSXBA0100H	Spare Base, 1 Slot, for Input/Output Common or Expert Module, Hardened
3	NTSAMO0400	Analog Output Module, 4 Outputs, Current, Voltage
	NTSAMO0400H	Analog Output Module, 4 Outputs, Current, Voltage, Hardened
4	NTSXTB12200H	Spring Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened
	NTSXTB12201H	Spring Terminal Block, 12 Points, 5 mm Pitch, With Cover, use on Low Height Module, Hardened
	NTSXTB12000H	Screw Terminal Block, 12 Points, 5 mm Pitch, Without Cover, use on Low Height Module, Hardened
	NTSXTB12001H	Screw Terminal Block, 12 Points, 5 mm Pitch, With cover, use on Low Height Module, Hardened
		NOTE: The terminal blocks are purchased separately.

NOTE: For more information on accessories and spare parts, refer to Modicon Edge I/O - System Planning and Installation Guide.

Physical Description


The following figure presents the elements of the module:

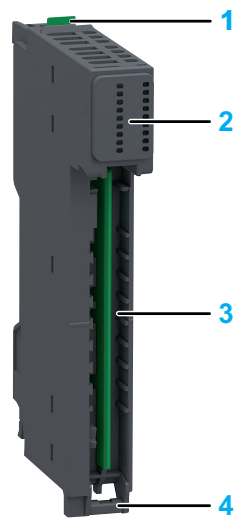

- 1: Release button for disengaging the module from the base
- 2: Status LEDs
- 3: Slot for the terminal block
- 4: Hinge for the terminal block installation

Status LEDs


The following figure presents the NTSAM00400/NTSAM00400H status LEDs:



The following table describes the status of LEDs:

R (Green)	E (Red)	Channel (Green)	Description
Initialization and non-operational states			
OFF	OFF	OFF	Indicates that the module is not energized.
OFF	Fast Flash	-	Indicates that the module has detected a system error.
Regular Flash	OFF	-	Indicates that the firmware is being updated.
Regular Flash	ON	-	Indicates that a module mismatch is detected.
Single Flash	OFF	-	Indicates that the module is energized and not configured.
Operational state			
ON	OFF	-	Indicates that the module is energized, configured and operational.
ON	-	ON	Indicates that the channel is activated.
ON	-	OFF	Indicates that the channel is deactivated.
ON	Single Flash	-	Indicates an advisory detection.
ON	Single Flash	Single Flash	Indicates: - Lower tolerance advisory detection. - Upper tolerance advisory detection.
ON	Regular Flash	OFF	Indicates that an error is detected in the 24 Vdc field power.
ON	Regular Flash	-	Module in fallback state.
ON	Regular Flash	Regular Flash	Indicates: - Broken wire detection. - Short circuit detection. - Overflow/underflow error detection. - DAC power error detection.
ON	Regular Flash	OFF	Indicates an internal error detection.

The following graphic shows the system status of LEDs during module operation:

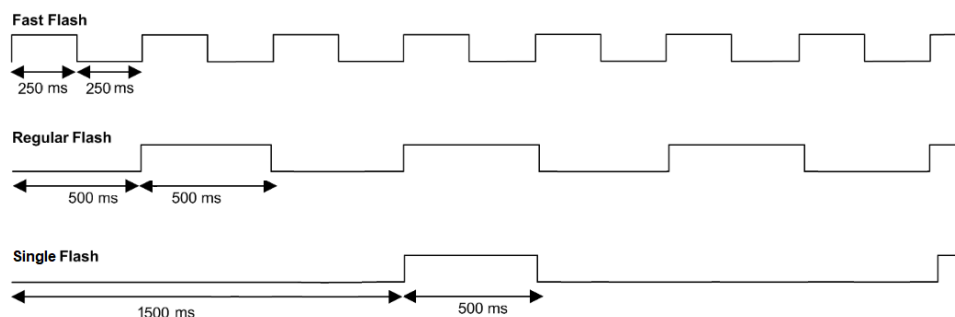

NTSAMO0400/NTSAMO0400H Characteristics

Overview

This section provides a general description of the characteristics of the module.

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION


Do not exceed any of the rated values specified in the environmental and electrical characteristics tables.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

For more information on environmental characteristics, refer to Modicon Edge I/O - System Planning and Installation Guide.

Dimensions

The following figure presents the external dimensions of the assembled module:

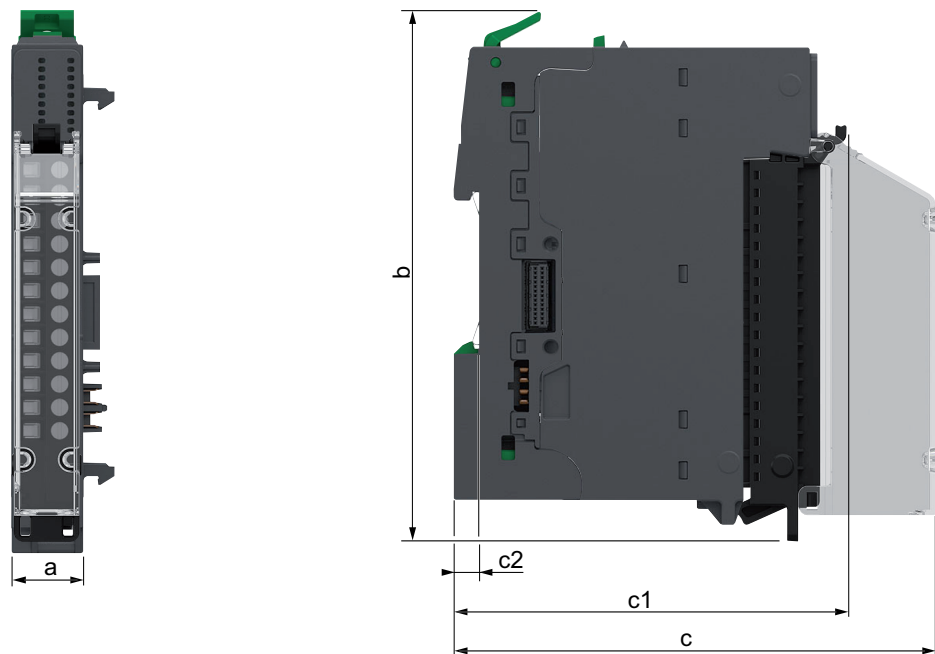

- a: 15 mm (0.59 in)
- b: 116.6 mm (4.57 in)
- c: 107.5 mm (4.21 in)
- c1: 88.2 mm (3.46 in)
- c2: 5.6 mm (0.2 in)

Weight

- NTSAMO0400/NTSAMO0400H: 48 g (1.69 oz)
- NTSAMO0400K/NTSAMO0400HK: 74 g (2.61 oz)

General Characteristics

The following table shows the general characteristics of the NTSAMO0400/
NTSAMO0400H output modules:

Characteristics		Value
Rated supplied voltage		24 Vdc
Power supplied voltage range		20.4...28.8 Vdc
Isolation	Between channels	No
	Between channels and bus	1500 Vac
	Between channels and field power	No
	Between field power and bus	1500 Vac
Protection and detection		Overcurrent or short-circuit on voltage output Broken wire on current output
Power dissipation		1.64 W

Output Characteristics

The following table describes the output characteristics of the NTSAM00400/
NTSAM00400H output modules:

Characteristics		Value	
Module		NTSAM00400	NTSAM00400H
Output type		Single end	
Logic type		High level output	
Wiring type Actuator connection		2-wire	
Output range		± 10 Vdc 0...10 Vdc ± 5 Vdc 0...5 Vdc 1...5 Vdc 0...20 mA 4...20 mA	
Load impedance	Voltage output	- 20 °C...60 °C (- 4 °F...140 °F): up to 4 channels with a load of 1 k Ω minimum.	- 40 °C...60 °C (- 40 °F...140 °F): up to 4 channels with a load of 1 k Ω minimum. 60 °C...70 °C (140 °F...158 °F): the module needs derating as follows: • 1 channel maximum with a load of 1 kΩ minimum. • 2 channels maximum with a load of 2 kΩ minimum.
	Current output	600 Ω maximum	
Resolution		16 bits, or 15 bits plus sign bit: ± 10 Vdc, ± 5 Vdc 15 bits: 0...10 Vdc, 0...5 Vdc, 1...5 Vdc, 0...20 mA, 4...20 mA	
Maximum accuracy at ambient 25 °C (77 °F) / maximum allowed temperature		0.1 % / 0.2 % of full scale	
Response time		1 ms at 600 Ω	
Temperature drift		0.002 %/°C of full scale	
Repeatability after stabilization time		0.05 % of full scale	
Nonlinearity		0.02 % of full scale	
Cable	Type	Shielded	
	Length	Voltage output: 200 m (656 ft) Current output: 1,000 m (3,280 ft)	

NTSAMO0400/NTSAMO0400H Wiring

Overview


This section provides the wiring diagram for the NTSAMO0400/NTSAMO0400H output modules.

Wiring Rules

For more information on the wiring, refer to Modicon Edge I/O - System Planning and Installation Guide.

Wiring Diagram

The following figure illustrates the connection between the outputs and the actuators:

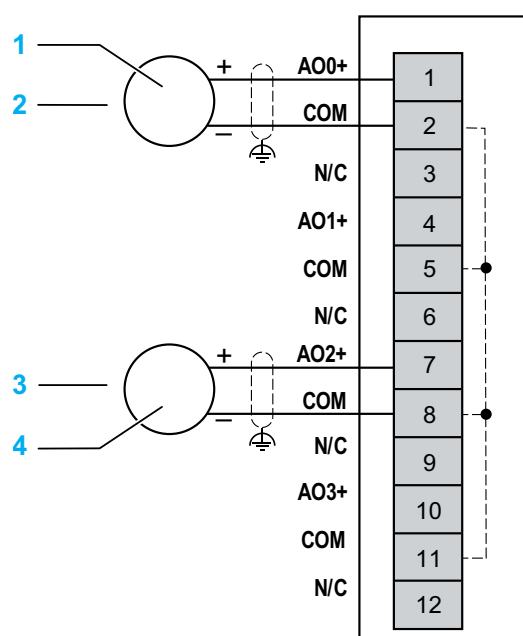

- 1: Actuator
- 2: 2-wire connection for Voltage output
- 3: 2-wire connection for Current output
- 4: Actuator
- N/C: Not Connected

⚠ WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals and/or terminals indicated as “No Connection (N/C)”.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NTSAMO0400/NTSAMO0400H Parameters

Overview

This section describes the parameters of the NTSAMO0400/NTSAMO0400H modules.

Parameters are the set of values, specific to a module, that can be edited with the programming software during edition mode.

Software configuration is accomplished with one of the following options:

- The Edge I/O configuration software (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).
- The EcoStruxure Automation Expert software (refer to the EcoStruxure Automation Expert online help).
- The EcoStruxure Automation Expert - Motion software (refer to the EcoStruxure Automation Expert - Motion online help).
- The embedded Web interface (refer to the Modicon Edge I/O - Configurator and Web Interface - User Guide).

If you have physically wired the analog channel for a voltage signal and you configure the channel for a current signal, you may damage the analog circuit.

NOTICE
INOPERABLE EQUIPMENT Verify that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel. Failure to follow these instructions can result in equipment damage.

Parameters Description

Configurable Parameters

The following table presents the configurable parameters for the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Device Mode <i>DeviceMode</i>	0: Normal * 1: Optional 2: Virtual reserved	ENUM	Allows you to select the device mode: Normal: The module is part of the software configuration and is physically connected in the cluster. Optional: The module is part of the software configuration. A dummy module or the configured module must be physically installed in the cluster. Whether either module is present does not cause a configuration error to be detected. Virtual reserved: The module is part of the software configuration. A dummy module must be physically installed in the cluster. If the virtual module is physically installed in the cluster, a configuration error is detected.

* Parameter default value

The following table presents the configurable parameters for the channels of the module:

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Channel Enabled <i>ChannelEnable</i>	FALSE TRUE *	BOOL	Determines whether a channel is activated or deactivated.
Range Mode <i>RangeMode</i>	+/-10 V * 0..10 V +/-5 V 0..5 V 1..5 V 0..20 mA 4..20 mA	ENUM	Defines the range mode for the output channel. For more information on RangeMode parameter, refer to <i>RangeMode Parameters</i> , page 138.
Range Maximum <i>RangeMax</i>	-32767...32767	INT16	Sets the high threshold value of the normal range. The values are computed according to the selected RangeMode .
Range Minimum <i>RangeMin</i>	-32768...32766	INT16	Sets the low threshold value of the normal range. The values are computed according to the selected RangeMode .
Fallback Mode <i>OutputFallbackMode</i>	Predefined Fallback Value * Maintain	ENUM	Chooses the output Fallback mode function.
Predefined Fallback Value <i>OutputFallbackValue</i>	-32768...32767	INT16	Sets the value of the predefined Fallback value.
Hart Tolerance Enabled <i>HartToleranceEnable</i>	FALSE * TRUE	BOOL	Enables the slew rate filter to filter out HART signals on the analog current output. Current output does not affect original HART signal in current loop, it slows the output slew rate. HartToleranceEnable parameter can be changed to TRUE when the RangeMode is set to 4..20 mA . For more information on HartToleranceEnable parameter, refer to <i>HartToleranceEnable</i> , page 136.

Displayed Name <i>Parameter Name</i>	Value(s)	Data type	Description
Overflow Checked <i>OverflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables overflow detection. An error is detected if the measurement is greater than Overflow Threshold . For more information on OverflowChecked parameter, refer to <i>Overflowcheck/Underflowcheck</i> , page 141.
Overflow Threshold <i>OverMax</i>	-32767...32767	INT16	Sets the overflow threshold value. The values are computed according to the selected RangeMax value.
Underflow Checked <i>UnderflowCheck</i>	FALSE TRUE*	BOOL	Enables or disables underflow detection. An error is detected if the measurement is lower than Underflow Threshold . For more information on UnderflowChecked parameter, refer to <i>Overflowcheck/Underflowcheck</i> , page 141.
Underflow Threshold <i>OverMin</i>	-32768...32766	INT16	Sets the underflow threshold value. The values are computed according to the selected RangeMin value.
Shorted Wire Checked <i>ShortedWireCheck</i>	FALSE TRUE*	BOOL	Enables or disables shorted wire detection on voltage output.
Broken Wire Checked <i>BrokenWireCheck⁽¹⁾</i>	FALSE TRUE*	BOOL	Enables or disables broken wire detection on current output.
AlignmentOffset <i>AlignmentOffset⁽¹⁾</i>	-1500...1500	INT16	Compensates for a permanent offset observed with a given sensor, around a specific operating point. This operation compensates for an offset linked to the process. Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment. For more information on AlignmentOffset parameter, refer to <i>Alignment Offset</i> , page 138.
* Parameter default value ⁽¹⁾ Online modification is allowed.			

Implicit Data

The following table presents the input implicit data for the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
GCS	0...255	BYTE 1	Group Cyclic Status Bit 0: Data quality Bit 1: General module status Bit 2: I/O status Bit 3: Receive status Bit 4: Output status Bit 5: Advisory status Bit 6: N/A Bit 7: Data freshness NOTE: For more information, refer to Modicon Edge I/O - Diagnostic Data - User Guide.
ChannelHealth0_7 ⁽¹⁾	0...255	BYTE 1	Bit 0...7 = Status of channel 0...7 • Bit = FALSE: Channel is invalid or not present. • Bit = TRUE: Channel is valid or disabled.
⁽¹⁾ This parameter is not part of the implicit data if the optimized I/O profile is selected.			

The following table presents the output implicit data for the channels of the module:

Parameter Name	Value(s)	Data type Size in bytes	Description
QValue	-32,768... 32,767	INT16 2	Value of the output channel.

Explicit Data

The following table presents the explicit data for the channels of the module:

<i>Parameter Name</i>	<i>Value(s)</i>	<i>Data type</i> <i>Size in bytes</i>	<i>Description</i>
<i>ChannelFault1</i>	0...255	BYTE 1	Indicates module channel error catalog. Bit 0: Underflow error detected Bit 1: Overflow error detected Bit 2: Broken wire error detected Bit 3: Short circuit error detected Bit 4: Hardware error detected Bit 5: Calibration error detected Bit 6: N/A Bit 7: N/A
<i>ChannelFault2</i>	0...255	BYTE 1	Bit 0: DAC power error detected Bit 7: Power supply error detected NOTE: Bits 1 to 6 are reserved.
<i>MeasureStatus1</i>	0...255	BYTE 1	Bit 0: N/A Bit 1: N/A Bit 2: Non-zero alignment offset configured Bit 3: Channel enabled configured NOTE: Bits 4 to 7 are reserved.
<i>MeasureStatus2</i>	0...255	BYTE 1	Bits 0 to 7 are reserved.

Appendices

What's in This Part

Parameters Description	136
------------------------------	-----

Parameters Description

What’s in This Chapter

General Parameters	136
RangeMode Parameters	138
Overflowcheck/Underflowcheck and ScalingRange Parameters	141

General Parameters

HartToleranceEnable

HartToleranceEnable parameter enables the slew rate filter on an analog current channel.
For analog input modules, this function is achieved by setting the Analog to Digital Converter (ADC) internal digital filter to filter out HART signals.
For analog output modules, the current output does not affect the original HART signal in the current loop, but the output slew rate is slower. This function is achieved by setting the Digital to Analog Converter (DAC) output slew rate.

NOTE:

- To enable HART tolerance, one channel needs at least 20 ms with 50 Hz ADC data rate.
- When HART tolerance is enabled, the relative channel sampling time is increased.
- HART signal has limitation on the analog current input rate of change.
- When HART tolerance is enabled for NTSACI0802X and NTSACI0802XH, the module is switched to asynchronous mode, requiring at least 20 ms per channel.
- When HART tolerance is enabled for NTSAMI0210 and NTSAM10210H, the module is switched to asynchronous mode, with a 55 ms delay of the ADC per channel.

HartToleranceEnable can be changed to **TRUE** when the **RangeMode** is set to **4..20mA**.

Measurement Filter

This parameter defines the type of filtering for the input channel selected for the analog modules. The type of filtering performed by the system is called “first order filtering”. The filtering coefficient can be modified from a programming console or through the program.

The mathematical formula used is as follows:

$$\mathbf{Meas}_{f(n)} = \alpha \times \mathbf{Meas}_{f(n-1)} + (1 - \alpha) \times \mathbf{Val}_{b(n)}$$

Where:

- α = efficiency of the filter
- $\mathbf{Meas}_{f(n)}$ = filtered measurement at moment n
- $\mathbf{Meas}_{f(n-1)}$ = filtered measurement at moment n-1
- $\mathbf{Val}_{b(n)}$ = internal value at moment n

You can configure the filtering value even when the application is in RUN mode:

Desired Efficiency	Required Value	Corresponding α	Filter Response Time at 63%	Cutoff Frequency (Hz)
No filtering	0	0	0	0
Low filtering	1	0.750	$4 \times T_{\text{cycle}}$	$0.040 / T_{\text{cycle}}$
	2	0.875	$8 \times T_{\text{cycle}}$	$0.020 / T_{\text{cycle}}$
Medium filtering	3	0.937	$16 \times T_{\text{cycle}}$	$0.010 / T_{\text{cycle}}$
	4	0.969	$32 \times T_{\text{cycle}}$	$0.005 / T_{\text{cycle}}$
High filtering	5	0.984	$64 \times T_{\text{cycle}}$	$0.0025 / T_{\text{cycle}}$
	6	0.992	$128 \times T_{\text{cycle}}$	$0.0012 / T_{\text{cycle}}$
T_{cycle} = sampling period of the channel.				

You may also configure the NTSAMI0420 filtering value using peak filtering as follow:

Desired Efficiency	Required Value	Description
Peak filtering	7	This type of filtering is used to filter peaks above 1.1% of the fullscale input range. If the absolute value of the difference between the present value ($\mathbf{Val}_{b(n)}$) and the previous one ($\mathbf{Val}_{b(n-1)}$) is greater than 1.1% of the fullscale, the $\mathbf{Meas}_{f(n)}$ is equal to the previous value ($\mathbf{Val}_{b(n-1)}$). If the value of the difference between the next value ($\mathbf{Val}_{b(n+1)}$) and the previous one ($\mathbf{Val}_{b(n-1)}$) is greater than 1.1% of the fullscale, the $\mathbf{Meas}_{f(n)}$ is equal to the next value ($\mathbf{Val}_{b(n+1)}$).


Alignment Offset

The process of alignment offset compensates for a permanent offset observed with a given sensor, around a specific operating point.

This operation compensates for an offset linked to the process.

Replacing the module does not require a new alignment. However, replacing the sensor or changing the operating point of the sensor does require a new alignment.

Conversion lines are as follows:

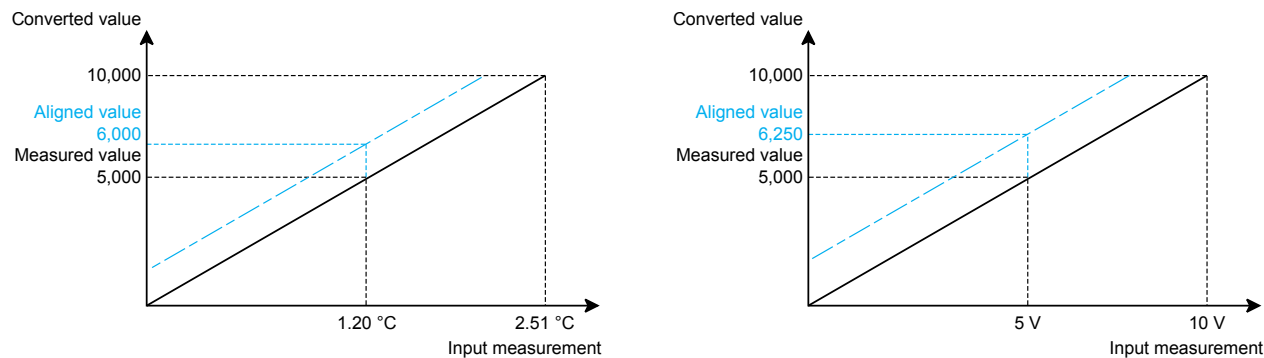

Channel alignment is performed on the channel in standard operating mode, without any effect on the operating modes of the channel.

The maximum offset between measured value and desired (aligned) value must not exceed +/-1,500.

NOTE: To align several analog channels, proceed channel by channel. Test each channel after alignment before moving to the next channel to apply the parameters correctly.

RangeMode Parameters

The following table enumerates range modes for input and output modules:

Enumeration Value	Value Meaning
0	± 10 Vdc
1	0...10 Vdc
2	± 5 Vdc
3	0...5 Vdc
4	1...5 Vdc
5	± 20 mA
6	0...20 mA
7	4...20 mA

The following tables enumerate range modes for temperature input modules:

NTSART0603 Resistance Temperature Detector RTD Range Mode Parameters

Enumeration Value	Value Meaning
11	Ni100 2 wires
12	Ni100 3 wires
13 ⁽¹⁾	Ni100 4 wires
14	Ni1000 2 wires

NTSART0603 Resistance Temperature Detector RTD Range Mode Parameters (Continued)

Enumeration Value	Value Meaning
15	Ni1000 3 wires
16 ⁽¹⁾	Ni1000 4 wires
17	PT100 2 wires
18	PT100 3 wires
19 ⁽¹⁾	PT100 4 wires
20	JPt100 2 wires
21	JPt100 3 wires
22 ⁽¹⁾	JPt100 4 wires
23	PT1000 2 wires
24	PT1000 3 wires
25 ⁽¹⁾	PT1000 4 wires
26	JPt1000 2 wires
27	JPt1000 3 wires
28 ⁽¹⁾	JPt1000 4 wires
29	Cu10 2 wires
30	Cu10 3 wires
31 ⁽¹⁾	Cu10 4 wires
32	Cu50 2 wires
33	Cu50 3 wires
34 ⁽¹⁾	Cu50 4 wires
35	Cu100 2 wires
36	Cu100 3 wires
37 ⁽¹⁾	Cu100 4 wires
⁽¹⁾ The enumeration value is only valid for NTSART0603 modules.	

NTSART0603 Resistance Sensor Range Mode

Enumeration Value	Value Meaning
44	0 ~ 150 Ohm 2 wires
45	0 ~ 150 Ohm 3 wires
46 ⁽¹⁾	0 ~ 150 Ohm 4 wires
47	0 ~ 300 Ohm 2 wires
48	0 ~ 300 Ohm 3 wires
49 ⁽¹⁾	0 ~ 300 Ohm 4 wires
50	0 ~ 600 Ohm 2 wires
51	0 ~ 600 Ohm 3 wires
52 ⁽¹⁾	0 ~ 600 Ohm 4 wires
53	0 ~ 2000 Ohm 2 wires
54	0 ~ 2000 Ohm 3 wires
55 ⁽¹⁾	0 ~ 2000 Ohm 4 wires
56	0 ~ 4500 Ohm 2 wires
57	0 ~ 4500 Ohm 3 wires
58 ⁽¹⁾	0 ~ 4500 Ohm 4 wires
⁽¹⁾ The enumeration value is only valid for NTSART0603 modules.	

NTSART0603 Resistance Sensor Range Mode

Enumeration Value	Value Meaning
59	0 ~ 32000 Ohm 2 wires
60	0 ~ 32000 Ohm 3 wires

NTSART0603 Thermistor Sensor Range Mode

Enumeration Value	Value Meaning
61	PTC 100 ~ 10000 Ohm 2 wires
62	NTC 100 ~ 200000 Ohm 2 wires

Overflowcheck/Underflowcheck and ScalingRange Parameters

Overflowcheck/Underflowcheck

Depending on the range selected, the module verifies that the measurement falls between two thresholds. A tolerance area can be set around each threshold.

The following table describes the types of areas:

Designation	Description
Nominal Area	No advisory or error indicator in this area: Measurement range corresponds to the chosen range.
Upper Tolerance Area	Advisory indicator in this area: Measurement range varies between the values included between the upper advisory threshold (Range Maximum) and upper error threshold (Overflow Threshold).
Lower Tolerance Area	Advisory indicator in this area: Measurement range varies between the values included between the lower advisory threshold (Range Minimum) and lower error threshold (Underflow Threshold).
Overflow Area	Error indicator in this area: Measurement range is located beyond the upper error threshold.
Underflow Area	Error indicator in this area: Measurement range is located under the lower error threshold.

NOTE: For voltage/current input ranges, the resolution is different depending on scaling range used.

For the temperature input modules, you can set:

Temperature unit display: The values are displayed in tenth of degree.

- Tenth of degree Celsius if the configured unit is °C

- Tenth of degree Fahrenheit if the configured unit is °F:

$$T[°F] = 1.8 \times T[°C] + 32.$$

- Tenth of Kelvin if the configured unit is K:

$$T[K] = T[°C] + 273.15.$$

User display: You can choose a user display 0...10 000 (0 to 10 000 ⁰/₀₀₀) by setting the minimal and maximal temperatures corresponding to 0 and to 10 000.

To set a tolerance area, you can configure **Range Maximum** and **Range Minimum** in the configuration software or embedded web page. The **Overflow Threshold** and **Underflow Threshold** parameters are computed by setting **Range Maximum** and **Range Minimum**.

NOTE: If RTD high Resolution Mode is enabled, the code display for RTD type is 1/100; otherwise it is 1/10.

Input Modules Scaling Range

NTSAMI0210/NTSAMI0210H Scaling Range

Range	Default Underflow Threshold	Nominal Area [Range Minimum, Range Maximum]		Default Overflow Threshold
	Configurable range	Default Range Minimum Value	Default Range Maximum Value	Configurable range
± 10 Vdc	-11,000 -11,400...-10,000	-10,000	10,000	11,000 10,000...11,400
	-11 V -11.4...-10 V	-10 V	+10 V	+11 V 10...11.4 V
0...10 Vdc	-1,000 -1,400...0	0	10,000	11,000 10,000...11,400
	-1 V -1.4...0 V	0 V	+10 V	+11 V 10...11.4 V
± 5 Vdc	-11,000 -15,000...-10,000	-10,000	10,000	11,000 10,000...15,000
	-5.5 V -7.5...-5 V	-5 V	+5 V	+5.5 V 5...7.5 V
0...5 Vdc	-1,000 -5,000...0	0	10,000	11,000 10,000...15,000
	-0.5 V -2.5...0 V	0 V	+5 V	+5.5 V 0...7.5 V
1...5 Vdc	-800 -4,000...0	0	10,000	10,800 10,000...14,000
	+0.68 V -0.6...+1 V	+1 V	+5 V	+5.32 V 5...6.6 V
± 20 mA	-11,000 -12,000...-10,000	-10,000	10,000	11,000 10,000...12,000
	-22 mA -24...-20 mA	-20 mA	20 mA	22 mA 20...24 mA
0...20 mA	-1,000 -5,000...0	0	10,000	11,000 10,000...12,000
	-2 mA -10...0 mA	0 mA	20 mA	22 mA 20...24 mA
4...20 mA	-800 -4,000...0	0	10,000	10,800 10,000...12,000
	2.72 mA -2.4...4 mA	4 mA	20 mA	21.28 mA 20...23.2 mA

NTSACI0802X/NTSACI0802XH Scaling Range

Range	Default Underflow Threshold Configurable range	Nominal Area [Range Minimum, Range Maximum]		Default Overflow Threshold Configurable range
		Default Range Minimum Value	Default Range Maximum Value	
± 20 mA	-10,500	-10,000	10,000	10,500
	-11,000, -10,000			10,000, 11,250
	-21 mA -22 mA, -20 mA	-20 mA	20 mA	21 mA 20 mA, 22.5 mA
0...20 mA	-1,000	0	10,000	10,500
	-5,000, 0			10,000, 11,250
	-2 mA -10 mA, 0 mA	0 mA	20 mA	21 mA 20 mA, 22.5 mA
4...20 mA	-800	0	10,000	10,500
	-4,000, 0			10,000, 11,250
	2.72 mA -2.4 mA, 4 mA	4 mA	20 mA	20.8 mA 20 mA, 22 mA

NTSAMI0400/NTSAMI0420/NTSAMI0800 Scaling Range

Range	Default Underflow Threshold Configurable range	Nominal Area [Range Minimum, Range Maximum]		Default Overflow Threshold Configurable range
		Default Range Minimum Value	Default Range Maximum Value	
± 10 Vdc	-11,000	-10,000	10,000	11,000
	-11,400, -10,000			10,000, 11,400
	-11 V -11.4 V, -10 V	-10 V	+10 V	+11 V +10 V, +11.4 V
0...10 Vdc	-1,000	0	10,000	11,000
	-1,400, 0			10,000, 11,400
	-1 V -1.4 V, 0 V	0 V	+10 V	+11 V +10 V, +11.4 V
± 5 Vdc	-11,000	-10,000	10,000	11,000
	-15,000, -10,000			10,000, 15,000
	-5.5 V -7.5 V, -5V	-5 V	+5 V	+5.5 V +5 V, +7.5 V
0...5 Vdc	-1,000	0	10,000	11,000
	-5,000, 0			10,000, 15,000
	-0.5 V -2.5 V, 0 V	0 V	+5 V	+5.5 V 0 V, +7.5 V
1...5 Vdc	-800	0	10,000	10,800
	-4,000, 0			10,000, 14,000
	+0.68 V -0.6 V, +1 V	+1 V	+5 V	+5.32 V +5 V, +6.6 V
± 20 mA	-10,500	-10,000	10,000	10,500
	-12,000, -10,000			10,000, 11,250
	-21 mA -22.5 mA, -20 mA	-20 mA	20 mA	21 mA 20 mA, 22.5 mA
0...20 mA	-1,000	0	10,000	10,500
	-5,000, 0			10,000, 11,250
	-2 mA -10 mA, 0 mA	0 mA	20 mA	21 mA 20 mA, 22.5 mA
4...20 mA	-800	0	10,000	10,500
	-4,000, 0			10,000, 11,250
	2.72 mA -2.4 mA, 4 mA	4 mA	20 mA	20.8 mA 20 mA, 22 mA

Output Modules Scaling Range

NTSAM00210/NTSAM00210H Scaling Range

Range	Default Underflow Threshold Configurable range	Nominal Area [Range Minimum, Range Maximum]		Default Overflow Threshold Configurable range
		Default Range Minimum Value	Default Range Maximum Value	
± 10 Vdc	-11,000	-10,000	10,000	11,000
	-11,250, -10,000			10,000, 11,250
	-11 V -11.25 V, -10 V	-10 V	+10 V	+11 V +10 V, +11.25 V
0...10 Vdc	-1,000	0	10,000	11,000
	-2,000, 0			10,000, 11,250
	-1 V -2 V, 0 V	0 V	+10 V	+11 V +10 V, +11.25 V
± 5 Vdc	-11,000	-10,000	10,000	11,000
	-11,250, -10,000			10,000, 11,250
	-5.5 V -5.625 V, -5 V	-5 V	+5 V	+5.5 V +5 V, +5.625 V
0...5 Vdc	-1,000	0	10,000	11,000
	-2,000, 0			10,000, 11,250
	-0.5 V -1 V, 0 V	0 V	+5 V	+5.5 V +5 V, +5.625 V
1...5 Vdc	-800	0	10,000	11,000
	-1,600, 0			10,000, 11,250
	0.68 V 0.36 V, 1 V	1 V	+5 V	+5.4 V +5 V, +5.5 V
± 20 mA	-10,800	-10,000	10,000	10,800
	-11,600, -10,000			10,000, 11,600
	-21.6mA -23.2 mA, -20 mA	-20 mA	20 mA	21.6 mA 20 mA, 23.2 mA
0...20 mA	-1,000	0	10,000	10,800
	-2,000, 0			10,000, 11,600
	-2 mA -4 mA, 0 mA	0 mA	20 mA	21.6 mA 20 mA, 23.2 mA
4...20 mA	-800	0	10,000	10,800
	-1,600, 0			10,000, 11,600
	2.72 mA 1.44 mA, 4 mA	4 mA	20 mA	21.28 mA 20 mA, 22.56 mA

NTSAM00400/NTSAM00400H Scaling Range

Range	Default Underflow Threshold Configurable range	Nominal Area [Range Minimum, Range Maximum]		Default Overflow Threshold Configurable range
		Default Range Minimum Value	Default Range Maximum Value	
± 10 Vdc	-10,300 -10,500, -10,000	-10,000	10,000	10,300 10,000, 10,500
	-10.3 V -10.5 V, -10 V	-10 V	+10 V	+10.3 V +10 V, +10.5 V
0...10 Vdc	-1,000 -2,000, 0	0	10,000	10,300 10,000, 10,500
	-1 V -2 V, 0 V	0 V	+10 V	+10.3 V +10 V, +10.5 V
± 5 Vdc	-10,300 -10,500, -10,000	-10,000	10,000	10,300 10,000, 10,500
	-5.15 V -5.25 V, -5 V	-5 V	+5 V	+5.15 V +5 V, +5.25 V
0...5 Vdc	-1,000 -2,000, 0	0	10,000	10,300 10,000, 10,500
	-0.5 V -1 V, 0 V	0 V	+5 V	+5.15 V +5 V, +5.25 V
1...5 Vdc	-800 -1,600, 0	0	10,000	10,300 10,000, 10,500
	0.68 V 0.36 V, 1 V	1 V	+5 V	+5.12 V +5 V, +5.2 V
0...20 mA	-1,000 -2,000, 0	0	10,000	10,300 10,000, 10,500
	-2 mA -4 mA, 0 mA	0 mA	20 mA	20.6 mA 20 mA, 21 mA
4...20 mA	-800 -1,600, 0	0	10,000	10,300 10,000, 10,500
	2.72 mA 1.44 mA, 4 mA	4 mA	20 mA	20.48 mA 20 mA, 20.8 mA

Temperature Input Modules Scaling Range

NTSART0603 Standard RTD Ranges

Range	Standard	Unit	Default Underflow Threshold	Nominal Area [Range Minimum, Range Maximum]		Default Overflow Threshold
				Default Range Minimum Value	Default Range Maximum Value	
Pt100 (2/3/4 wires)	IEC 751	°C	-1,990	-1,750	8,250	8,490
		°F	-3,260	-2,830	15,170	15,600
		K	750	990	10,980	11,210
Pt1000(2/3/4 wires)	IEC 751	°C	-1,990	-1,750	8,250	8,490
		°F	-3,260	-2,830	15,170	15,600
		K	750	990	10,980	11,210
Ni100 (2/3/4 wires)	DIN43760:1987	°C	-590	-540	2,420	2,490
		°F	-750	-660	4,680	4,800
		K	2,120	2,200	5,150	5,220
Ni1000 (2/3/4 wires)	DIN43760:1987	°C	-590	-540	2,420	2,490
		°F	-750	-660	-4,680	-4,810
		K	2,120	2,200	5,150	5,220
JPt100 (2/3/4 wires)	JIS C1604:1997	°C	-1,990	-1,750	8,250	8,490
		°F	-3,260	-2,830	15,170	15,600
		K	750	990	10,980	11,210
JPt1000 (2/3/4 wires)	JIS C1604:1997	°C	-1,990	-1,750	8,250	8,490
		°F	-3,260	-2,830	15,170	15,600
		K	750	990	10,980	11,210
Cu10 (2/3/4 wires)	Copper	°C	-990	-910	2,510	2,590
		°F	-1,460	-1,320	4,840	4,980
		K	1,740	1,830	5,240	5,320
Cu50 (2/3/4 wires)	GOST6651:94	°C	-2,000	-1,910	1,910	2,000
		°F	-3,280	-3,120	3,760	3,920
		K	730	830	4,640	4,730
Cu100(2/3/4 wires)	GOST6651:94	°C	-2,000	-1,910	1,910	2,000
		°F	-3,280	-3,120	3,760	3,920
		K	730	830	4,640	4,730

NTSART0603 High Resolution Mode RTD Ranges

Range	Unit	Default Underflow Threshold	Nominal Area [Range Minimum, Range Maximum]		Default Overflow Threshold
			Default Range Minimum Value	Default Range Maximum Value	
Cu10	°C	-9,900	-6,920	22,920	25,900
	°F	-13,380	-9,260	32,000	32,000
	K	19,240	20,400	32,000	32,000
Cu50/Cu100	°C	-20,000	-16,670	16,670	20,000
	°F	-32,000	-26,800	32,000	32,000
	K	8,510	10,650	32,000	32,000
Ni100/Ni1000	°C	-5,900	-3,340	22,340	24,900
	°F	-6,300	-2,820	32,000	32,000
	K	23,170	23,980	32,000	32,000
PT100/PT1000/JPt100/JPt1000	°C	-14,500	-12,000	13,000	15,500
	°F	-22,900	-18,400	26,600	31,100
	K	13,650	15,320	32,000	32,000

NTSART0603 Resistance Ranges

Range		Default Underflow Threshold	Nominal Area [Range Minimum, Range Maximum]		Default Overflow Threshold
			Default Range Minimum Value	Default Range Maximum Value	
0-150 Ohms 2/3/4 wires	default	0	0	15,000	15,360
	maximum	0	0	32,000	32,000
0-300 Ohms 2/3/4 wires	default	0	0	30,000	30,720
	maximum	0	0	32,000	32,000
0-600 Ohms 2/3/4 wires	default	0	0	6,000	6,144
	maximum	0	0	32,000	32,000
0-2000 Ohms 2/3/4 wires	default	0	0	20,000	20,480
	maximum	0	0	32,000	32,000
0-4500 Ohms 2/3/4 wires	default	0	0	4,500	4,590
	maximum	0	0	32,000	32,000
0-32,000 Ohms 2/3 wires	default	0	0	32,000	32,000
	maximum	0	0	32,000	32,000
PTC 100-10k Ohms 2 wires	default	0	100	10,000	10,237
	maximum	0	0	32,000	32,000
NTC ⁽¹⁾ 100-200k Ohms 2 wires	default	0	100	20,000	20,477
	maximum	0	0	32,000	32,000

⁽¹⁾ NTC is only valid for NTSART0603 module.

Glossary

A

analog input:

Converts received voltage or current levels into numerical values. You can store and process these values within the logic controller.

analog output:

Converts numerical values within the logic controller and sends out proportional voltage or current levels.

application:

A program including configuration data, symbols, and documentation.

C

CA:

(*Certificate Authority*) An entity that issues digital certificates to certify the ownership of a public key by the named subject of the certificate.

configuration:

The arrangement and interconnection of hardware components within a system and the hardware and software parameters that determine the operating characteristics of the system.

controller:

Automates industrial processes (also known as programmable logic controller or programmable controller).

D

derating:

A reduction in an operating specification. For devices in general, it is usually a specified reduction in nominal power to allow operation at increased ambient conditions like higher temperatures or higher altitudes.

E

electronic module:

In a programmable controller system, most electronic modules directly interface to the sensors, actuators, and external devices of the machine/process. This electronic module is the component that mounts in a bus base and provides electrical connections between the controller and the field devices. Electronic modules are offered in a variety of signal levels and capacities. (Some electronic modules are not I/O interfaces, including power distribution modules and transmitter/Extender module).

EN:

EN identifies one of many European standards maintained by CEN (*European Committee for Standardization*), CENELEC (*European Committee for Electrotechnical Standardization*), or ETSI (*European Telecommunications Standards Institute*).

Ethernet:

A physical and data link layer technology for LANs, also known as IEEE 802.3.

F**firmware:**

Represents the BIOS, data parameters, and programming instructions that constitute the operating system on a controller. The firmware is stored in non-volatile memory within the controller.

H**hex:**

(hexadecimal)

I**I/O:**

(input/output)

ID:

(identifier/identification)

IEC:

(international electrotechnical commission) A non-profit and non-governmental international standards organization that prepares and publishes international standards for electrical, electronic, and related technologies.

input/output:

The index of the ARRAY.

Island: : Group of remote or distributed clusters.

L**LED:**

(light emitting diode) An indicator that illuminates under a low-level electrical charge.

M**ms:**

(millisecond)

N**NAMUR NE43:**

NAMUR NE43 provides a guideline on how a sensor fault can be indicated to a control system using the 4...20 mA signal.

network:

A system of interconnected devices that share a common data path and protocol for communications.

NTS: *(Network Terminal Slice)*

R

Readback: Readback is the re-reading of the physical output. The readback error is therefore a different reading of the command.

run:

A command that causes the controller to scan the application program, read the physical inputs, and write to the physical outputs according to solution of the logic of the program.

T**terminal block:**

(*terminal block*) The component that mounts in an electronic module and provides electrical connections between the controller and the field devices.

Index

A

Analog Input Modules	16
NTSACI0802X	77
NTSACI0802XH	77
NTSAMI0210	19
NTSAMI0210H	19
NTSAMI0400	38
NTSAMI0420	51
NTSAMI0800	64
Analog Output Modules	17
NTSAMO0210	109
NTSAMO0210H	109
NTSAMO0400	122
NTSAMO0400H	122

M

Modicon Edge I/O NTS Analog Modules	15
Analog Input Modules	18
Analog Output Modules	108
Temperature Input Modules	93

T

Temperature Input Modules	17
NTSART0603	94

Schneider Electric
35 rue Joseph Monier
92500 Rueil Malmaison
France

www.se.com

As standards, specifications, and design change from time to time, please ask for confirmation of the information given in this publication.

© 2025 Schneider Electric. All rights reserved.

EIO0000005246.02