

Product Environmental Profile

Vigilohm Insulation Fault Locator




General information

Reference product	VigiloHM Insulation Fault Locator - IMDIFL12MCT
Description of the product	<p>IFL is an insulation fault locating device with 12 channel for ungrounded power systems with isolated neutral. It works with Insulation monitoring device which detects that there is fault in the system and IFL locates where the fault has occurred in the system</p> <p>This device provides the following features:</p> <ul style="list-style-type: none"> • Fast fault location (time < 5 s). • Transient fault indication. • Relay for fault indication. • Individual LEDs for 12 channels. • Configurable thresholds (low, medium, and high) for alarm. • Configurable filtering times for highly disturbed ungrounded system. • Dedicated commissioning mode for quick installation verification. • Auto-detects and configures compatible toroids in commissioning mode.
Functional unit	<p>To monitor and detect during 10 years insulation fault of a power systems with isolated neutral.</p> <p>Type of earthing system = IT system $I_g = 3\text{mA}$ (IFL maximum fault current) $V_a \leq 1000\text{V}$ IP degree of protection- Case: IP20, Front face: IP54 Standards - IEC61557-9 Ed.2014, IEC61010-1 Ed.2010, UL 61010-1 Ed.2012, IEC61326-2-4 Ed.2012, IEC60364-4-41 Ed.2005</p>

Constituent materials

Reference product mass	533 g including the product, its packaging and additional elements and accessories
------------------------	--

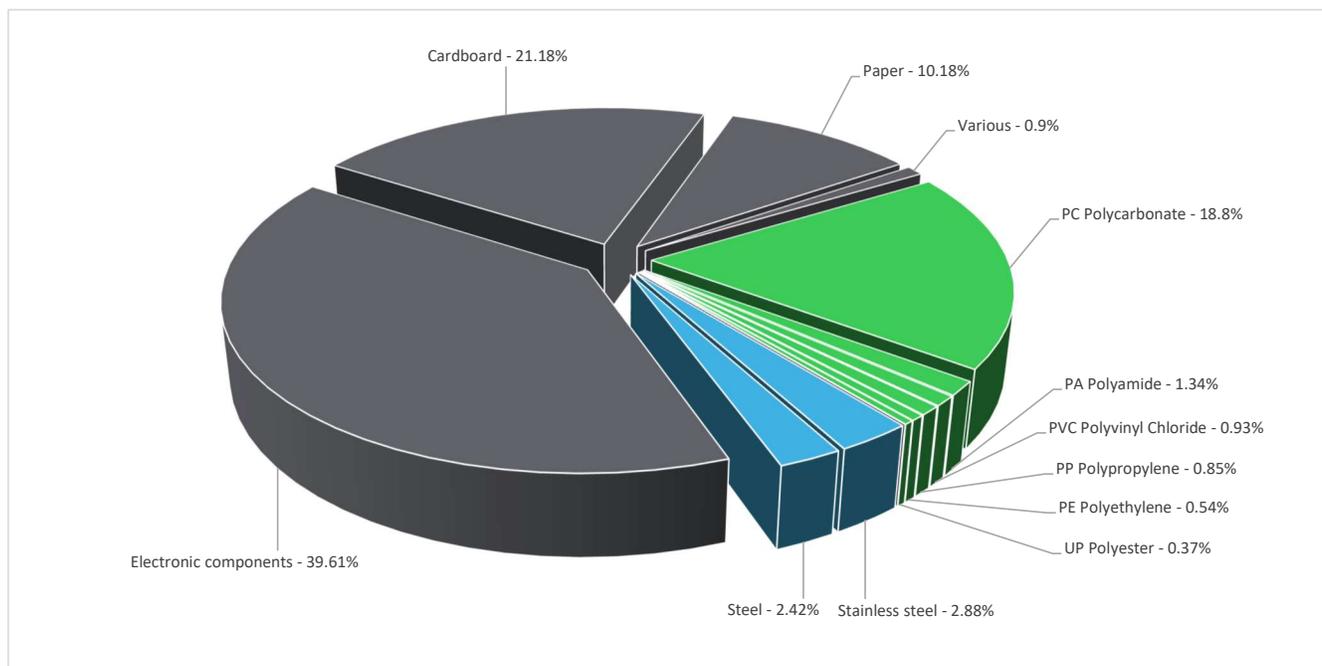

Plastics	22.8%
Metals	5.3%
Others	71.9%

Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website
<https://www.se.com/ww/en/work/support/green-premium/>

**Additional environmental information**

End Of Life	Recyclability potential:	8%	Recyclability rate has been calculated based on REEECY'LAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the "ECO'DEEE recyclability and recoverability calculation method" was taken. If no data was found a conservative assumption was used (0% recyclability).
-------------	--------------------------	----	---

**Environmental impacts**

Reference service life time	10 years			
Product category	Other equipments - Active product			
Installation elements	The packaging is disposed of during the installation phase			
Use scenario	The product is in active mode 5% of the time with a power use of 16.2W and in stand-by mode 95% of the time with a power use of 10.12W for 10 years			
Technological representativeness	The Modules of Technologies such as material production, manufacturing process and transport technology used in this PEP analysis (LCA-EIME in this case) are Similar and representative of the actual type of technologies used to make the product in production.			
Geographical representativeness	Global			
Energy model used	[A1 - A3]	[A5]	[B6]	[C1 - C4]
	Electricity Mix; Production mix; Low voltage; IN	Electricity Mix; Production mix; Low voltage; UE-27	Electricity Mix; Production mix; Low voltage; UE-27	Electricity Mix; Production mix; Low voltage; UE-27
		Electricity Mix; Production mix; Low voltage; APAC	Electricity Mix; Production mix; Low voltage; APAC	Electricity Mix; Production mix; Low voltage; APAC
		Electricity Mix; Production mix; Low voltage; TR	Electricity Mix; Production mix; Low voltage; TR	Electricity Mix; Production mix; Low voltage; TR

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators		VigiloHM Insulation Fault Locator - IMDIFL12MCT						
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life	Benefits
			[A1 - A3]	[A4]	[A5]	[B1 - B7]	[C1 - C4]	[D]
Contribution to climate change	kg CO2 eq	6.48E+02	9.82E+01	1.54E-01	3.01E-01	5.49E+02	7.45E-01	-6.18E-01
Contribution to climate change-fossil	kg CO2 eq	6.48E+02	9.81E+01	1.54E-01	2.88E-01	5.48E+02	7.25E-01	-6.05E-01
Contribution to climate change-biogenic	kg CO2 eq	5.59E-01	1.33E-01	0*	1.34E-02	3.92E-01	1.99E-02	-1.31E-02
Contribution to climate change-land use and land use change	kg CO2 eq	1.96E-07	1.96E-07	0*	0*	0*	0*	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	3.28E-05	3.00E-05	1.36E-07	2.00E-08	2.61E-06	2.68E-08	-5.10E-08
Contribution to acidification	mol H+ eq	4.07E+00	5.64E-01	6.68E-04	1.20E-03	3.49E+00	1.03E-02	-3.17E-03
Contribution to eutrophication, freshwater	kg (PO4) ³⁻ eq	6.68E-04	1.70E-04	0*	2.18E-06	4.88E-04	7.02E-06	-4.10E-06
Contribution to eutrophication marine	kg N eq	4.82E-01	8.56E-02	3.07E-04	3.17E-04	3.88E-01	7.26E-03	-5.92E-04
Contribution to eutrophication, terrestrial	mol N eq	5.73E+00	9.10E-01	3.32E-03	2.39E-03	4.81E+00	3.90E-03	-5.40E-03
Contribution to photochemical ozone formation - human health	kg COVNM eq	1.60E+00	3.14E-01	1.09E-03	6.39E-04	1.28E+00	1.57E-03	-1.57E-03
Contribution to resource use, minerals and metals	kg Sb eq	1.21E-02	1.21E-02	0*	0*	1.86E-05	0*	-7.01E-05
Contribution to resource use, fossils	MJ	1.14E+04	1.14E+03	1.87E+00	3.14E+00	1.02E+04	9.84E+00	-8.60E+00
Contribution to water use	m3 eq	1.78E+02	2.76E+01	0*	1.29E-01	2.13E+01	1.29E+02	-3.25E-01

Additional indicators for the French regulation are available as well

Inventory flows indicators		VigiloHM Insulation Fault Locator - IMDIFL12MCT						
Inventory flows	Unit	Total	Manufact. [A1 - A3]	Distribution [A4]	Installation [A5]	Use [B1 - B7]	End of Life [C1 - C4]	Benefits [D]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	1.57E+03	3.19E+01	0*	2.25E-01	1.53E+03	5.66E-01	1.77E+00
Contribution to use of renewable primary energy resources used as raw material	MJ	3.22E+00	3.22E+00	0*	0*	0*	0*	-3.03E+00
Contribution to total use of renewable primary energy resources	MJ	1.57E+03	3.51E+01	0*	2.25E-01	1.53E+03	5.66E-01	-1.26E+00
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	1.14E+04	1.14E+03	1.87E+00	3.14E+00	1.02E+04	9.84E+00	-8.60E+00
Contribution to use of non renewable primary energy resources used as raw material	MJ	5.85E+00	5.85E+00	0*	0*	0*	0*	0.00E+00
Contribution to total use of non-renewable primary energy resources	MJ	1.14E+04	1.14E+03	1.87E+00	3.14E+00	1.02E+04	9.84E+00	-8.60E+00
Contribution to use of secondary material	kg	5.31E-05	5.31E-05	0*	0*	0*	0*	0.00E+00
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to net use of freshwater	m³	4.52E+00	6.42E-01	0*	3.00E-03	4.95E-01	3.38E+00	-7.58E-03
Contribution to hazardous waste disposed	kg	2.31E+02	2.18E+02	0*	0*	1.31E+01	3.87E-01	-5.54E+00
Contribution to non hazardous waste disposed	kg	1.10E+02	2.19E+01	0*	9.81E-01	8.65E+01	1.58E-01	-4.57E+00
Contribution to radioactive waste disposed	kg	3.56E-02	2.48E-02	3.05E-05	1.32E-04	1.07E-02	1.19E-05	-3.07E-04
Contribution to components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to materials for recycling	kg	1.96E-01	0*	0*	1.66E-01	0*	3.06E-02	0.00E+00
Contribution to materials for energy recovery	kg	6.86E-09	6.86E-09	0*	0*	0*	0*	0.00E+00
Contribution to exported energy	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to biogenic carbon content of the product	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to biogenic carbon content of the associated packaging	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v5.9.4, database version 2022-01 in compliance with ISO14044.

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	ENVPEP1712006_V2	Drafting rules	PEP-PCR-ed4-2021 09 06
Verifier accreditation N°		Supplemented by	PSR-0005-ed2-2016 03 29
Date of issue	2023/12	Information and reference documents	www.pep-ecopassport.org
		Validity period	5 years
Independent verification of the declaration and data, in compliance with ISO 14021 : 2016			
Internal	X	External	
The PCR review was conducted by a panel of experts chaired by Julie ORGELET (DDemain)			
PEP are compliant with XP C08-100-1 :2016 or EN 50693:2019			
The elements of the present PEP cannot be compared with elements from another program.			
Document in compliance with ISO 14021 : 2016 « Environmental labels and declarations. Type II environmental declarations »			

Schneider Electric Industries SAS
Country Customer Care Center
<http://www.schneider-electric.com/contact>
35, rue Joseph Monier
CS 30323
F- 92500 Rueil Malmaison Cedex
RCS Nanterre 954 503 439
Capital social 896 313 776 €

www.se.com

SCHN-00287-V02.01-EN

Published by Schneider Electric

©2023 - Schneider Electric – All rights reserved

2023/12