Product Environmental Profile


PowerLogic[™] PM32xx series Power Meter







| General information | | | | | | | | | |
|----------------------------|---|--|--|--|--|--|--|--|--|
| | | | | | | | | | |
| Reference product | PowerLogic™ PM32xx series Power Meter - METSEPM3255 | | | | | | | | |
| Description of the product | The PowerLogic [™] PM32xx series Power Meter is a cost-attractive, feature-rich range of DIN railmounted power meters ideal for power metering and network monitoring application in addition to sub-billing and cost allocation applications. | | | | | | | | |
| Description of the range | Single product | | | | | | | | |
| Functional unit | PowerLogic™ PM32xx series is a power meter with an LCD display. The meter will measure Energy, Active and Reactive Power, Voltage, Current, Frequency, Power Factor, Apparent Power, Total Harmonic Distortion and up to 15th Harmonic during 10 years. | | | | | | | | |
| Specifications are: | Supply voltage = 100 to 277VAC, 173 to 480VAC and 100 to 300VDC Network frequency: 50 - 60Hz Sampling rate : 32 samples/cycle Pollution degree: 2 IP40 front panel and IP20 body Degree of protection in accordance with the standard IEC 60529 | | | | | | | | |

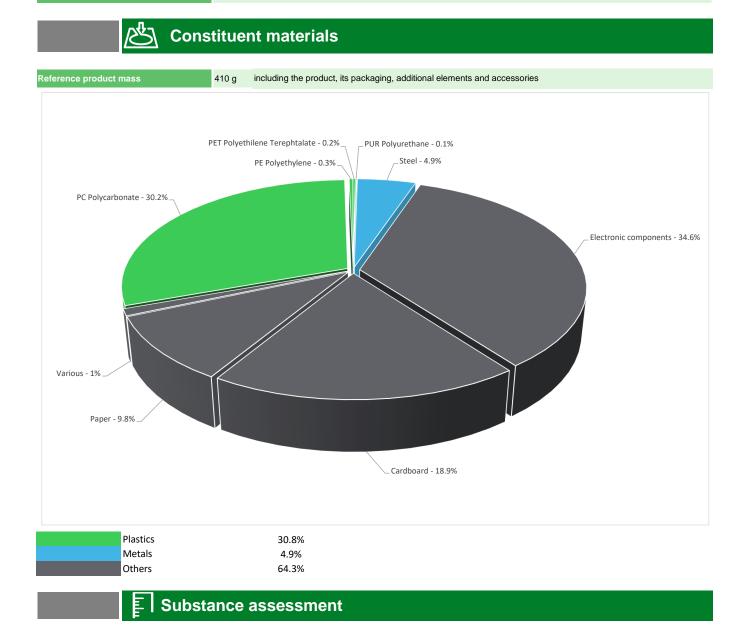

Details of ROHS and REACH substances information are available on the Schneider-Electric website

https://www.se.com

(1) Additional environmental information

```
End Of Life
```

Recyclability potential:

The recyclability rate was calculated from the recycling rates of each material making up the product based on REEECY'LAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the EIME database and the related PSR was taken. If no data was found a conservative assumption was used (0% recyclability).

9%

| Reference service life time | 10 years | | | | | | | | | |
|----------------------------------|--|----------------|---|---|--|--|--|--|--|--|
| Product category | Other equipments - Active product | | | | | | | | | |
| Life cycle of the product | The manufacturing, the distribution, the installation, the use and the end of life were taken into consideration in this study | | | | | | | | | |
| Electricity consumtion | The electricity consumed during manufacturing processes is considered for each part of the product individually, the final assembly generates a negligable consumption | | | | | | | | | |
| Installation elements | The product does not require special installation p materials are accounted for during the installation | | | al of the packaging | | | | | | |
| Use scenario | The product is in active mode 5% of the time with a power use of 3W, in stand-by mode 70% of the time with a power use of 2.4W and in sleep mode 25% of the time with a power use of 2.04W, for 10 years | | | | | | | | | |
| Time representativeness | The collected data are representative of the year 2024 | | | | | | | | | |
| Technological representativeness | The Modules of Technologies such as material production, manufacturing processes and transport technology used in the PEP analysis (LCA EIME in the case) are Similar and représentaive of the actual type of technologies used to make the product. | | | | | | | | | |
| Geographical | Final assembly site | Use | End-of-life | | | | | | | |
| representativeness | China | Gle | obal | Global | | | | | | |
| | [A1 - A3] | [A5] | [B6] | [C1 - C4] | | | | | | |
| Energy model used | Electricity Mix; Low voltage; 2020; China, CN | No energy used | Electricity Mix; Low voltage; 2020; Europe, EU-27 Electricity Mix; Low voltage; 2020; United States, US Electricity Mix; Low voltage; 2020; Asia Pacific, APAC Electricity Mix; Low voltage; 2020; Australia, AU | Global, European and French datasets are used. | | | | | | |

Detailed results of the optional indicators mentioned in PCRed4 are available in the LCA report and on demand in a digital format - Country Customer Care Center - http://www.se.com/contact

| Mandatory Indicators | PowerLogic [™] PM32xx series Power Meter - METSEPM3255 | | | | | | | |
|--|---|-----------------------------|------------------------------|------------------------|------------------------|-----------------|----------------------------|-----------------------------|
| Impact indicators | Unit | Total (without Module D) | [A1 - A3] - Manufacturing | [A4] - Distribution | [A5] - Installation | [B1 - B7] - Use | [C1 - C4] - End of life | [D] - Benefits and loads |
| Contribution to climate change | kg CO2 eq | 1.05E+02 | 1.15E+01 | 1.06E+00 | 0* | 9.21E+01 | 8.16E-01 | -9.06E-02 |
| Contribution to climate change-fossil | kg CO2 eq | 1.05E+02 | 1.15E+01 | 1.06E+00 | 0* | 9.20E+01 | 8.15E-01 | -8.92E-02 |
| Contribution to climate change-biogenic | kg CO2 eq | 6.38E-02 | 0* | 0* | 0* | 1.27E-01 | 1.24E-03 | -1.36E-03 |
| Contribution to climate change-land use and land use change | e kg CO2 eq | 1.58E-04 | 1.58E-04 | 0* | 0* | 0* | 2.06E-08 | 0.00E+00 |
| Contribution to ozone depletion | kg CFC-11 eq | 2.81E-06 | 1.43E-06 | 9.33E-07 | 0* | 4.41E-07 | 2.08E-09 | -1.53E-08 |
| Contribution to acidification | mol H+ eq | 5.97E-01 | 8.07E-02 | 4.36E-03 | 6.36E-05 | 5.11E-01 | 8.93E-04 | -1.44E-03 |
| Contribution to eutrophication, freshwater | kg P eq | 2.38E-04 | 3.84E-05 | 1.24E-07 | 0* | 1.59E-04 | 4.13E-05 | -1.35E-07 |
| Contribution to eutrophication marine | kg N eq | 7.15E-02 | 8.93E-03 | 1.99E-03 | 2.99E-05 | 6.02E-02 | 3.05E-04 | -5.91E-05 |
| Contribution to eutrophication, terrestrial | mol N eq | 9.58E-01 | 9.49E-02 | 2.15E-02 | 3.06E-04 | 8.38E-01 | 3.31E-03 | -6.91E-04 |
| Contribution to photochemical ozone formation - human health | kg COVNM eq | 2.35E-01 | 3.20E-02 | 7.18E-03 | 7.32E-05 | 1.95E-01 | 8.46E-04 | -2.92E-04 |
| Contribution to resource use, minerals and metals | kg Sb eq | 3.21E-03 | 3.18E-03 | 0* | 0* | 2.45E-05 | 1.26E-06 | -3.28E-05 |
| Contribution to resource use, fossils | MJ | 2.20E+03 | 1.66E+02 | 1.32E+01 | 0* | 2.01E+03 | 5.50E+00 | -2.03E+00 |
| Contribution to water use | m3 eq | 1.05E+01 | 3.92E+00 | 5.36E-02 | 1.14E-02 | 6.26E+00 | 3.00E-01 | -8.38E-02 |

| Inventory flows Indicators | PowerLogic™ PM32xx series Power Meter - METSEPM3255 | | | | | | | | | |
|--|---|-----------------------------|------------------------------|------------------------|------------------------|-----------------|----------------------------|-----------------------------|--|--|
| Inventory flows | Unit | Total (without Module D) | [A1 - A3] - Manufacturing | [A4] - Distribution | [A5] - Installation | [B1 - B7] - Use | [C1 - C4] - End of life | [D] - Benefits and loads | | |
| Contribution to use of renewable primary energy excluding renewable primary energy used as raw material | MJ | 4.55E+02 | 4.17E+00 | 0* | 0* | 4.51E+02 | 0* | -3.97E-02 | | |
| Contribution to use of renewable primary energy resources used as raw material | MJ | 2.36E+00 | 2.36E+00 | 0* | 0* | 0* | 0* | 0.00E+00 | | |
| Contribution to total use of renewable primary energy resources | MJ | 4.58E+02 | 6.54E+00 | 0* | 0* | 4.51E+02 | 0* | -3.97E-02 | | |
| Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material | MJ | 2.19E+03 | 1.60E+02 | 1.32E+01 | 0* | 2.01E+03 | 5.50E+00 | -2.03E+00 | | |
| Contribution to use of non renewable primary energy resources used as raw material | MJ | 6.24E+00 | 6.24E+00 | 0* | 0* | 0* | 0* | 0.00E+00 | | |
| Contribution to total use of non-renewable primary energy resources | MJ | 2.20E+03 | 1.66E+02 | 1.32E+01 | 0* | 2.01E+03 | 5.50E+00 | -2.03E+00 | | |
| Contribution to use of secondary material | kg | 4.17E-05 | 4.17E-05 | 0* | 0* | 0* | 0* | 0.00E+00 | | |
| Contribution to use of renewable secondary fuels | MJ | 0.00E+00 | 0* | 0* | 0* | 0* | 0* | 0.00E+00 | | |
| Contribution to use of non renewable secondary fuels | MJ | 0.00E+00 | 0* | 0* | 0* | 0* | 0* | 0.00E+00 | | |
| Contribution to net use of freshwater | m³ | 2.51E-01 | 9.12E-02 | 1.25E-03 | 2.66E-04 | 1.47E-01 | 1.20E-02 | -2.09E-03 | | |
| Contribution to hazardous waste disposed | kg | 6.52E+01 | 6.18E+01 | 0* | 0* | 3.27E+00 | 1.40E-01 | -2.69E+00 | | |
| Contribution to non hazardous waste disposed | kg | 2.09E+01 | 4.70E+00 | 0* | 1.22E-01 | 1.60E+01 | 1.44E-01 | -6.47E-02 | | |
| Contribution to radioactive waste disposed | kg | 4.36E-03 | 1.30E-03 | 2.10E-04 | 0* | 2.85E-03 | 6.40E-06 | -2.97E-05 | | |
| Contribution to components for reuse | kg | 0.00E+00 | 0* | 0* | 0* | 0* | 0* | 0.00E+00 | | |
| Contribution to materials for recycling | kg | 2.68E-02 | 5.00E-04 | 0* | 0* | 0* | 2.63E-02 | 0.00E+00 | | |
| Contribution to materials for energy recovery | kg | 0.00E+00 | 0* | 0* | 0* | 0* | 0* | 0.00E+00 | | |
| Contribution to exported energy | MJ | 2.12E-04 | 1.24E-05 | 0* | 0* | 0* | 2.00E-04 | 0.00E+00 | | |

* represents less than 0.01% of the total life cycle of the reference flow

 Contribution to biogenic carbon content of the product
 kg of C
 0.00E+00

 Contribution to biogenic carbon content of the associated packaging
 kg of C
 3.79E-02

* The calculation of the biogenic carbon is based on the Ademe for the Cardboard (28%), EN16485 for Wood (39,52%), and APESA/RECORD for Paper (37,8%)

| Mandatory Indicators | | PowerLogic | ™ PM32xx | series I | Power M | eter - METSEPM | 13255 | | |
|--|-----------------|-----------------|----------|----------|---------|----------------|-------|----------|------|
| Impact indicators | Unit | [B1 - B7] - Use | [B1] | [B2] | [B3] | [B4] | [B5] | [B6] | [B7] |
| Contribution to climate change | kg CO2 eq | 9.21E+01 | 0* | 0* | 0* | 0* | 0* | 9.21E+01 | 0* |
| Contribution to climate change-fossil | kg CO2 eq | 9.20E+01 | 0* | 0* | 0* | 0* | 0* | 9.20E+01 | 0* |
| Contribution to climate change-biogenic | kg CO2 eq | 1.27E-01 | 0* | 0* | 0* | 0* | 0* | 1.27E-01 | 0* |
| Contribution to climate change-land use and land use chang | e kg CO2 eq | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| Contribution to ozone depletion | kg CFC-11 eq | 4.41E-07 | 0* | 0* | 0* | 0* | 0* | 4.41E-07 | 0* |
| Contribution to acidification | mol H+ eq | 5.11E-01 | 0* | 0* | 0* | 0* | 0* | 5.11E-01 | 0* |
| Contribution to eutrophication, freshwater | kg P eq | 1.59E-04 | 0* | 0* | 0* | 0* | 0* | 1.59E-04 | 0* |
| Contribution to eutrophication marine | kg N eq | 6.02E-02 | 0* | 0* | 0* | 0* | 0* | 6.02E-02 | 0* |
| Contribution to eutrophication, terrestrial | mol N eq | 8.38E-01 | 0* | 0* | 0* | 0* | 0* | 8.38E-01 | 0* |
| Contribution to photochemical ozone formation - human health | kg COVNM eq | 1.95E-01 | 0* | 0* | 0* | 0* | 0* | 1.95E-01 | 0* |
| Contribution to resource use, minerals and metals | kg Sb eq | 2.45E-05 | 0* | 0* | 0* | 0* | 0* | 2.45E-05 | 0* |
| Contribution to resource use, fossils | MJ | 2.01E+03 | 0* | 0* | 0* | 0* | 0* | 2.01E+03 | 0* |
| Contribution to water use | m3 eq | 6.26E+00 | 0* | 0* | 0* | 0* | 0* | 6.26E+00 | 0* |

| Inventory flows Indicators | | | | PowerLogic™ | [™] PM32xx | series I | Power Me | eter - METSEPN | 13255 |
|---|------|-----------------|------|-------------|---------------------|----------|----------|----------------|-------|
| Inventory flows | Unit | [B1 - B7] - Use | [B1] | [B2] | [B3] | [B4] | [B5] | [B6] | [B7] |
| ontribution to use of renewable primary energy excluding newable primary energy used as raw material | MJ | 4.51E+02 | 0* | 0* | 0* | 0* | 0* | 4.51E+02 | 0* |
| ontribution to use of renewable primary energy resources ed as raw material | MJ | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| ontribution to total use of renewable primary energy sources | MJ | 4.51E+02 | 0* | 0* | 0* | 0* | 0* | 4.51E+02 | 0* |
| ontribution to use of non renewable primary energy cluding non renewable primary energy used as raw material | MJ | 2.01E+03 | 0* | 0* | 0* | 0* | 0* | 2.01E+03 | 0* |
| ntribution to use of non renewable primary energy sources used as raw material | MJ | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| tribution to total use of non-renewable primary energy purces | MJ | 2.01E+03 | 0* | 0* | 0* | 0* | 0* | 2.01E+03 | 0* |
| ntribution to use of secondary material | kg | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| tribution to use of renewable secondary fuels | MJ | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| ribution to use of non renewable secondary fuels | MJ | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| ibution to net use of freshwater | m³ | 1.47E-01 | 0* | 0* | 0* | 0* | 0* | 1.47E-01 | 0* |
| ribution to hazardous waste disposed | kg | 3.27E+00 | 0* | 0* | 0* | 0* | 0* | 3.27E+00 | 0* |
| ibution to non hazardous waste disposed | kg | 1.60E+01 | 0* | 0* | 0* | 0* | 0* | 1.60E+01 | 0* |
| ribution to radioactive waste disposed | kg | 2.85E-03 | 0* | 0* | 0* | 0* | 0* | 2.85E-03 | 0* |
| ibution to components for reuse | kg | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| bution to materials for recycling | kg | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| ibution to materials for energy recovery | kg | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |
| ribution to exported energy | MJ | 0* | 0* | 0* | 0* | 0* | 0* | 0* | 0* |

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v6.2.4, database version 2024-01 in compliance with ISO14044, EF3.1 method is applied, for biogenic carbon storage, assessment methodology -1/1 is used

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

| Registration number : | SCHN-01357-V01.01-EN | Drafting rules | PEP-PCR-ed4-2021 09 06 | | | | | | |
|---|---|-------------------------------------|-------------------------|--|--|--|--|--|--|
| | | Supplemented by | PSR-0005-ed3-2023 06 06 | | | | | | |
| Verifier accreditation N° | VH48 | Information and reference documents | www.pep-ecopassport.org | | | | | | |
| Date of issue | 01-2025 | 01-2025 Validity period 5 | | | | | | | |
| Independent verification of the declaration and data, in compliance with ISO 14025 : 2006 | | | | | | | | | |
| Internal | Internal External X | | | | | | | | |
| The PCR review was conducted | The PCR review was conducted by a panel of experts chaired by Julie Orgelet (DDemain) | | | | | | | | |
| PEPs are compliant with XP C08-100-1:2016 and EN 50693:2019 or NF E38-500 :2022 | | | | | | | | | |
| PEPs are compliant with XP C08-100-1:2016 and EN 50693:2019 or NF E38-500 :2022 The components of the present PEP may not be compared with components from any other program. | | | | | | | | | |
| Document complies with ISO 14025:2006 "Environmental labels and declarations. Type III environmental declarations" | | | | | | | | | |

Schneider Electric Industries SAS Country Customer Care Center http://www.se.com/contact Head Office 35, rue Joseph Monier CS 30323 F- 92500 Rueil Malmaison Cedex RCS Nanterre 954 503 439 Capital social 928 298 512 €

www.se.com

SCHN-01357-V01.01-EN

Published by Schneider Electric

©2024 - Schneider Electric - All rights reserved

01-2025