

# Product Environmental Profile

## Harmony XVU Tower Light






## General information

Reference product	Harmony XVU Tower Light - XVUC21B, XVUC24, XVUC23,XVUC28,XVUZ02
Description of the product	The representative product used for the analysis is illuminated LED indicator bank consisting of various units (XVUC21B, XVUC24, XVUC23,XVUC28,XVUZ02).This Harmony XVU modular range of tower lights are visual and audible signaling units indicating various states, operation sequence or installation of a machine. Reduced diameter Ø 60 mm makes them suitable for use on small equipment and their aesthetic design distinguishes them from other tower lights. The availability of black and metallic silver body makes them ideal for use in automotive, machine tools, material handling and electronic equipment industry.
Functional unit	This Harmony XVU modular range of tower lights are 360° pilot lights and commonly used signaling product for a wide range of applications. These tower lights are visual and audible signaling units that comes with a combination of innovative features high performance and simplicity.It has power consumption of 0.96 W with use rate of 73% for a period of 10 years.



## Constituent materials

Reference product mass	1024.98 g including the product, its packaging and additional elements and accessories
------------------------	--

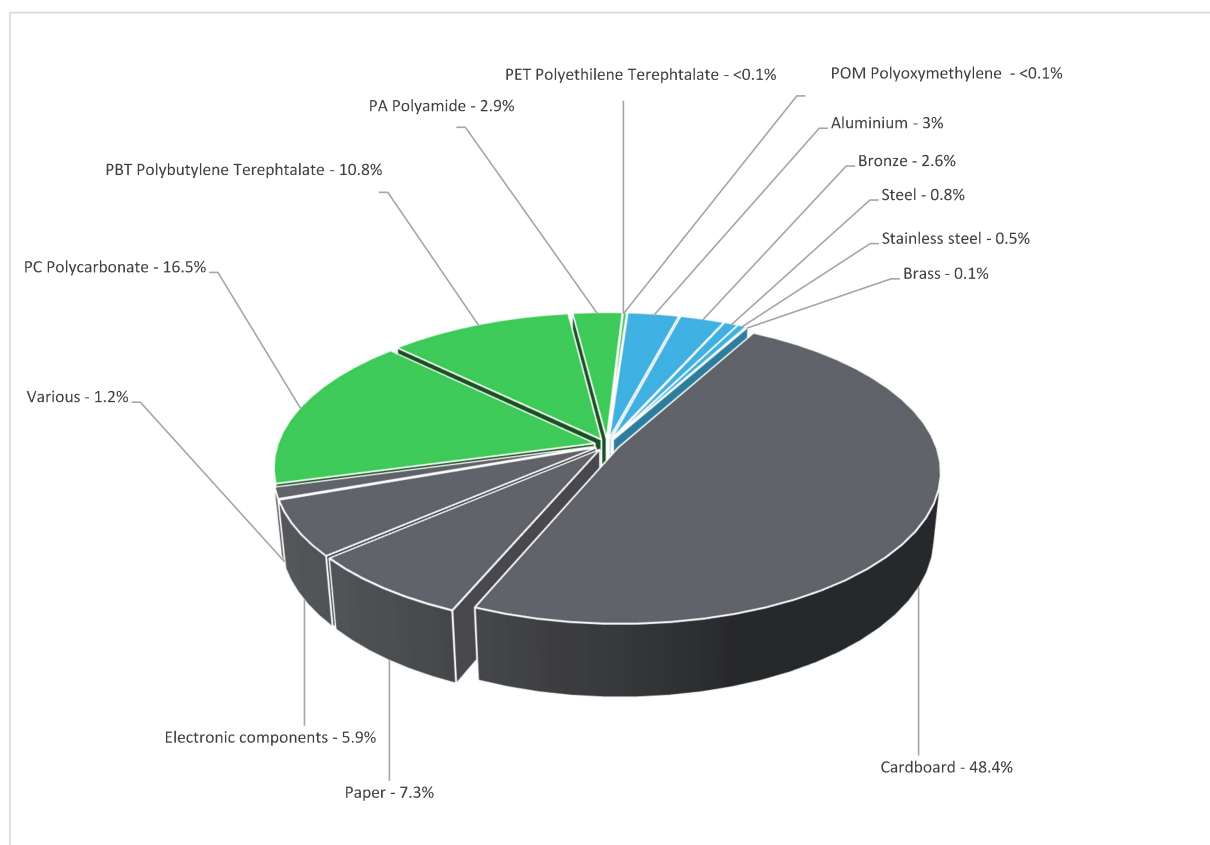

Others	62.8%
Plastics	30.2%
Metals	7.0%



## Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website

<https://www.se.com/ww/en/work/support/green-premium/>



## Additional environmental information

End Of Life	Recyclability potential:	16%	Recyclability rate has been calculated based on REEECYLAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the "ECO'DEEE recyclability and recoverability calculation method" was taken. If no data was found a conservative assumption was used (0% recyclability).
-------------	--------------------------	-----	--



## Environmental impacts

Reference service life time	10 years			
Product category	Other equipments - Active product			
Installation elements	No special installation components need during installation phase, but transport of packaging to disposal, and disposal of packaging accounted for during installation.			
Use scenario	The product is in active mode 73% of the time with a power use of 0.96 W and in stand by mode 27% of the time with a power use of 0 W for 10 years			
Technological representativeness	The Modules of Technologies such as material production, manufacturing process and transport technology used in this PEP analysis (LCA-EIME in this case) are similar and representative of the actual type of technologies used to make the product.			
Geographical representativeness	Global			
Energy model used	[A1 - A3]	[A5]	[B6]	[C1 - C4]
	Electricity Mix; Production mix; Low voltage; ID	Electricity Mix; Production mix; Low voltage; UE-27	Electricity Mix; Production mix; Low voltage; UE-27	Electricity Mix; Production mix; Low voltage; UE-27
		Electricity Mix; Production mix; Low voltage; APAC	Electricity Mix; Production mix; Low voltage; APAC	Electricity Mix; Production mix; Low voltage; APAC
		Electricity Mix; Production mix; Low voltage; US	Electricity Mix; Production mix; Low voltage; US	Electricity Mix; Production mix; Low voltage; US
		Electricity Mix; Production mix; Low voltage; RU	Electricity Mix; Production mix; Low voltage; RU	Electricity Mix; Production mix; Low voltage; RU

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators			Harmony XVU Tower Light - XVUC21B, XVUC24, XVUC23,XVUC28,XVUZ02					
Impact indicators	Unit	Total	Manufacturing [A1 - A3]	Distribution [A4]	Installation [A5]	Use [B1 - B7]	End of Life [C1 - C4]	Loads and Benefits [D]
Contribution to climate change	kg CO2 eq	3.73E+01	6.74E+00	1.34E-01	1.06E+00	2.85E+01	8.93E-01	-1.99E+00
Contribution to climate change-fossil	kg CO2 eq	3.70E+01	6.59E+00	1.34E-01	1.01E+00	2.84E+01	8.87E-01	-1.93E+00
Contribution to climate change-biogenic	kg CO2 eq	2.39E-01	1.51E-01	0*	4.71E-02	3.47E-02	5.89E-03	-5.69E-02
Contribution to climate change-land use and land use change	kg CO2 eq	5.36E-09	5.36E-09	0*	0*	0*	0*	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	7.28E-07	5.25E-07	2.05E-10	7.02E-08	1.21E-07	1.17E-08	-1.70E-07
Contribution to acidification	mol H+ eq	2.31E-01	6.35E-02	8.62E-04	4.21E-03	1.59E-01	3.68E-03	-1.03E-02
Contribution to eutrophication, freshwater	kg (PO4) <sup>3-</sup> eq	1.04E-04	3.14E-05	5.02E-08	7.66E-06	6.27E-05	2.10E-06	-1.52E-05
Contribution to eutrophication marine	kg N eq	3.44E-02	1.23E-02	4.05E-04	1.11E-03	1.83E-02	2.30E-03	-1.94E-03
Contribution to eutrophication, terrestrial	mol N eq	4.01E-01	1.30E-01	4.44E-03	8.41E-03	2.55E-01	2.79E-03	-1.73E-02
Contribution to photochemical ozone formation - human health	kg COVNM eq	1.03E-01	3.91E-02	1.12E-03	2.25E-03	5.94E-02	9.38E-04	-4.91E-03
Contribution to resource use, minerals and metals	kg Sb eq	1.66E-04	1.64E-04	0*	3.54E-08	1.70E-06	0*	-3.58E-05
Contribution to resource use, fossils	MJ	7.99E+02	1.05E+02	1.87E+00	1.10E+01	6.70E+02	1.06E+01	-2.08E+01
Contribution to water use	m3 eq	5.02E+01	1.01E+01	0*	4.53E-01	1.01E+00	3.86E+01	-9.68E-01

Additional indicators for the French regulation are available as well

Inventory flows Indicators			Harmony XVU Tower Light - XVUC21B, XVUC24, XVUC23,XVUC28,XVUZ02					
Inventory flows	Unit	Total	Manufact.	Distribution	Installation	Use	End of Life	Loads and Benefits
			[A1 - A3]	[A4]	[A5]	[B1 - B7]	[C1 - C4]	[D]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	1.10E+02	0*	0*	7.92E-01	1.14E+02	1.71E-01	5.98E+00
Contribution to use of renewable primary energy resources used as raw material	MJ	1.14E+01	1.14E+01	0*	0*	0*	0*	-1.05E+01
Contribution to total use of renewable primary energy resources	MJ	1.22E+02	6.90E+00	0*	7.92E-01	1.14E+02	1.71E-01	-4.51E+00
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	7.87E+02	9.40E+01	1.87E+00	1.10E+01	6.70E+02	1.06E+01	-2.08E+01
Contribution to use of non renewable primary energy resources used as raw material	MJ	1.15E+01	1.15E+01	0*	0*	0*	0*	0.00E+00
Contribution to total use of non-renewable primary energy resources	MJ	7.99E+02	1.05E+02	1.87E+00	1.10E+01	6.70E+02	1.06E+01	-2.08E+01
Contribution to use of secondary material	kg	1.10E-05	1.10E-05	0*	0*	0*	0*	0.00E+00
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to net use of freshwater	m³	1.28E+00	2.36E-01	0*	1.05E-02	2.35E-02	1.01E+00	-2.25E-02
Contribution to hazardous waste disposed	kg	2.54E+00	1.52E+00	0*	1.25E-02	5.42E-01	4.66E-01	-2.76E+00
Contribution to non hazardous waste disposed	kg	2.59E+01	1.81E+01	4.70E-03	3.45E+00	4.13E+00	2.25E-01	-1.60E+01
Contribution to radioactive waste disposed	kg	4.46E-03	3.16E-03	3.35E-06	4.63E-04	8.27E-04	1.06E-05	-1.40E-03
Contribution to components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to materials for recycling	kg	6.54E-01	0*	0*	5.83E-01	0*	7.19E-02	0.00E+00
Contribution to materials for energy recovery	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to exported energy	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to biogenic carbon content of the product	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to biogenic carbon content of the associated packaging	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00

\* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v5.9.4, database version 2022-01 in compliance with ISO14044.

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	ENVPEP2308032_V1	Drafting rules	PEP-PCR-ed4-2021 09 06
		Supplemented by	PSR-0005-ed2-2016 03 29
Date of issue	10/2023	Information and reference documents	www.pep-ecopassport.org
		Validity period	5 years
Independent verification of the declaration and data, in compliance with ISO 14021 : 2016			
Internal <input checked="" type="checkbox"/> External <input type="checkbox"/>			
The PCR review was conducted by a panel of experts chaired by Julie ORGELET (DDemain)			
PEP are compliant with XP C08-100-1 :2016 or EN 50693:2019			
The elements of the present PEP cannot be compared with elements from another program.			
Document in compliance with ISO 14021 : 2016 « Environmental labels and declarations. Type II environmental declarations »			

Schneider Electric Industries SAS  
Country Customer Care Center  
<http://www.schneider-electric.com/contact>  
35, rue Joseph Monier  
CS 30323  
F- 92500 Rueil Malmaison Cedex  
RCS Nanterre 954 503 439  
Capital social 928 298 512 €

[www.se.com](http://www.se.com)

ENVPEP2308032\_V1

Published by Schneider Electric

©2023 - Schneider Electric – All rights reserved

10/2023