
# **Product Environmental Profile**

#### **LED Lamp for Enclosures**



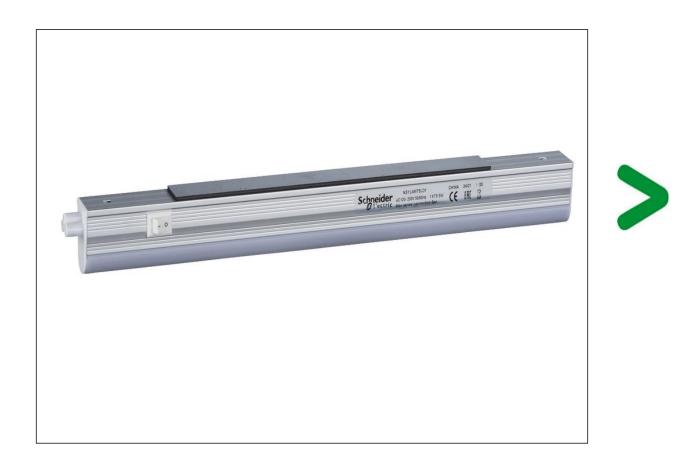


ENVPEP2202002\_V2 08-2025

### General information

Reference product	LED Lamp for Enclosures - NSYLAMT5LD1
Description of the product	The main purpose of the LED lamp is designed to optimise the cost benefit relation and can be used in almost all enclosures respecting the dimensions. These LED Lamps and door accesories designed to fit the needs of your electrical control panels. This lamp is designed to be used inside enclosures, allowing maintenance people to see inside the enclosure during maintenance operations. It is designed to be used only a couple a hours per month/year
Description of the range	Single product
Functional unit	The main function of the product is to Provide lighting that delivers an outgoing artificial luminous flux of 1000* lumens during a reference lifetime of 35000* hours while protecting against penetration of solid objects and liquids (IP20 - IEC 60529) as per standard IEC 60598.

<sup>\*</sup>Actual product having 500 lumens of luminous flux & 25000 hours of service life respectively. To ensure Comparability, We followed PSR Functional unit.

# Constituent materials

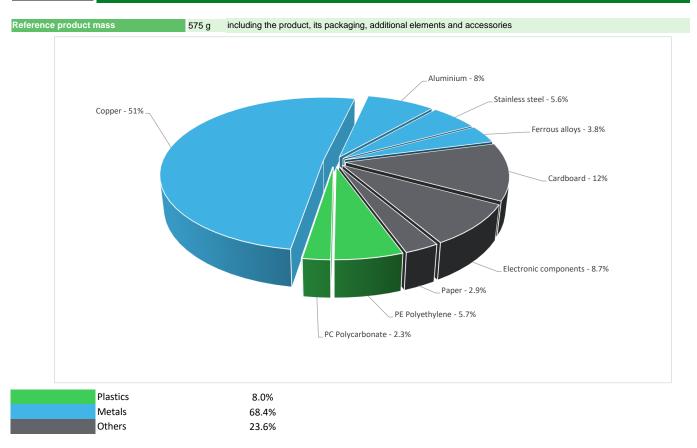

# **Substance assessment**

Details of ROHS and REACH substances information are available on the Schneider-Electric website <a href="https://www.se.com">https://www.se.com</a>

ENVPEP2202002\_V2 08-2025

## (1) Additional environmental information

End Of Life

Recyclability potential:

36%

The recyclability rate was calculated from the recycling rates of each material making up the product based on REEECY'LAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the EIME database and the related PSR was taken. If no data was found a conservative assumption was used (0% recyclability).

## **Environmental impacts**

Reference service life time	6.25 years									
Life cycle of the product	The manufacturing, the distribution, the installation, the use and the end of life were taken into consideration in this study									
Electricity consumtion	The electricity consumed during manufacturing p generates a negligible consumption	The electricity consumed during manufacturing processes is considered for each part of the product individually, the final assembly generates a negligible consumption								
Installation elements	No special installation components need during in accounted for during installation.	nstallation phase, but transport	of packaging to disposal and di	sposal of packaging						
Use scenario	The product is in active mode 46% of the time wi	The product is in active mode 46% of the time with a power use of 5W for 25000 Hours								
Time representativeness	The collected data are representative of the year 2025									
Technological representativeness	The Modules of Technologies such as material production, manufacturing processes and transport technology used in the PEP analysis (LCA EIME in the case) are similar and representative of the actual type of technologies used to make the product.									
Geographical	Final assembly site Use phase End-of-life									
representativeness	China Europe Europe									
	[A1 - A3]	[A5]	[B6]	[C1 - C4]						
Energy model used	Electricity Mix; Low voltage; 2020; China, CN	No energy used	Global, European and French datasets are used.							

Detailed results of the optional indicators mentioned in PCRed4 are available in the LCA report and on demand in a digital format - Country Customer Care Center - http://www.se.com/contact

Mandatory Indicators			LED Lamp for	Enclosures - NS	SYLAMT5LD1			
Impact indicators	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to climate change	kg CO2 eq	5.75E+01	5.38E+00	1.12E-01	1.37E-01	5.09E+01	9.50E-01	-9.55E-01
Contribution to climate change-fossil	kg CO2 eq	5.63E+01	5.31E+00	1.12E-01	1.32E-01	4.98E+01	9.27E-01	-1.02E+00
Contribution to climate change-biogenic	kg CO2 eq	1.21E+00	6.25E-02	0*	4.47E-03	1.12E+00	2.32E-02	6.21E-02
Contribution to climate change-land use and land use change	kg CO2 eq	1.22E-05	1.22E-05	0*	0*	0*	7.92E-08	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	8.39E-07	6.05E-07	1.72E-10	1.26E-09	2.18E-07	1.42E-08	-1.64E-07
Contribution to acidification	mol H+ eq	3.39E-01	7.00E-02	7.09E-04	3.08E-04	2.66E-01	2.00E-03	-1.95E-02
Contribution to eutrophication, freshwater	kg P eq	1.49E-04	2.23E-05	4.20E-08	2.40E-06	1.22E-04	2.74E-06	-5.04E-06
Contribution to eutrophication, marine	kg N eq	3.97E-02	7.50E-03	3.32E-04	1.24E-04	3.12E-02	5.33E-04	-7.76E-04
Contribution to eutrophication, terrestrial	mol N eq	5.92E-01	8.13E-02	3.65E-03	9.09E-04	5.00E-01	5.92E-03	-8.34E-03
Contribution to photochemical ozone formation - human health	kg COVNM eq	1.27E-01	2.57E-02	9.20E-04	2.05E-04	9.88E-02	1.55E-03	-3.52E-03
Contribution to resource use, minerals and metals	kg Sb eq	1.19E-03	1.17E-03	0*	0*	1.65E-05	0*	-1.78E-04
Contribution to resource use, fossils	MJ	1.32E+03	9.50E+01	1.56E+00	1.07E+00	1.22E+03	5.51E+00	-1.66E+01
Contribution to water use	m3 eq	7.66E+00	3.72E+00	0*	1.17E-02	3.86E+00	6.78E-02	-9.21E-01

ENVPEP2202002\_V2 08-2025

Inventory flows Indicators	LED Lamp for Enclosures - NSYLAMT5LD1							
Inventory flows	Unit	Total (without Module D)	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life	[D] - Benefits and loads
Contribution to renewable primary energy used as energy	MJ	2.89E+02	2.62E+00	0*	1.52E-01	2.86E+02	2.56E-01	-5.09E-01
Contribution to renewable primary energy used as raw material	MJ	1.71E+00	1.71E+00	0*	0*	0*	0*	-1.27E+00
Contribution to total renewable primary energy	MJ	2.91E+02	4.32E+00	0*	1.52E-01	2.86E+02	2.56E-01	-1.78E+00
Contribution to non renewable primary energy used as energy	MJ	1.32E+03	9.03E+01	1.56E+00	1.07E+00	1.22E+03	5.51E+00	-1.59E+01
Contribution to non renewable primary energy used as raw material	MJ	4.71E+00	4.71E+00	0*	0*	0*	0*	-6.24E-01
Contribution to total non renewable primary energy	MJ	1.32E+03	9.50E+01	1.56E+00	1.07E+00	1.22E+03	5.51E+00	-1.66E+01
Contribution to use of secondary material	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to net use of fresh water	m³	1.79E-01	8.65E-02	0*	2.69E-04	9.02E-02	1.85E-03	-2.14E-02
Contribution to hazardous waste disposed	kg	3.64E+01	3.47E+01	0*	0*	1.41E+00	2.48E-01	-1.38E+01
Contribution to non hazardous waste disposed	kg	1.20E+01	4.13E+00	3.93E-03	6.10E-02	7.67E+00	1.71E-01	-1.23E+00
Contribution to radioactive waste disposed	kg	4.30E-03	2.47E-03	2.80E-06	5.75E-06	1.81E-03	1.26E-05	-9.32E-04
Contribution to components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to materials for recycling	kg	2.20E-01	4.31E-02	0*	1.33E-02	0*	1.64E-01	0.00E+00
Contribution to materials for energy recovery	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to exported energy	MJ	4.93E-03	4.32E-04	0*	3.74E-03	0*	7.56E-04	0.00E+00

 $<sup>^{\</sup>star}$  represents less than 0.01% of the total life cycle of the reference flow

Contribution to biogenic carbon content of the product kg of C 0.00E+00 Contribution to biogenic carbon content of the associated packaging kg of C 2.57E-02

<sup>\*</sup> The calculation of the biogenic carbon is based on the Ademe for the Cardboard (28%), EN16485 for Wood (39,52%), and APESA/RECORD for Paper (37,8%)

Mandatory Indicators		LED Lamp for Enclosures - NSYLAMT5LD1							
Impact indicators	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to climate change	kg CO2 eq	5.09E+01	0*	0*	0*	0*	0*	5.09E+01	0*
Contribution to climate change-fossil	kg CO2 eq	4.98E+01	0*	0*	0*	0*	0*	4.98E+01	0*
Contribution to climate change-biogenic	kg CO2 eq	1.12E+00	0*	0*	0*	0*	0*	1.12E+00	0*
Contribution to climate change-land use and land use change	e kg CO2 eq	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to ozone depletion	kg CFC-11 eq	2.18E-07	0*	0*	0*	0*	0*	2.18E-07	0*
Contribution to acidification	mol H+ eq	2.66E-01	0*	0*	0*	0*	0*	2.66E-01	0*
Contribution to eutrophication, freshwater	kg P eq	1.22E-04	0*	0*	0*	0*	0*	1.22E-04	0*
Contribution to eutrophication marine	kg N eq	3.12E-02	0*	0*	0*	0*	0*	3.12E-02	0*
Contribution to eutrophication, terrestrial	mol N eq	5.00E-01	0*	0*	0*	0*	0*	5.00E-01	0*
Contribution to photochemical ozone formation - human health	kg COVNM eq	9.88E-02	0*	0*	0*	0*	0*	9.88E-02	0*
Contribution to resource use, minerals and metals	kg Sb eq	1.65E-05	0*	0*	0*	0*	0*	1.65E-05	0*
Contribution to resource use, fossils	MJ	1.22E+03	0*	0*	0*	0*	0*	1.22E+03	0*
Contribution to water use	m3 eq	3.86E+00	0*	0*	0*	0*	0*	3.86E+00	0*

ENVPEP2202002\_V2 08-2025

LED Lamp for Enclosures - NSYLAMT5LD1								
Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
MJ	2.86E+02	0*	0*	0*	0*	0*	2.86E+02	0*
MJ	0*	0*	0*	0*	0*	0*	0*	0*
MJ	2.86E+02	0*	0*	0*	0*	0*	2.86E+02	0*
MJ	1.22E+03	0*	0*	0*	0*	0*	1.22E+03	0*
MJ	0*	0*	0*	0*	0*	0*	0*	0*
MJ	1.22E+03	0*	0*	0*	0*	0*	1.22E+03	0*
kg	0*	0*	0*	0*	0*	0*	0*	0*
MJ	0*	0*	0*	0*	0*	0*	0*	0*
MJ	0*	0*	0*	0*	0*	0*	0*	0*
m³	9.02E-02	0*	0*	0*	0*	0*	9.02E-02	0*
kg	1.41E+00	0*	0*	0*	0*	0*	1.41E+00	0*
kg	7.67E+00	0*	0*	0*	0*	0*	7.67E+00	0*
kg	1.81E-03	0*	0*	0*	0*	0*	1.81E-03	0*
kg	0*	0*	0*	0*	0*	0*	0*	0*
kg	0*	0*	0*	0*	0*	0*	0*	0*
kg	0*	0*	0*	0*	0*	0*	0*	0*
MJ	0*	0*	0*	0*	0*	0*	0*	0*
	MJ MJ MJ MJ MJ MJ MJ kg MJ MJ kg kg kg kg kg kg	MJ 2.86E+02  MJ 0°  MJ 2.86E+02  MJ 1.22E+03  MJ 0°  MJ 1.22E+03  kg 0°  MJ 0°  MJ 0°  MJ 0°  MJ 0°  kg 1.41E+00  kg 7.67E+00  kg 1.81E-03  kg 0°  kg 0°  kg 0°	MJ 2.86E+02 0*  MJ 0* 0*  MJ 2.86E+02 0*  MJ 1.22E+03 0*  MJ 0*  MJ 0* 0*  MJ 0*	Unit         [B1 - B7] - Use         [B1]         [B2]           MJ         2.86E+02         0°         0°           MJ         2.86E+02         0°         0°           MJ         2.86E+02         0°         0°           MJ         1.22E+03         0°         0°           MJ         0°         0°         0°           kg         1.41E+00         0°         0°           kg         7.67E+00         0°         0°           kg         0°         0°         0°      <	Unit         [B1-B7]-Use         [B1]         [B2]         [B3]           MJ         2.86E+02         0°         0°         0°           MJ         0°         0°         0°         0°           MJ         2.86E+02         0°         0°         0°           MJ         1.22E+03         0°         0°         0°           MJ         0°         0°         0°         0°           kg         1.41E+00         0°         0°         0°           kg         7.67E+00         0°         0°         0°           kg         0°         0°         0°         0°           kg         0°         0°         0°         0°           kg         0°         0°         0°	Unit         [B1-B7]-Use         [B1]         [B2]         [B3]         [B4]           MJ         2.86E+02         0*         0*         0*         0*         0*           MJ         2.86E+02         0*         0*         0*         0*         0*           MJ         1.22E+03         0*         0*         0*         0*         0*           MJ         0*         0*         0*         0*         0*         0*           MJ         1.22E+03         0*         0*         0*         0*         0*           kg         0*         0*         0*         0*         0*         0*           MJ         0*         0*         0*         0*	Unit         [B1-B7] - Use         [B1]         [B2]         [B3]         [B4]         [B5]           MJ         2.86E+02         0*         0*         0*         0*         0*         0*           MJ         2.86E+02         0*         0*         0*         0*         0*         0*           MJ         1.22E+03         0*         0*         0*         0*         0*         0*           MJ         0*         0*         0*         0*         0*         0*         0*           MJ         1.22E+03         0*         0*         0*         0*         0*         0*           MJ         1.22E+03         0*         0*         0*         0*         0*         0*           kg         0*         0*         0*         0*         0*         0*         0*           MJ         0	Unit         [B1-B7] - Use         [B1]         [B2]         [B3]         [B4]         [B5]         [B6]           MJ         2.86E+02         0*         2.86E+02         0*         0*         0*         0*         0*         0*         0*         0*         2.86E+02         0*         0*         0*         0*         0*         0*         0*         0*         0*         0*         2.86E+02         0*

<sup>\*</sup> represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v6.2.5-6, database version 2024-01 in compliance with ISO14044, EF3.1 method is applied, for biogenic carbon storage, assessment methodology -1/1 is used

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	ENVPEP2202002_V2	Drafting rules	PEP-PCR-ed4-2021 09 06						
		Supplemented by	PSR-0014-ed2-EN-2023 07 13						
Date of issue	08-2025	Information and reference documents	www.pep-ecopassport.org						
		Validity period	5 years						
Independent verification of the declaration and data, in compliance with ISO 14021 : 2016									
Internal X	External								
The PCR review was conducted by a panel of experts chaired by Julie Orgelet (DDemain)									
PEPs are compliant with XP C08-100-1:2016 and EN 50693:2019 or NF E38-500 :2022									
The components of the present PEP may not be compared with components from any other program.									
Document complies with ISO 14021:2016 "Environmental labels and declarations. Type II environmental declarations"									

Schneider Electric Industries SAS Country Customer Care Center http://www.se.com/contact Head Office 35, rue Joseph Monier CS 30323 F- 92500 Rueil Malmaison Cedex RCS Nanterre 954 503 439 Capital social 928 298 512 €

www.se.com

Published by Schneider Electric ENVPEP2202002\_V2 ©2024 - Schneider Electric - All rights reserved

08-2025

ENVPEP2202002\_V2 08-2025